



भारत सरकार
Government of India
विद्युत मंत्रालय
Ministry of Power
केन्द्रीय विद्युत प्राधिकरण
Central Electricity Authority
नवीकरणीय ऊर्जा उद्भव विकास प्रभाग
Renewable Energy Source Development Division
*** ** ***

No. CEA/PIg/RES-30/2017

Dated: 17-07-2017

विषय: मौजूदा पंप स्टोरेज संयंत्रों (पीएसपी) के संचालन हेतु और अन्य संबंधित मुद्दों के बारे में 28-06-2017 को नई दिल्ली में आयोजित बैठक के **मिनट्स (कार्यवृत्त)**.

Subject: **Minutes** of the meeting regarding operationalization of **existing pump storage plants (PSPs)** and related issues **held in New Delhi (at NRPC) on 28-06-2017**– reg.

महोदय/Sir,

Minutes of the meeting regarding operationalization of **existing pump storage plants** held on **28th June, 2017 at NRPC, New Delhi**, under the Chairmanship of **Member (Planning), CEA**, are enclosed herewith for your kind information and further necessary action.

Copies of the presentations made during the meeting are being sent on emails only.

बैठक के दौरान की गई प्रस्तुतियों की प्रतियां केवल ईमेल पर भेजी जा रही हैं .

कृपया पत्र की पावती दें/ Kindly acknowledge the receipt of the letter.

भवदीय/Yours faithfully

अशोक कुमार राजपूत/(Ashok Kumar Rajput)

Chief Engineer(RES Dev.)

Convener and Member Secretary

Email: ceaopmwind@gmail.com

Phone : 011-26714324 /26732257 (M) – 9868202176

सेवा भवन, आर के पुरम, सेक्टर-1, नई दिल्ली-110066 फैक्स: 011-26715402 ई मेल: ceaopmwind@gmail.com वेबसाइट: www.cea.nic.in
Sewa Bhawan, R.K.Puram-I, New Delhi-110066 Telefax: 011-26715402 Email: ceaopmwind@gmail.com Website: www.cea.nic.in

To:

1. Sh. Hanumantharayappa, Chief Engineer, Elecyc, (Planning & Co- ordination), KPTCL
2. Sh. P. Suresh Babu, Chief Engineer, SLDC & Telecom, TSTRANSCO
3. Sh. B.B. Mehta, Chief Engineer, State Load Despatch Centre, Gujarat
4. Sh. A K V Bhaskar, SE, State Load Dispatch Centre, A.P. Transco
5. Sh. P.A.R. Bende, Chief Engineer, SLDC, MPPTCL
6. Sh. Manoj Kumar, General Manager (BD&JV), NHPC Ltd.
7. Sh. Atulya Kumar Naik, AGM (Power Systems), SECI
8. Dr. P.C. Maithani, Adviser and Sh. J. K. Jethani, Scientist-D, MNRE
9. Dr. Subir Sen, COO (CTU-Plg & SG), CTU/Powergrid
10. Sh G. Chakraborty, DGM, NLDC (POSOCO)
11. Sh. S.S. Mishra, AGM (PE-Solar), and Sh. A.K. Sinha, AGM (OS-SIIS), NTPC Limited
12. Chief Engineer (IRP), CEA
13. Chief Engineer (PSP&A-I), CEA
14. Chief Engineer (PSP&A-II), CEA
15. Chief Engineer (HE&TD), CEA
16. Chief Engineer (TE&TD), CEA
17. Chief Engineer (GM), CEA
18. Chief Engineer (FM), CEA
19. Chief Engineer (F&CA), CEA
20. Secretary, CERC, New Delhi.
21. Member-Secretary (NRPC, WRPC, SRPC, ERPC & NERPC)

Copy for kind information to:

- 1) PPS to Secretary (Power), New Delhi
- 2) PPS to Secretary (MNRE), New Delhi
- 3) PPS to Joint Secretary (Ms Jyoti Arora), Ministry of Power, New Delhi
- 4) Joint Secretary (Dist), MoP, New Delhi
- 5) SA to Chairperson, CEA,
- 6) SA to Member (Hydro), CEA
- 7) SA to Member (GO&D), CEA
- 8) SA to Member (Power System), CEA
- 9) SA to Member (E&C), CEA
- 10) SA to Member (Thermal), CEA
- 11) Sr.PPS to Member (Planning), CEA

Minutes of meeting regarding operationalization of existing pump storage plants (PSPs) and related issues held at NRPC, New Delhi on 28-06-2017

In the meeting of the Technical Committee (held on 13th June, 2017 at NRPC, New Delhi) constituted by CEA under the chairmanship of **Member (Planning), CEA** for “Study of optimal location of the various types of balancing energy sources / energy storage devices to facilitate grid integration of Renewable Energy Sources (RES) and associated issues”, it was decided that a specific meeting on the operational issues of existing pump storage plants (PSPs) will be held. Accordingly, this meeting was held on 28th June, 2017 at NRPC, New Delhi, under the Chairmanship of **Shri Pankaj Batra, Member (Planning), CEA**. List of participants is given at **Annexure-1**.

Member (Planning), CEA welcomed **Member (E&C), CEA** and the participants. **The Chair** briefed the participants that in view of the increasing penetration of power from Renewable Sources of Generation (RES), having variability of generation, there is a requirement of balancing power. There could be various types of balancing sources, including the Battery Energy Storage system (**BESS**). BESS of adequate capacity could be installed near the RES pooling stations to relieve the transmission system. Depending upon the feasibility, balancing power could be sourced from Thermal Power Plants (**TPPs**) having capability of flexible load operation, **gas based** power plants and of course from operational management of various types of Hydro Power Plants (**HPPs**). Pumped Storage Power Plants (**PSPs**) offer the unique advantage of acting as generator or a load depending on the requirement of the grid. He stated that uniform Renewable Purchase Obligations (**RPOs**) have been prescribed for all the States. As RE resources are concentrated in certain states, it would be fair that the balancing cost is not shared by those states alone, but it is shared on prorata basis by all the states. Keeping this aspect in view the representatives of Electricity Regulatory Commissions (**ERCs**) were also invited in the meeting of the Technical committee held on 13-06-2017. Balancing could be done at the **state level, regional level or national level or even through balancing power sources of neighboring countries**.

The Chair stated that the option of **flexible load operation** of thermal power stations could also be used. Coal based units have lower ramp rate as compared to that of gas based plants. Hydro plants have an even faster ramp rate. He stated that ideally functional requirements for balancing services should be given and all plants who could provide these services should be allowed to compete for ensuring cheapest cost to consumer. **Member (E&C)** mentioned about a need to assess the cost economics of the options to be implemented.

Shri A K Rajput, Member Secretary of the Committee and Chief Engineer (RES), CEA welcomed **Member (Planning), Member (E&C), CEA** and the participants. He invited participants for making presentations and requested to deliberate particularly on the following aspects:

- i. Role of Hydro Power Generating sources in “**balancing power requirement**” in view of the increased penetration of RE.
- ii. Operationalization of existing pump storage plants (PSPs), which are not operational and Integrated operation of hydro power plants.

CE (HEPR), CEA made a presentation, highlighting that Nagarjunasagar, 700 MW (Revised-705.6 MW) in Andhra Pradesh is the first PSP of India (commissioned during 1980-85), but is not working in pumping mode due to delay in tail pool dam construction.

A potential of 96,524 MW (63 schemes) in the Country has been identified for pumped storage scheme on main rivers and their tributaries by Central Electricity Authority (**CEA**). It does not include the pumped storage schemes on small streams /Nallah and schemes that could be taken up on the existing reservoir schemes in operation, where pumped storage plant could be set up by constructing another reservoir upstream or downstream. Western Region (**WR**) in the Country has the highest potential for PSPs. He stated that the **basin wise review** has been taken up and would be completed in about 2 years' time. He stated that for effective development of Power system, and in particular hydro power development, there is a need to think at **National level**, rather than only at the state level.

At present, there are 9 (nine) PSPs in the Country with an installed capacity of 4785.6 MW. However, for various reasons, only 5 plants (2600 MW) are being operated in PSP mode. In case of **Panchet Hill** 1x40 MW plant of DVC, Tail Pool Dam could not be constructed due to land acquisition problem.

He stated that **Tamil Nadu** has prepared DPR of **Kundah PSP** (500 MW) and 5 projects have also been identified on existing sites. **Karnataka** has identified 2 PSPs on existing projects. In **Kerala** 3 schemes namely Sholayar-I (810 MW), Sholayar-II (390 MW) and Pringalkuthu (80 MW) have been identified on existing conventional schemes, however survey and investigation (S&I)/implementation could not be taken up for want of forest clearance. A scheme, namely Warasgaon (1200 MW) in **Maharashtra**, is under DPR stage. DPR of Malshej Ghat (700 MW) has been prepared by THDC for which implementation agreement is to be signed with the State Govt. S&I (Survey and Investigation) and preparation of DPR for Humbarli PSS (400 MW) is likely to be awarded shortly. The S&I on Chikhaldara (400MW) is in progress. In case of **West Bengal** S&I of Turga PSS (1000 MW) is completed and DPR has been concurred by CEA. The project is likely to be taken up for development after obtaining necessary clearances from Central/State Govts. S&I on Bandhu PSS (900 MW) is in progress. In **Jharkhand** S&I on Lugupahar Pumped storage Project (2800 MW) is likely to be taken up by DVC after getting permission from State Govt.

He stated that to make PSP commercially viable, there is a need of differential tariff for peak hours. He also suggested to consider Pumped storage schemes as “**Grid Element**” instead of Energy Generation Source alone. **Market based mechanism of operation through Regulatory treatment** will help in commercial viability of PSPs.

CE (HEPR), CEA stated that the funding required for operationalization of existing non-operating PSPs and future development of PSPs may be supported from Power System Development Fund (**PSDF**) or National Clean Energy and Environment Fund (**NCEEF**). Some of the identified schemes, particularly, in Western Region are located in areas which have been declared as **Wild Life Sanctuaries**. The State/Central Governments are required to take necessary action to **de-notify** such areas required for development of PSPs. State Governments should be encouraged to allocate the identified pumped storage schemes to prospective developer for implementation of PSPs, as **Water and 'Water Power' is a State subject**. It would be more cost effective to locate a pumped storage scheme where one of the reservoir i.e. upper / lower

reservoir, is already existing / under construction. The presentation made by CE (HEPR), CEA is at **Annex-A**.

Member Secretary, NRPC shared the operating experience of Sardar Sarovar Power Project (**SSP**). He expressed that for reservoir operation there is '**filling period**' and a '**depletion period**' and there is a need to follow **Rule Curve** and finalize Reservoir Operation Table (**ROT**) in advance. He emphasized on availability of **real time data acquisition**. Each Hydro Project should establish, maintain and operate a system of flood forecasting and flood control.

He expressed concerns about power house operation constraints like '**ten daily limit**' set by Reservoir Regulation Committee, '**Environmental Release**', demand of beneficiary states, irrigation demand and breach in canal etc.

He suggested that the scheduling of the generation at SSP should be done on "Best Fit Schedule (**BFS**)" and energy consumed by SSP during Pumping mode should be distributed among beneficiary States in the ratio of their shares in SSP. He stated that **Tribunal Orders/Awards** are also binding, posing another constraint. He summarised his presentation as below:

- i. Simultaneous Pumping and Straight generation not to be permitted.
- ii. Sharing of operation and maintenance (O&M) expanses, to be agreed apriori among beneficiaries.
- iii. Separate energy account for Straight generation, pumping energy & power generation from pumped water.
- iv. Separate water account to be maintained for pumped water and inflow water.
- v. Peak hours may be different for beneficiary States. Generation from pumped water to be scheduled keeping in view the grid requirement.

There are inter-state issues in operationalization of SSP in Pump Storage Mode. In order to resolve the issue of operationalization of SSP in PSP mode, it was decided to have a focused **meeting on the issues of SSP in CEA** where all stakeholders need to deliberate the issue. **Hydro Wing CEA to coordinate this meeting**. Presentation made by MS, NRPC is at **Annex-B**.

Representative of **THDC** made a presentation and salient features of Tehri Hydro Power Complex, were highlighted:

Tehri Hydro Power Complex (2400 MW) is a multipurpose project, stores water, meets irrigation requirement of Uttar Pradesh (UP) and drinking water requirement of UP & Delhi in addition to provide peaking support to Northern Grid.

Tehri reservoir stores water during monsoon period whereas Koteshwar reservoir in downstream serves the purpose of daily regulation of water released from Tehri. After commissioning of Tehri PSP, Koteshwar reservoir will also function as lower reservoir for PSP. During non-monsoon period (about 270 days) seven (7) hours of pumping has been estimated while during monsoon due to spillage, there is no requirement of pumping. For Integrated operation of Tehri PSP, Tehri HPP and Koteshwar HEP, total time required in one cycle is 11 hours (4 hours in generating mode and 7 hours in pumping mode). He informed that PSP is good option and proven technology for large scale storage and grid stability and helps in mitigating the intermittency of renewable energy. He mentioned that scheduling shall entirely depend on margin available in balancing reservoir instead of daily basis, hence provision for **flexible scheduling** needs to be devised in Indian Electricity Grid Code (**IEGC**) for PSP. He further added

that there should be provision of flexible scheduling in case of multipurpose project. The presentation made by THDC is at **Annex-C**.

A presentation was made by **Dr Anoop Singh, Professor, Deptt. of Industrial and Management Engineering Indian Institute of Technology Kanpur** on Economic Value of Pumped Storage in a Power System with Solar PV. He mentioned that in a generic sense, all the technologies could compete with each other, but certainly there are economic advantage of PSPs. The following are the highlights of the presentation:

In order to redress the issue of variability of renewable generation (VRE) the focused approach could be - Better RE forecasting, Better load forecasting, Load shifting from peak to off peak of the load curve, and Energy Storage Systems (ESS) that could store the surplus generation and utilize it during times of low or no generation. A case study was presented, in which a unit commitment power system model is setup to analyse the impact of ESS for VRE sources. Pumping facility of a hydro unit adds value, depending on case to case basis. The Summary of study highlights that power system (society) is losing economic benefit of investments made in PSPs, if these are not operated in an economic manner. PSPs can assist Greater penetration for Variable Renewable Energy (VRE) in the system. The presentation made by Dr Anoop Singh is at **Annex-D**.

Representative of **SRLDC** made a presentation and stated that in the Southern Region, Hydro Power is highly Monsoon Dependent, Hydro is mostly utilized for the morning and the evening peak ramping requirements. Presently pumped storage installed capacity in Southern Region is 2005 MW at **Srisailem Left Bank (Lb), Nagarjunsagar** and **Kadamparai**.

He expressed that in case of **Srisailem Left Bank**, there is a generation constraint. The Dam is under the control of Krishna Irrigation Department. In case of additional requirement due to grid conditions, special permission is to be obtained. It cannot be Operated at less than 110 MW due to Vibration problem.

Pump Operation at **Srisailem Left Bank** is dependent on **Nagarjunsagar Dam** level, as Srisailem Tail Race WEIR is under repair. 540 ft water level is required at Nagarjunsagar for pump operation at Srisailem. Water above this level is available only for about 2-3 months a year. The weir between Srisailem Reservoir and Nagarjunsagar Reservoir, which is used for pumping operation is not operational, since last two years. Attempts to repair the weir have not been successful. He stated that during the monsoon, water from Maharashtra (Narayanpur side) comes in huge quantity, all of a sudden, and it is one of the cause of damage of the said weir. The issue of damage and need to repair the weir had been taken up with CEA/CWC also. ***It was decided that SRPC should write to CEA (Member Hydro) indicating the specific issues, and at the same time Andhra Pradesh and Telangana should also write to Member Hydro, CEA to resolve the issue of weir repair and strengthening.*** Each unit takes around 20 – 30 minutes from standstill to pumping mode. He stated that other constraints are -shifting of lift irrigation pumps to avoid possible submergence. 7 TMC of water is required in the Tail Pond Reservoir for pumping operation, out of which, 6 TMC was dead storage while one (1) TMC could be utilized for pumping operation. For pumping mode, the level required in Tail Pond Reservoir was higher than the MDDL for 2x25 MW generating station under APGENCO, TSGENCO suggestion us that APGENCO station may operate its unit when water level is above the level required for pump mode and whenever discharge

was there from main Nagarjunasagar Reservoir. Vibration was observed when generation is less than 65 MW for Unit#1 & 55 MW for Unit#2 to 8.

SRLDC presented the constraints in operation at **Kadamparai**, which are due to low voltage at 230 kV level, due to which the stator draws more current, which can damage the windings. There is water shortage also during non-monsoon months. The presentation made by SRLDC is at **Annex-E**.

The representative of **SRPC** made a presentation and indicated that of total Capacity of 2005 MW of PSPs in Southern Region, only 1300 MW is operational (at Srisaillam and Kadamparai). For pump mode Operationalization of Nagarjunasagar, there are certain issues between Andhra Pradesh and Telangana, main being *discharge quantum and time duration*. It was decided that the mechanism for enabling pump mode operation/utilization of the water pumped back could be referred to CEA for further guidance and suitable directions.

SRPC stated that Commercial framework and an incentive scheme may be designed for **Regional balancing**. **Andhra Pradesh (AP)** is preparing DPR for Pumped Storage Scheme of 1000 MW at Upper Sileru, which is at finalisation stage. **KPCL (Karnataka)** through WAPCOS Ltd got prepared a project report on **Sharavathy** Pumped Storage Scheme, Pre-feasibility Report (PFR) has indicated the capacity of 2000 MW. PFR has been submitted to Ministry of Environment and Forest (MOEF) for first stage clearance. PFR for **Varahi** Pumped Storage scheme is also under preparation. The presentation made by SRPC is at **Annex-F**.

SLDC Chennai gave a presentation about **Kadamparai** Pumped Storage Scheme, in which during non-peak hours water from Upper Aliyar Dam is pumped to Kadamparai dam. Prior to 2002, grid was operated at low frequency (i.e. between 48.5 Hz & 49.0 Hz) and almost no surplus power was available during off peak time for pumping.

For pump mode operation, **Kadamparai** plant is designed between 49.5 Hz and 50.5 Hz. The motor input required is about 110 MW. If all the four units are operated as pump, then the power input required at station end is about 440 MW. First time, on 12-02-2003 only, all the four units were put on pump mode, though the station was commissioned in 1989. **At present due to failure of monsoon the water level at Kadamparai is very low, hence it cannot be used in generating mode and due to very less storage in Upper Aliyar it also cannot be used as pump mode effectively.** This leads to difficulty in absorption of Renewable Energy (RE). Because of less hydro storage due to failure of monsoon, the cheapest hydro sources in Tamilnadu are used as peaking stations only. The presentation made by SLDC of Tamilnadu is at **Annex-G**.

Representative of **GSECL (Gujarat)** expressed that in year 2004-05, **Kadana** Hydro Electric Project (KHEP) units were run in pumping mode, but the machine did not operate smoothly and some problems were observed such as high eddy current drawn in reactor, frequent rotor earth fault resulting in puncture of slip ring insulated bolts, vibration at the dam and penstock area, Rise of TGB (Turbine Generator Bearing) temperature and machine vibration.

GSECL held a meeting with M/s BHEL at Bhopal on 6/08/2015 regarding feasibility of pump mode operation of KHEP units, where it was advised by BHEL that keeping in view the past experience, the machines should not be operated in pump mode operation. As per requirement of SLDC, KHEP again asked to M/s. BHEL and OEM M/s CKD Balnsko (Czechoslovakia) for the budgetary offer for the pump mode

operation of KHEP units. M/s Voith Hydro Noida has also been requested by them to submit their budgetary offer. OEM M/s CKD Balnsko had plan to visit KHEP during 11/7/2017 to 20/7/2017. BHEL would also be participating. The presentation made by GSECL is at **Annex-H**.

Representatives of **Maharashtra** and **TATA Power** made a joint presentation. It was stated that at present Ghatghar, Paithan & Bhira Hydro Pumped Storage Plants are in operation in Maharashtra. Ghatghar is used in generation mode operation in morning peak hours and Evening peak hours (2x125 MW) or whenever required and to reduce over drawl from grid during low frequency. In Ghatghar, units are available within 15 minutes of giving instructions and once taken as generator, the unit is operated for a minimum of 1 (one) hour. Further, its capacity is very less compared to what is required to meet the peak demand. But it is useful in relieving congestion or constraints, in case of line or unit tripping and can also provide support during black start.

Bhira Pumped Storage Plant is designed to pump water from Bhira Tail Race Pickup (**BTRP**) pond to Mulshi lake. Problems faced in Bhira Hydro Pumped Storage Plant are that pumping would be possible only during off peak hours and when Bhira Old Power House and Rawalje Power House are not generating and Rawalje pickup pond level should be a minimum of 94.4 m during starting and more than 93.85 m throughout the pumping operation.

The following measures were suggested to resolve the issue of tail race level:

- To control the water level in pick-up pond a gate has to be provided in between the forebay and pick-up pond.
- An agreement for design of gated bypass channel and coffer dam for the BTRP project has been made with Central Design Organization, Nashik.

The presentation made by Maharashtra is at **Annex-I**.

The representative of **WBSEDCL, West Bengal** made a presentation, citing the problem of RE integration due to fluctuating RE generation in West Bengal, where major share of generation is from thermal energy. They suggested development of additional pumped storage hydro project, to take care of the fluctuating RE generation.

He stated that the **Purulia** PSP (900 MW) project provides several benefits in managing the grid. He stated that for a stable grid, the ratio of peak load plant to base load plant should be 40:60. He stated that bulk energy storage would promote development of RE. It was suggested that in order to compensate for the losses due to cycle efficiency, there should be incentives in tariff to the PSP and a grant of 15% of project cost. The presentation made by West Bengal is at **Annex-J**.

The representative of **BHEL** presented the contribution of BHEL in Hydro Power development and presented BHEL's manufacturing capabilities. Though BHEL has not directly supplied PSPs, but in association with other companies, they have executed the projects. BHEL has got experience of high capacity pumps. BHEL proposed themselves as a qualifier for PSPs tenders in future. BHEL has contracted 5877 MW of pumps for various lift Irrigation Schemes. Largest pump is of 145 MW unit rating. It was informed that their State of the Art turbine model testing Laboratory is at Bhopal and they are the only hydro equipment manufacturer in India having a model

test lab. They have been recognized by the Department of Scientific & Industrial Research (**DSIR**), Government of India as in-house R & D group for Hydraulic Design & Development of Hydro Turbines. Advance Research is undertaken by BHEL in the field of hydraulic machinery. They mentioned that Hydro pumped storage systems shall play an important role in providing storage of power and maintaining grid stability and most of the developed countries are following this route. Hydro pump storage system is the only long term technically proven solution without any restriction of Unit capacity, is cost-effective, highly efficient and provides operationally flexible energy storage on a large scale and is available on short notice.

BHEL requested for consideration on following points and also requested for modifying the Qualification requirements.

- i. Even though BHEL has been associated in execution of Six PSS projects, BHEL does not possess the qualification requirements, as orders were placed on foreign manufactures, with BHEL as partner.
- ii. BHEL over the years, has developed its own technology and is capable of supplying PSS schemes.
- iii. BHEL is already a leader in design, engineering & supply of large size pumps for Lift Irrigation Schemes.
- iv. In view of forthcoming requirement of PSS, it would be in the interest of all stakeholders to qualify BHEL for future PSS tenders.
- v. E&M package to be a standalone Package (excluding any civil works); Alternatively, E&M works vendor can be a nominated sub-vendor to the civil party.
- vi. Options for qualification should be available to companies like BHEL, who have earlier executed reversible Pump-Turbine sets in India in association with established Pump-Turbine manufacturers.

The presentation made by BHEL is at **Annex-K**.

The conclusions from the meeting are summarized below:

1. **Saradar Sarovar Project** - It was decided to have a focused meeting on the issues of SSP in CEA where all stakeholders need to deliberate the issue. **Hydro Wing of CEA** may coordinate this meeting.
2. **Srisaillam Left Bank** - It was decided that SRPC should write to CEA (Member Hydro) indicating the specific issues and at the same time Andhra Pradesh and Telangana should also write to Member Hydro, CEA to resolve the issue of weir repair and strengthening.
3. **Nagarjunasagar** - For pump mode Operationalization of Nagarjunasagar there are certain issues between Andhra Pradesh and Telangana, main being discharges quantum and time duration. It was decided that the mechanism for enabling pump mode operation/utilization of the water pumped back could be referred to CEA for further guidance and suitable directions.

The meeting ended with a vote of thanks to the Chair.

Annexure-1

List of participants of meeting regarding operationalization of existing pump storage plants (PSPs) and related issues held in New Delhi (at NRPC) on 28-06-2017

S.No	Name	Designation	Organization	Ph.No/Fax No	Mobile No	Email Id.
1	Sh. Pankaj Batra	Member (Pgl)	CEA	011-26732202	9350981062	pan_batra@hotmail.com
2	A.K.Rajput	Chief Engineer	CEA	011-26732020	9868202176	rajput.ashok@gmail.com
3	Naresh Bandari	CE (Communication)	CEA			nbnareshbhandari@gmail.com
4	C.P.Jain	Dir.	CEA	011-26732852	9871305009	cpj60@rediffmail.com
5	L.Satyanarayana	Dy.Director	CEA	011-26732256	9818327046	lsn262003@yahoo.co.uk
6	Sneha	AD	CEA	011-26732255	9013213867	snehabit@gmail.com
7	Hoshiyar Singh	D.E.O	CEA		9911118997	hoshiyarsingh393@gmail.com
8	Sumit Sinha	AD-1	CEA	011-27602236	9717484055	sumitsinha66@gmail.com
9	Upendra Kumar	Dir.	NRPC	011-26513265	9910180485	upendra0309@gmail.com
10	MAKP Singh	Member Sec.	NRPC		9425066437	makpsingh@yahoo.com
11	Apporva Anand	AD	CEA		7042157177	anand.apoorva@gmail.com
12	B.S Meena	EE (O) NRPC	NRPC		8750251805	bhanwarmeenamop@gmail.com
13	Ajay Bhatuagar	Consultnt (Tech)	NRPC		9910952459	ajaysb10@gmail.com
14	Sushuma Kumari	AGM	NTPC		9650990191	sushumakumari@ntpc.co.in
15	Uday Shankar	DGM(OS)	NTPC		9650990096	sunouday@gmail.com
16	Rajendra Kumar	A.Engineer(SCADA)	RVPV,Jaipur		9413383221	aenssdasldc@gmail.com
17	V.V Ramane Murty	DE	APTRANSCO		9490153120	de.scada.uldcaptransco.gov.in
18	Vasant. D. Pande		SLDC Maharashtra MSETCL	022-27601758	9820741941	vasant.pande@mahasldc.in
19	Neeraj Verma	DGM	THDC India Ltd, Rishikesh		9997999111	nvermathdc@gmail.com
20	G.Ramaniaeyulu	Asst. Engineer	CERC New Delhi		9811555001	ramcerc@gmail.com
21	M.M.Chaudhary	Dy Chief Engineer	CERC New Delhi		9953929114	mmc.cerc@gmail.com
22	K.K. Parbhakar	Chief Engineer	MP-SLDC		9425805267	kkparbhakar@yahoo.co.in
23	Shankar Chakraborty	EE	MPSLDC		9425805248	s.chakraborty.ibl@gmail.com
24	Debasis De	AGM	NRLDC, POSOCO		9560665333	debasis.de@posoco.in
25	Kashish Bhambhani	Chief MGR	Power Grid		9971399117	kashish@powergridmd.com
26	Mithur Dubey		RE Connect Energy, Gurgoan		9910623960	mithur.dubey@reconnectenergy.com
27	O.P Taneja		IWTMA, New Delhi		9971096623	ad.delhi@indianwindpower.com
28	Rajiv Aggarwal		ICPPA, New Delhi		9871574111	icppassociation@gmail.com
29	Amit Angra		HEIDELBERG CEMENT		9873951700	amit.angra@heidelbergcement.com
30	P. Raja Gunanihi		TANTRANSCO		9445857186	eegrid@tnebnet.org
31	T.R Ganesh	Sr. Manager	SRLDC POSOCO		9449599164	tr_ganesh@yahoo.com
32	Jairan K.V.	EE	KSEB Ltd. Kerala SLDC		9446008247	eeckkly@gmail.com
33	N.Manjunatha	SE-SRPC,	CEA-SRPC, Bangalore		9448790396	n.manjunatha@gov.in
34	K. Mandhava Rao	DE (SCAOA)	TSTRANSCO		9490153119	cesldctelangana@gmail.com
35	Naresh Panchal	Head &VP - PE	Suzlon Energy Ltd.	020-67025034	9850829701	pnaresh@suzlon.com
36	NSM Rao		Suzlon Energy Ltd.	020-67025003	9922937701	nsm.rao@suzlon.com
37	Coc Vinay Gupta	RETD	Suzlon Energy Ltd.	020-67022507	9167991372	vinay.gupta@suzlon.com
38	A.D. Thirnmoothy	Chief Technical Advisor	Indian Wind Power Office		9965549894	adtmoorthy@gmail.com
39	K. Thyagaraj		KPTCL Bengaluru		9448365432	secscada@gmail.com
40	Naresh Kumar		PCD/CEA		8860310642	celdntcea@gmail.com
41	Ajay Aggarwal		Scope T&M Pvt Ltd.		97177466224	ajay.aggarwal@scopetnm.com
42	Siddharth Arora		CERC New Delhi		9766405417	sid.cerc@gmail.com

Secretary Power etc

secy-power@nic.in, secy-mnre@nic.in, pan-batra@hotmail.com, i.arora@nic.in, arun.verma@nic.in, chair@nic.in, singhvi.cea@gmail.com, kk.arya58@gov.in, balwan72@nic.in, ravi2658@yahoo.co.in, re_cea@rediffmail.com, psmhaske@yahoo.com, memberspscea@nic.in, somit.d@nic.in, somit.d@gov.in, aruncea@nic.in, pdswal@yahoo.com, ashok1959@nic.in, ykashyap95@gmail.com, gulshannarang786@yahoo.co.in, ceaopmwind@gmail.com, cerndcea@gmail.com, rstomer@nic.in, ceitcea@gmail.com, itcea@nic.in, ddirpcea2015@yahoo.com,

Committee Members, MS RPCs

ceepnc@gmail.com , cesldctelangana@gmail.com , celd@gebmail.com , akvbhaskar@gmail.com , slcempjbg@gmail.com , parbende@gmail.com , ce.ld@rvpn.co.in , aks40aks@gmail.com , se.remc@rvpn.co.in , cesldc@mahasldc.in , directoropn@tnebnet.org ,	seremc@tnebnet.org , eegrid@tnebnet.org , rajagunani@nic.in , ajagunani@nic.in , seeremc@tnebnet.org , mkomar@nhpc.nic.in , aknaik@seci.co.in , pcmailhani@nic.in , jethani.jk@nic.in , subir@powergridindia.com , gchakraborty@posoco.in , c.goutam62@gmail.com , ssmishra@ntpc.co.in ,	mssrpc@yahoo.com , nerpc@ymail.com , b_lyngkholi@yahoo.com , msnrcpl@yahoo.com , ms-nrpc@nic.in , ms-wrpc@nic.in , ma_balan@hotmail.com , mserpc-power@nic.in , anjansinha01@ntpc.co.in , secy@cerind.gov.in , cerc.ra@gmail.com , ms-wrpc@nic.in , ma_balan@hotmail.com ,
---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Ces of CEA

ceirpcea@yahoo.com
skrmohapatra@rediffmail.com
Ravindergupta_cea@rediffmail.com
ravindergupta_cea@nic.in

prabhatkureel@yahoo.co.in
prabhat.kureel@gov.in
ldpapney@gmail.com
cegmece1@gmail.com
pranika30@yahoo.com
ajay.talegaonkar@gmail.com
ajay.talegaonkar@nic.in
ceaopmwind@gmail.com
nbnareshbhandari@gmail.com

Participants (PSP-28-06-2017)

Email Id.	de.scada.uldceaptransco.gov.in ,	eegrid@tnebn.net
pan_batra@hotmail.com ,	vasant.pande@mahasldc.in	tr_ganesh@yahoo.com
rajput.ashok@gmail.com ,	nvermathdc@gmail.com	eedckly@gmail.com
nbnareshbhandari@gmail.com ,	ramcerc@gmail.com	n.manjunatha@gov.in
cpj60@rediffmail.com	mmc.cerc@gmail.com	cesldctelangana@gmail.com
lsn262003@yahoo.co.uk	kkparbhakar@yahoo.co.in	pnaresh@suzlon.com
snehabit@gmail.com	s.chakraborty.jbl@gmail.com	nsm.rao@suzlon.com
hoshiyarsingh393@gmail.com	debasis.de@posoco.in	vinay.gupta@suzlon.com
sumitsinha66@gmail.com	kashish@powergridmd.com	adtmoothy@gmail.com
upendra0309@gmail.com	mithur.dubey@reconnectenergy.com	seccada@gmail.com
makpsingh@yahoo.com	ad.delhi@indianwindpower.com	ceidntcea@gmail.com
anand.apoorva@gmail.com	icppassociation@gmail.com	ajay.agarwal@scopetnm.com
bhanwarmeenamop@gmail.com	amit.angra@heidelbergcement.com	sid.cerc@gmail.com
ajaysb10@gmail.com		
sushumakumari@ntpc.co.in		
sunouday@gmail.com		
aenssdasldc@gmail.com		

To whom Meeting Notice was sent (PSP)

<p>secy-power@nic.in, secy-mnre@nic.in, chair@nic.in, devroop_singhvi <singhvi.cea@gmail.com>, kk.arya58@gov.in, kkarya_2001@rediffmail.com, pan_batra@hotmail.com, balwan72@nic.in, Shantanu Biswas <re_cea@rediffmail.com>, psmhaske@yahoo.com, "SA to Member(Planning)" <ddirpcea2015@yahoo.com>, Awdhesh Yadav <awd.cea@gmail.com>, y Kashyap95@gmail.com, ashok1959@nic.in, gulshannarang786@yahoo.co.in, nhdc@nhdcl.com, dirpr@bbmb.nic.in, cman@bbmb.nic.in, mdssnl2009@gmail.com, uppsanjay@gmail.com, sanjay.uppal@sjvn.nic.in, sectt.cmd@sjvn.nic.in, vkbadori@thdc.gov.in, uckannaujia@thdc.co.in, CESLDC Telangana <cesldctelangana@gmail.com>, CE SLDC Gujrat <celd@gebmail.com>, cmdnhpc@nic.in, "Chief Engg.SLDC" <cesldc@mahasldc.in>, cmd@wbpdcl.co.in, cednhdc@yahoo.com, memberdr@nic.in, wrlccr@posoco.in, memberdr-cwc@nic.in, svsrivastava@nhpc.nic.in, Manoj Kumar <mkumar@nhpc.nic.in>, CMD NHPC <cmd@nhpc.nic.in> Prashant Atrey <prashantatrey@nhpc.nic.in>, Cherian Mathew <cmathew@nhpc.nic.in>,</p>	<p>cmd@thdc.gov.in, wbpdcl@wbpdcl.co.in, mdr@nic.in, CE SLDC Gujrat <celd@gebmail.com>, eegrid@tnebn.net, rajaganidhi@yahoo.co.in, Tamil Nadu <chairman@tnebn.net>, Chief Engineer pnc <ceepnc@gmail.com>, dgnpti@npti.in, akv bhaskar <akvbhaskar@gmail.com>, "S.S. Mishra" <ssmishra@ntpc.co.in>, cmd <cmd@ntpc.co.in>, anjansinha01@ntpc.co.in, pkagarwal@gmail.com, alok.kumar@posoco.in, alokkumar73@gmail.com, gchakraborty@posoco.in, Goutam Chakraborty <c.goutam62@gmail.com>, webmaster@nhpc.nic.in, cmd-mis@nhpc.nic.in, dpbhargava@nhpc.nic.in, ajoshi@bhel.in, secycerc@gmail.com, secy@cercind.gov.in, cmdrsd@bhel.in, harjit@bhel.in, "Shri Subrata Biswas, Dir (E,R&D)" <biswas@bhel.in>, "Somnath Mondal SA to (Director Power)" <snm@bhel.in>, Shri Dinesh Kumar <dinesh.kumar@bhel.in>, satyan@bhel.in, Akhil Joshi <ajoshi@bhel.in>, snm@bhel.in, ceahedp@yahoo.com, CEA CEGM <cegmece1@gmail.com>, dchandra.cea@nic.in,</p>	<p>cerc RA <cerc.ra@gmail.com>, Manoj Kumar <mkumar@nhpc.nic.in>, biswas@bhel.in, ANBUNESAN GOVINDASWAMY <anbunesang@gmail.com>, shilpadce@yahoo.com, sushanta_chat@yahoo.com, chairman@dvc.gov.in, Slde Mpseb <slcdmpjbp@gmail.com>, "P.A.R. Bende" <parbende@gmail.com>, subir@powergridindia.com, PC Maithani <pcmaithani@nic.in>, Jeevan Kumar Jethani <jethani.jk@nic.in>, pradeep_shukl@yahoo.com, jaideepbawa@nic.in, Jaideep Bawa <jaideep.bawa@yahoo.com>, jaideepbawa@yahoo.co.in, SIC Power Sector <ceirpcea@yahoo.com>, joydev042000@yahoo.co.in, prabhat.kureel@gov.in, ajay.talegaonkar@nic.in, Ajay Talegaonkar <ajay.talegaonkar@gmail.com>, san.srivastava@gov.in, dchandra.cea@nic.in, CEA CEGM <cegmece1@gmail.com>, msnrpc1@yahoo.com, ms-nrpc@nic.in, makpsingh@yahoo.com, member Secretary SRPC <msnrpc@yahoo.com>, ms-wrpc <ms-wrpc@nic.in>, ma_balan@hotmail.com, msercp-power@nic.in,</p>
------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

upper reservoir


**PUMPED STORAGE HYDRO
CURRENT SCENARIO
&
FUTURE POTENTIAL**

**P.K.SHUKLA
Chief Engineer
CEA**

penstock

turbine
generator

lower
reservoir

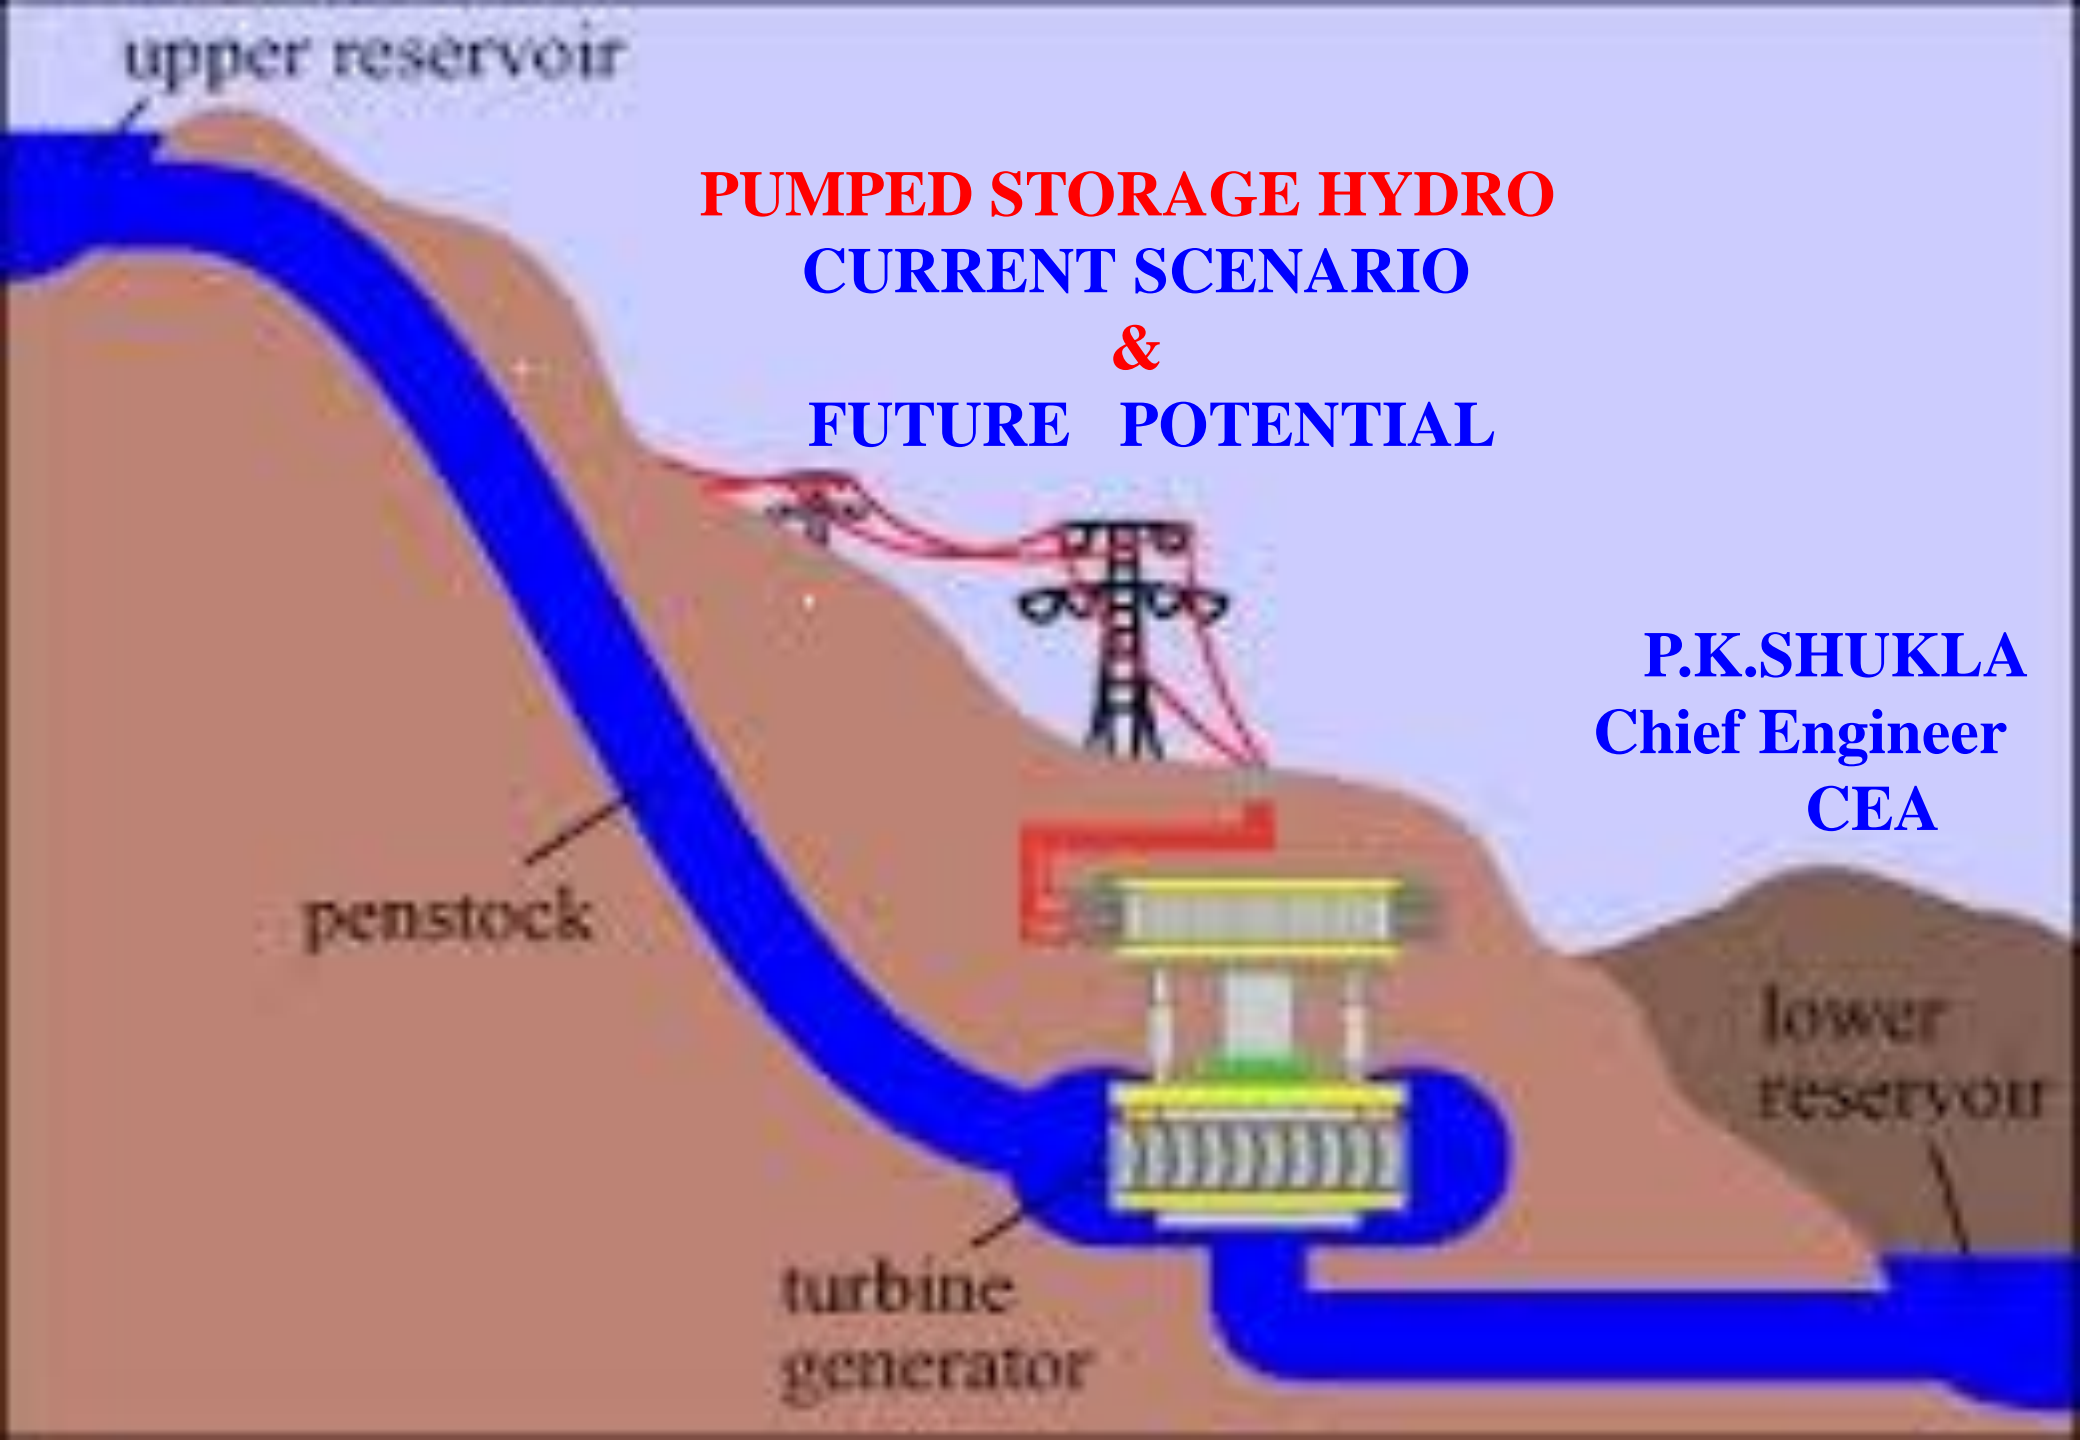

Pumped Storage Hydro-Electric Projects

- SCHEME WITH TWO RESERVOIRS ,UPPER & LOWER, WATER FLOWS FROM UPPER RESERVOIR TO LOWER RESERVOIR DURING GENERATION AND VICE VERSA DURING PUMPING
- ENERGY TO BE SUPPLIED FOR ENERGY PRODUCTION

First Pumped Storage Project in India

In India the first pumped storage plant was taken up at Nagarjunasagar in Andhra Pradesh in the year 1970 with an installed capacity of 700 MW (Revised-705.6 MW). The Project got commissioned during 1980-85.*

***The project is not working in pumping mode as the tail pool dam construction took a long time and still not functional.**

Status of Pumped Storage Potential

- **Identified Sites** **63 nos.**
- **Probable Installed capacity** **96,524 MW**

Region	Probable Installed Capacity (MW)	Capacity Developed (MW)	Capacity under Construction (MW)
Northern	13065(7 Nos.)	0	1000(1 Nos.)
Western	39684(29 Nos.)	1840(4 Nos.)	80(1 Nos.)
Southern	17750(10 Nos.)	2005.6(3 Nos.)	0
Eastern	9125(7 Nos.)	940(2 Nos.)	0
North Eastern	16900(10 Nos.)	0	0
Total	96524(63 Nos.)	4785.6(9 Nos.)*	1080(2 Nos.)

*In addition 2 Nos. of schemes namely Paithan(12 MW) and Ujjaini(12 MW) in Aurangabad and Solapur in Maharashtra are under operation.

Western region has the largest potential (about 41% of the total) for development of pumped storage plants. This is mainly due to the topographical features with steep gradients of the rivers originating from the Western Ghats.

Pumped Storage Hydro-Electric Potential and its Status of Development in the Country -

Northern Region

State	Probable Installed Capacity (MW)	Capacity Developed (MW)	Capacity under Construction (MW)
Jammu & Kashmir	1650(1Nos.)	0	0
Himachal Pradesh	3600(2 Nos.)	0	0
Uttarakhand	4035(2 Nos.)		1000(1 Nos.)
Rajasthan	3780(2Nos.)	0	0
Total	13065(7Nos.)	0	1000(1 Nos.)

Pumped Storage Hydro-Electric Potential and its Status of Development in the Country -

Western Region

State	Probable Installed Capacity (MW)	Capacity Developed (MW)	Capacity under Construction (MW)
Madhya Pradesh	6150 (4Nos.)	0	0
Chhattisgarh	5000(3 Nos.)		
Maharashtra	27094(20Nos.)	400(2 Nos.)	80(1 Nos.)
Gujrat	1440(2 Nos.)	1440(2 Nos.)	0
Total	39684(29Nos.)	1840(4 Nos.)*	80(1 Nos.)

*In addition 2 Nos. of schemes namely Paithan(12 MW) and Ujjaini(12 MW) in Aurangabad and Solapur in Maharashtra are under operation.

Pumped Storage Hydro-Electric Potential and its Status of Development in the Country -

Southern Region

State	Probable Installed Capacity (MW)	Capacity Developed (MW)	Capacity under Construction (MW)
Andhra Pradesh & Telangana	2350(2 Nos.)	1605.6(2 Nos.)	0
Karnataka	7900(4 Nos.)	0	0
Kerala	4400(2 Nos.)	0	0
Tamil Nadu	3100(2 Nos.)	400(1 Nos.)	0
Total	13065(10Nos.)	2005.6(3 Nos.)	0

Pumped Storage Hydro-Electric Potential and its Status of Development in the Country -

Eastern Region

State	Probable Installed Capacity (MW)	Capacity Developed (MW)	Capacity under Construction (MW)
Jharkhand	2800(1 Nos.)	0	0
Odisha	2500(1Nos.)	0	0
West Bengal	3825(4 Nos.)	940(2 Nos.)	0
Total	9125(6 Nos.)	940(2 Nos.)	0

Pumped Storage Hydro-Electric Potential and its Status of Development in the Country -

North Eastern Region

State	Probable Installed Capacity (MW)	Capacity Developed (MW)	Capacity under Construction (MW)
Manipur	4350(2 Nos.)	0	0
Assam	2100(1 Nos.)	0	0
Mizoram	10450(7 Nos.)	0	0
Total	16900(10 Nos.)	0	0

Pumped storage Schemes Potential

- The potential of 96524 MW (63 schemes) has been identified on **main rivers and their tributaries** during the reassessment studies carried out by CEA in 1978-87.
- It does not include the pumped storage schemes on small streams /Nallah.
- It does not include the schemes that could be taken up on the existing reservoir schemes in operation, where pumped storage plant could be set up by constructing another reservoir upstream or downstream.

Pumped storage plants in operation

- **At present 9 pumped storage schemes with aggregate installed capacity of 4785.6 MW are in operation in the country.**
- **Out of these, only 5 No. of plants with aggregate installed capacity of 2600 MW are being operated in Pumping mode.**

Pumped storage plants in operation in Pumping Mode

S. No.	Name of Project	State	Installed Capacity(MW)
1.	Kadamparai	Tamil Nadu	4x 100=400
2.	Bhira	Maharashtra	1x150=150
3	Srisailam LBPH	Telangana	6x150=900
4	Purulia PSS	West Bengal	4x225=900
5.	Ghatghar	Maharashtra	2x125=250
		TOTAL	2600

Pumped storage plants not operating in Pumping Mode

S. No.	Name of Project	State	I.C. (MW)	Reasons for not working in pumping mode	Present Status
1.	Kadana St. I&II	Gujarat	2x60+ 2x60 =240	Due to vibration problem	BHEL has been asked to study and rectify the problem
2.	Nagarjuna Sagar	Telangana	7x100.80 = 705.60 (Revised)	Tail pool dam not yet operational	Telangana and Andhra Pradesh to take action for making tail pool dam operational
3.	Sardar Sarovar	Gujarat	6x200 =1200	Tail pool dam under construction	Likely to be completed by Oct'2018
4.	Panchet Hill	DVC	1x40=40	Tail pool dam not constructed	It has been decided not to operate project in pumping mode due to land acquisition issues of Lower Reservoir
		Total	2185.6		14

States/Regions taking up Pumped Storage Hydro Projects Development

Southern Region

Tamil Nadu

- **Tamil Nadu has prepared DPR of Kundah PSP(500 MW) and taken up the Development of the project in 4 stages.**
- **The following 5 projects have been identified on existing projects:**
 - **Sillahalla PSP(2000 MW)**
 - **Kodayar PSP(500 MW)**
 - **Manalar PSP(500 MW)**
 - **Mettur PSP(500 MW)**
 - **Upper Bhavani PSP(500 MW)**

Southern Region

Karnataka

- **State has identified 2 pumped storage schemes on existing projects :-**
 - **Sharavathy(2000 MW)**
 - **Varahi(700 MW)**

Southern Region

Kerala

- **3 schemes namely Sholayar I (810 MW), Sholayar II (390 MW) and Pringalkuthu(80 MW) have been identified by State Govt on existing conventional schemes, however S&I/implementation could not be taken up in view of non-availability of Forest clearance.**

Western Region

Maharashtra

- **One scheme namely Warasgaon(1200 MW) is under S&I/DPR stage by State Govt.**
- **DPR of Malshej Ghat(700 MW) have been prepared by THDC for which implementation agreement to be signed with State Govt.**
- **The work of S&I and preparation of DPR for Humbarli PSS (400 MW) is likely to be awarded shortly.**
- **The S&I on Chikhaldara (400MW) is in progress.**

Eastern Region

West Bengal

- **S&I of Turga PSS(1000 MW) is completed and DPR has been prepared/concurred by CEA. The project is likely to be taken up for development after obtaining necessary clearances from Central/State Govts.**
- **S&I on Bandhu PSS (900 MW) is in progress.**

Eastern Region

Jharkhand

- **S&I on Lugupahar Pumped storage Project(2800 MW) is likely to be taken up by DVC after getting permission from State Govt.**

TENTATIVE LIST OF PUMPED STORAGE SCHEMES IDENTIFIED FOR BENEFITS DURING COMING PERIOD

S.No.	Name of Project	State	I.C. (MW)	Agency	Present Status
1	Tehri PSS	Uttarakhand	1000	THDC	Under Construction Comm. 2018-19
2	Koyna Left Bank	Maharashtra	80	GoMWRD	Under Construction Comm.2018-19
3	Kundah	Tamil Nadu	500	TANGEDCO	DPR Prepared. Project taken up in 4 stages
4	Turga	West Bengal	1000	WBSEDCL	DPR concurred by CEA
5	Lugupahar	Jharkhand	2800	DVC	To be taken up under S&I
6	Malshej Ghat	Maharashtra	700	NPCIL &THDC	IA yet to be signed with State Govt.DPR prepared

S.No.	Name of Project	State	I.C. (MW)	Agency	Present Status
7	Humbarli	Maharashtra	400	NPCIL & THDC	Under Survey & Investigation
8	Warasgaon	Maharashtra	1200	GoMWRD	Under Survey & Investigation
9	Chikhaldara	Maharashtra	400	GoMWRD	Under Survey & Investigation
10	Sholayar I	Kerala	810	KSEB	Yet to be taken up under S&I.
11	Sholayar II	Kerala	390	KSEB	Yet to be taken up under S&I.
12	Poringal Kuthu	Kerala	80	KSEB	Yet to be taken up under S&I.
13	Sharavathy	Karnataka	450	KPCL	Under Survey & Investigation
14	Varahi	Karnataka	700	KPCL	S&I likely to start soon
	Total		10510		

**Advantages
of
Pumped Storage Hydro
Projects**

Advantages to the Grid with Pumped Storage Hydro Projects

- **Provides Large Grid Storage and Long Discharge time**
- **High Ramp rate**
- **Balancing the Grid for Demand -Driven variations**
- **Balancing Generation -Driven Variations**
- **Voltage Support**
- **Grid Stability**
- **Black start facility**
- **Improves overall economy of power system operation and increases capacity utilization of thermal , solar and wind stations.**

**Issues and Way Forward
for
Pumped Storage Hydro
Projects**

Issues and Way Forward

- Since Pumped storage schemes use energy for pumping operation, commercial justification of peak energy produced from these plants pose problem.
- It is therefore desirable that separate regulation for peak energy may be envisaged.
- Regulatory treatment to Pump Storage schemes and market design is very critical for commercial viability of these plants as pricing rules should fully capture benefits of PSP and reward such assets for the full range of services provided by them to the Power system.
- The Pumped storage schemes should be considered as Grid Element instead of Energy Generation Source and may be funded from Power System Development fund(PSDF) or National Clean Energy Energy Fund(NCEF).

Issues and Way Forward

- **Water and water Power is state subject. State Govts. Should be encouraged to allocate the identified pumped storage schemes to prospective developers for implementation.**
- **Some of the identified schemes, particularly, in Western Region are located in areas which have been declared as Wild Life Sanctuaries.**
- **The State/Central Governments are required to take necessary action to de-notify the areas required for development of pumped storage schemes involving Wild Life Sanctuaries .**
- **In case, it is possible to locate a pumped storage scheme where upper / lower reservoir is already existing / under construction, it would be more cost effective and easily implementable.**

Thank you!



SCHEDULING OF HYDRO PLANT

PUMPED STORAGE SCHEME

INTEGRATING RE

SSP EXPERIENCE

M A K P SINGH

Member Secretary, NRPC

Sardar Sarovar Dam - a Satellite View



Narmada
Main Canal

Link Channels

Ponds

Dykes

IBPT

CHPH

RBPH

Reservoir

Dam

3153 m


Pointer 21°50'32.01" N 73°47'10.26" E

Image © 2008 TerraMetrics
Streaming ||||| 100%

© 2007 Google™

Eye alt 11.36 km

Overview of Dam & Hydropower Complex

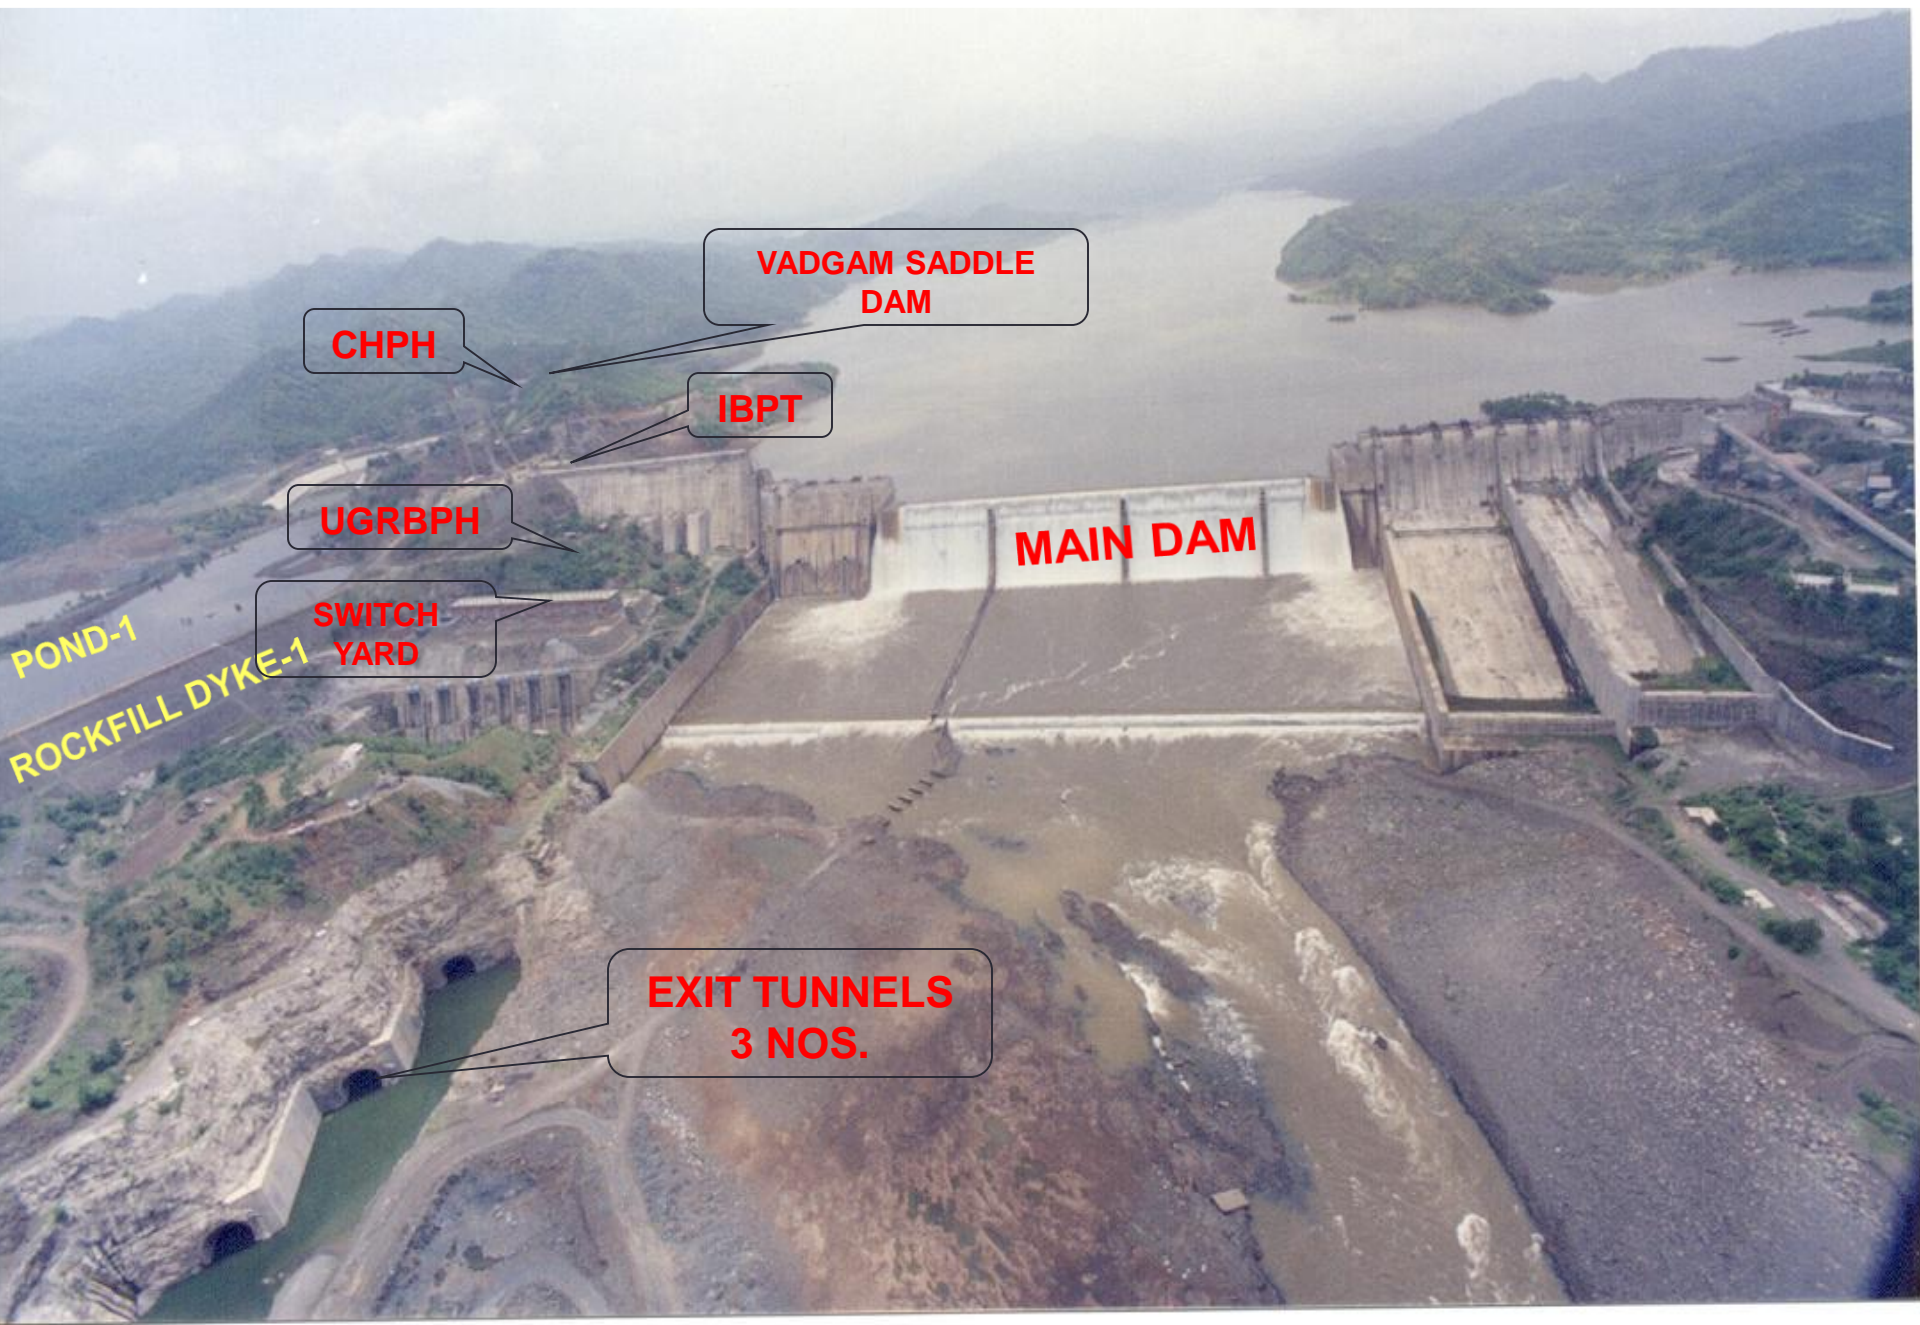

VADGAM SADDLE DAM

CHPH

IBPT

UGRBPH

MAIN DAM

SWITCH YARD

POND-1
ROCKFILL DYKE-1

EXIT TUNNELS
3 NOS.

PRINCIPLES OF SOUND RESERVOIRS OPERATION

- Maximization of Irrigation.
- Maximization of power generation.
- Avoidance of floods.
- To hedge against poor/delayed monsoons during the ensuing year.
- ~~Peak~~ Power Management

Government Guarantee

- Subsequent to the successful negotiations with M/s Sumitomo Corporation of Japan, the loan agreement was signed by SSNNL with Sumitomo Corporation.
- The Government of Gujarat has given guarantee
- The counter-guarantee was given by Ministry of Finance Government of India.

OPERATION OF RESERVOIRS

- The reservoir operation is classified into two distinct periods viz.

Filling Period and the **Depletion Period**.

The **‘Filling Period’** (Monsoon-months):

1st July to 30th November.

The **‘Depletion Period’** (Non-Monsoon Months)

1st Dec to 30th June

Rule Curve to be followed: Reservoir operation Table (ROT) is finalized well in advance

SSP RESERVOIR

Length	214 Km
FRL	138.68 m (455 ft)
MDDL	110.63 m (363 ft)
Crest level	121.92 m (400 ft)
Gross storage	9500 Mcum (7.70 Maf)
Live storage	5800 Mcum (4.43 Maf)
Evaporation Loss	616 Mcum (0.5 Maf) Annual

Gates

Type	...	Radial
No. & size	...	30
7 Nos. auxiliary spillway		18.3 m x 18.3 m (60'x60')
23 Nos service spillway		18.3 m x 16.76 m (60'x55')
Discharge Capacity	...	84949 cumec (30 lakh cusec)

USE OF WATER

IRRIGATION

CCA	21.29 lakh ha.
Annual Irrigation	17.92 lakh ha. (Gujarat- 12 districts) 73000 ha (Rajasthan) Jalore & Barmer Districts.

DRINKING WATER

Allocation	...	1307 Mcum (1.06 Maf) in Gujarat
•		8 Mcum in Rajasthan.
• Industrial use in Gujarat		275 Mcum (0.21 Maf)
• Drinking water use in Gujarat		1032 Mcum (0.85 Maf)
Urban Centres benefitted		135
Villages benefitted	...	8215

POWER

- Power benefits:

RBPH (River Bed Power House 6x200 MW Underground)

Firm 3635 Gwh reducing to Zero after 45 years.

Secondary 1431 Gwh reducing to 520 Gwh after 45 years.

CHPH (Canal Head Power House 5x50 MW)

Firm 213 Gwh increasing to 440 Gwh After 45 Yrs.

Secondary 190 Gwh increasing to 345 Gwh after 45 years.

POWER HOUSE OPERATION Constraints

Ten daily limit set by Reservoir Regulation Committee
(Water Allocated in Ten daily)

Environmental Release

Demand of beneficiary State

Downstream water requirement- Festivals.

No sudden surge of water

Irrigation demand

Breach in canal

Maintenance in Canal

Afflux Bund

- The Afflux Bund is for protection of backwater affected villages.
- Construction of earthen embankments varying from 2m to 10m to be constructed on river side of affected villages with full pitching on river side slope and green turving on village side slope.
- Proper arrangement for natural drainage through Sluices and Pumps
- Earthen embankment of masonry section is to be constructed in reaches with the objective of protecting households rather than agricultural land.
- The topographical monitoring to be done on regular basis.

Real Time Data Acquisition System

- Each Hydro Project should establish, maintain and operate an effective system of flood forecasting and flood control, including reporting of heavy precipitation, and telecommunication systems.

CANAL

Main Canal structures		590
Canal syphon	...	14
Drainage syphone	...	148
Canal crossing		25
Syphon aquaduct	...	5
Main Canal Level		
Regulator	...	42
Cross Regulator	...	39
Escapes	...	13
Super passage	...	6
Road bridge	...	280
Railway crossing	...	17
Lining	...	M-15 cement concrete
•		10 cm thick on bed and 12.5 cm on sides.

NANGAL HYDEL CHANNEL


- Permissible Rate of Raising the water

• Depth of Water	Rate per Hour
0 to 5.5 ft	5.5 ft/hr
5 to 16 ft	0.5 ft/hr
Above 16ft	0.25 ft/hr

- Permissible Rate of Lowering the water

• Depth of Water	Rate per Hour
Above 16 ft	0.25 ft/hr
16 to 12 ft	0.20 ft/hr
12 to 5.5 ft	0.10 ft/hr

PEAK AND OFF PEAK GENERATION IN JAN 2005

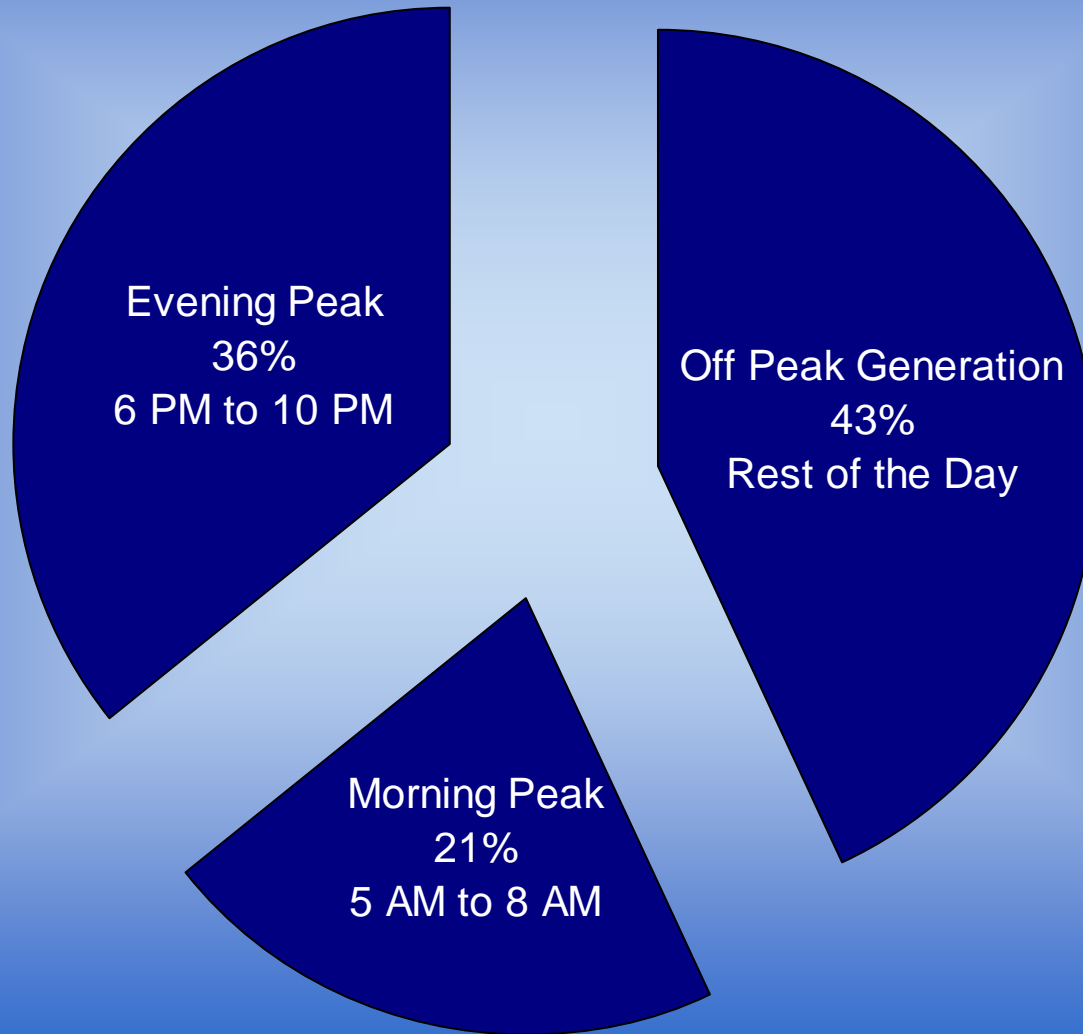


The Tribunal orders:

The power generated in the River Bed and Canal Power House at Navagam will be integrated in a common switchyard.

- Madhya Pradesh and Maharashtra will be entitled to get 57 percent and 27 percent respectively of the power available at bus bar in the switchyard after allowing for station auxiliaries.
- The above entitlement applies both to availability of machine capacity for peak loads and to the total energy produced in any day.
- The entitlement of power and energy for any day can be utilised fully or partly by the concerned States or sold to another participating State under mutual agreement. It cannot, however, be carried forward except under a separate agreement or working arrangement entered into among the affected parties.

7/18/2017

SSP (RBPH+CHPH) GENERATION RATE MU'S/100 MCM

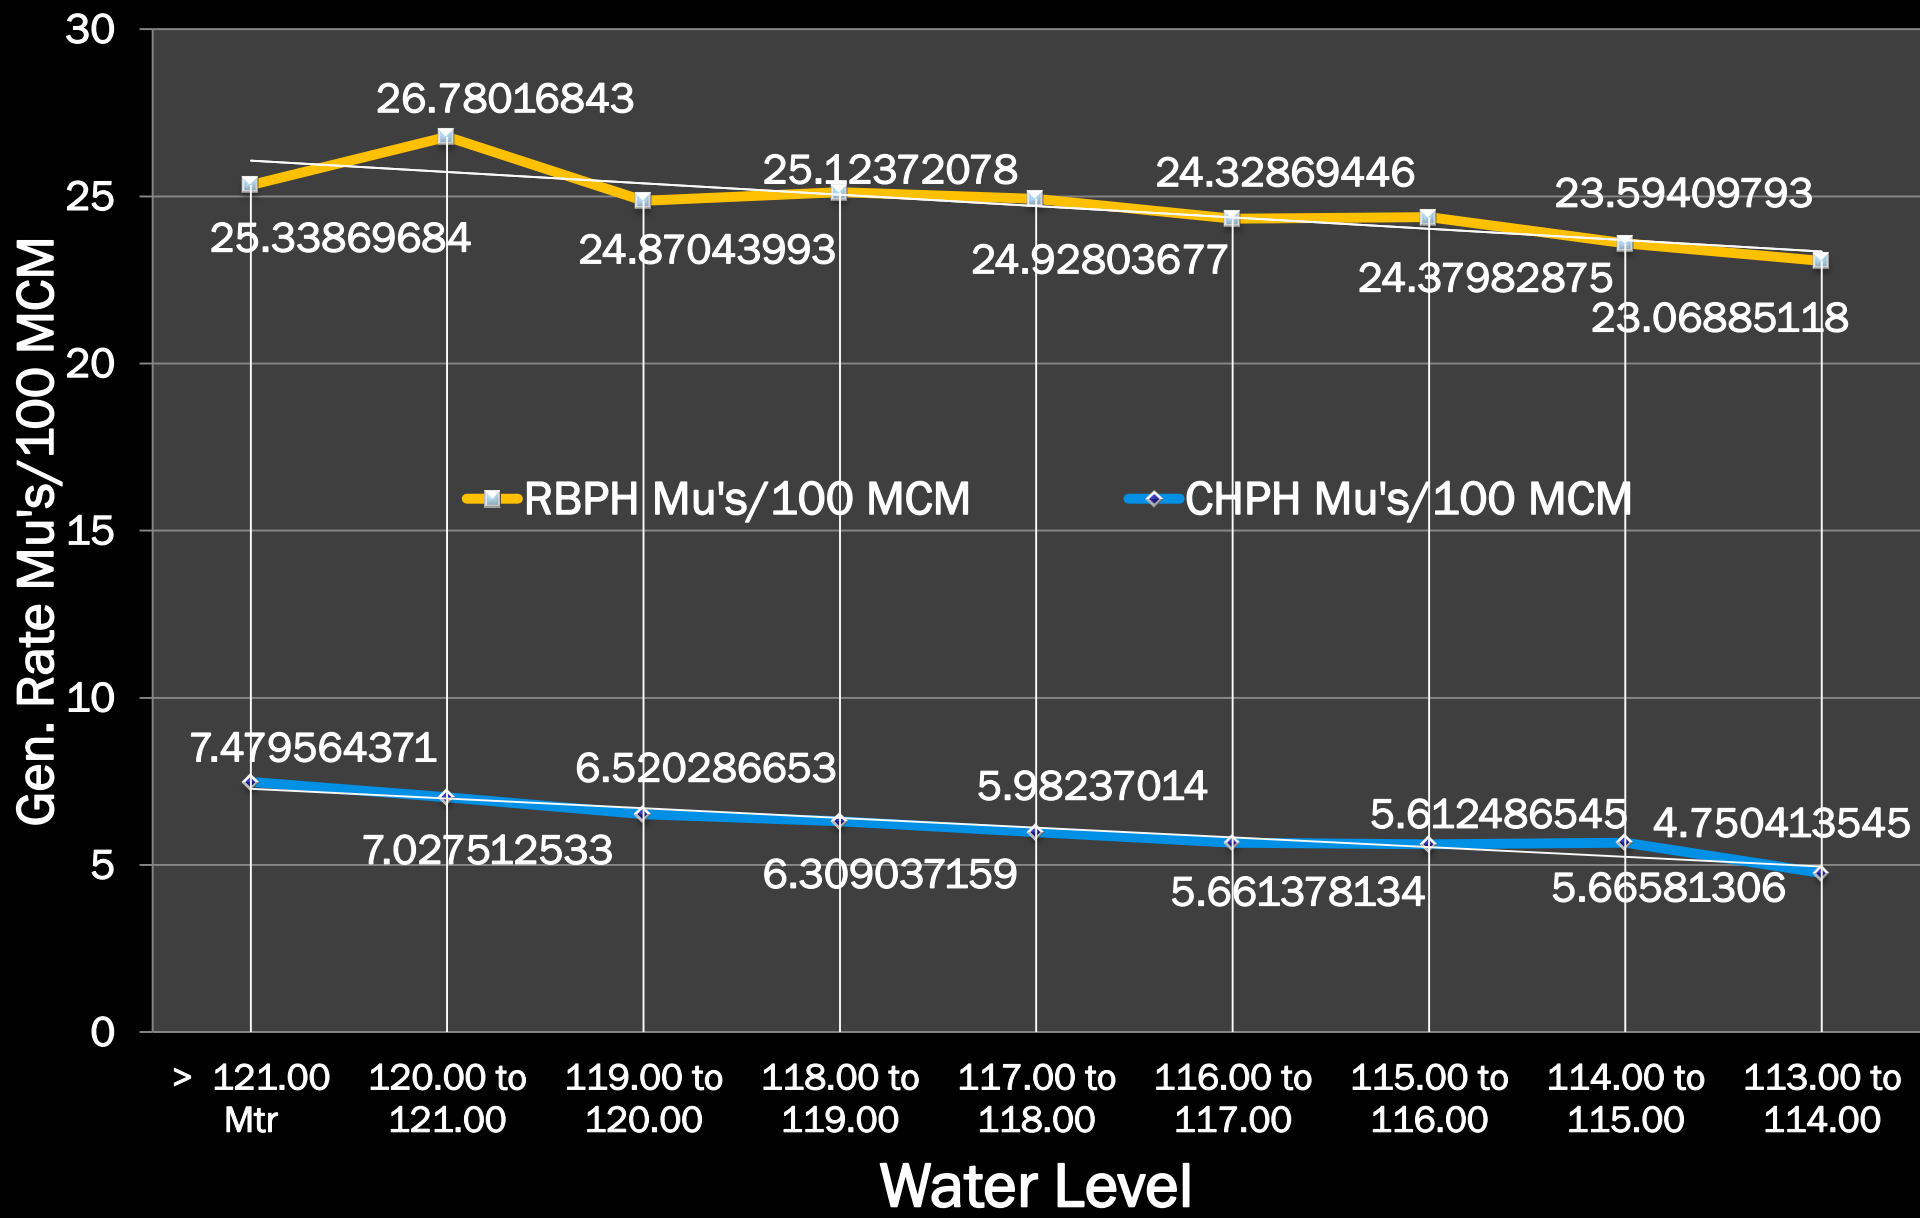

METHODOLOGY OF BEST FIT SCHEDULE OF SSP

Best Fit Schedule(BFS) Philosophy

The scheduling of the generation at SSP from its two Power Houses Viz: RBPH and CHPH (for irrigation) is being done BFS with following objectives:

- Demand of all beneficiary States in all time blocks is met to the maximum possible extent.
- Ten Daily target given by SSRRC is achieved.
- Prevent/minimize overflow at SSP Dam.
- Optimum utilization of water.
- Maximization of generation at SSP.
- Helps RLDC in Reliable and Stable Grid Operation.

Best fit schedule

- ❖ In consultation with WRLDC.
- ❖ As per the requirements of beneficiary States during different parts of the day
- ❖ As per the entitlement under NWDT Award.
- ❖ Schedule worked out will not be altered.
- ❖ Adjustment of shortfall/excess of power drawn to be settled at the earliest instance.

PROCEDURES

- ❖ Based on quantum of water allocated for RBPH in Ten Daily issued by SSRRC, NCA will inform total MW generation possible in each time block and m/c_hrs (Mus) for a given day in advance to each beneficiary states.
- ❖ During any time block the Max. sum of demand that can be met is equal to $DC * \text{Number of available RBPH M/Cs}$.
- ❖ Each beneficiary State to submit their demand set P1 time block-wise .

PROCEDURES Contd

- ❖ Additional set of demand(P2) if any to be indicated separately.

Where:

- ❖ T_d = Sum of demand given by all the three States in a 15 min time-block,
- ❖ T_{av} = Total no. of m/c available * DC in MW of each m/c as per DC

Situation I :

In a particular 15 mints time block if $T_d \leq T_{av}$, where T_d = Total demand of all the three States, T_{av} = MW then scheduled power in that time block will be as per the demand of each State.

	BLOCK	GUJ	MP	MAH	Td	Tav
Entitlement Demand	37	168	598.5	283.5		1050
		175	350	175	700	
internal calculation		175	350	175	700	
		0	0	0	0	
		175	350	175	700	
		0	0	0	0	
	Allocated share		175	350	175	700

Situation II:

In case , 1 or 2 states having demand less than their entitlement, then their non-requisitioned share will be given to other party state having demand more than its share.

		BLOCK	GUJ	MP	MAH	Td	Tav
Entitlement	Demand	41	168	598.5	283.5		1050
			175	350	875	1400	
internal calculation			260.47	350	439.53	1050	
			85.465	0	-435.5	85.465	
			175	350	525	1050	
			0	0	0	0	
	Allocated Share		175	350	525	1050	

Situation III:

If $T_d > T_{av}$ & All the three states having demand more than their entitlement then Total MW will be distributed in 57: 27:16 as per their power share mentioned in NWDT award.

	BLOCK	GUJ	MP	MAH	Td	Tav
Entitlement	61	168	598.5	283.5		1050
		175	700	875	1750	
Demand		168	598.5	283.5	1050	
		-7	-101.5	-591.5	0	
		168	598.5	283.5	1050	
		0	0	0	0	
internal calculation		168	598.5	283.5	1050	
Allocated Share		168	598.5	283.5	1050	

continued

Once a unit starts to generate it will not be withdrawn before minimum 3 hrs.

Except otherwise, for the reason of safety and security of WR grid, Best Fit Schedule will not be revised on Real Time Basis.

Unrequested Share (URS) MUs on any day by any state will be given to other states only on condition of Mutual Agreement between them and the copy of such agreement shall be made available to NCA as well as WRLDC.

State should consume SSP power on First Charge Basis.

After finalizing the Best Fit Schedule, it will be revised under emergency situation (e.g. withdrawal / stoppage of Generation, line/corridor congestion) on Real Time Basis in consultation with WRLDC.

Pattern of Power generation from the power complex SSP (RBPH & CHPH) in the initial and intermediate stages


All figures in MUs

Stage	Year	Firm Energy		Average Energy		Seasonal Energy	
		RBPH	CHPH**	RBPH	CHPH	RBPH	CHPH
I*	10	3635	213	5066	403	1431	190
II A	20	1477	676	2438	787	961	111
II	30	517	676	1851	787	1334	111
III	45	-	440	520	785	520	345

*Year of full commissioning of the power component.

** Corresponding to design irrigation release/requirements.

FLOW CHART SHOWING TIME LAG AND DISTANCES

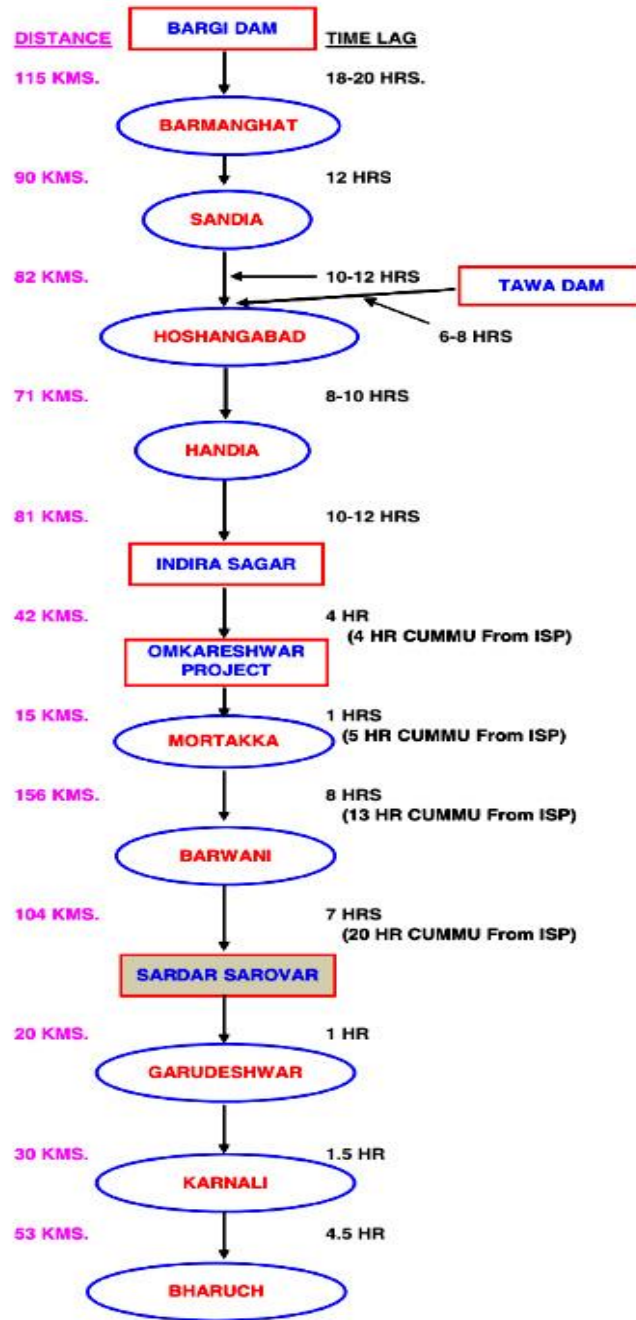

FLOW CHART
WITH LAG AND
DISTANCE
BETWEEN
NARMADA
PROJECTS

TARIFF OF THE PUMPED STORAGE SCHEME/PROJECTS

(Modified Amendments As Regulation 22a)

1. NET CAPACITY CHARGE

- A. If actual Generation (monthly) $\geq 75\%$ of the Pumping Energy consumed for the month:
Monthly Payable Net Capacity Charge (inclusive of incentive) = $((AFC \times NDM / NDY) - 0.75 \times ECCm)$
- B. If actual Generation (monthly) $< 75\%$ of the Pumping Energy consumed :
Monthly Payable Net Capacity Charge (inclusive of incentive) = $((AFC \times NDM / NDY) \times (\text{Actual Generation during peak hours in a month} / 75\% \text{ of the Pumping Energy consumed by the station during the month}))$

Where,

AFC = Annual fixed cost specified for the year (Rupees) ,

NDM = Number of days in the month

NDY = Number of days in the year

ECCm = Energy charge Credits for the sale of power in excess of the Design energy + 75% of the energy utilized in pumping the water in that month(Rupees).

2. Energy Charge

Energy Charge payable by beneficiary is at a flat rate equal to the avg. energy charge @ 20 paise / kWh, excluding free energy.

Energy charge payable = $0.20 \times \{\text{Scheduled energy (ex-bus) for the month(kWh)} - (\text{DEm} + 75\% \text{ of the energy utilized in pumping for the month})\} \times (100 - \text{FEHS}) / 100.$

Where,

DEm = Design energy for the month specified for the hydro station (MWh),

FEHS = Free energy for home State, in %, if any.

Provided further that

If Scheduled energy in a month $< (\text{DEm} + 75\% \text{ of the energy utilized in pumping})$, the energy charges payable by the beneficiaries need to be zero.

3. If without any valid reason, generator is not pumping water or not generating power to its potential or wasting natural flow of water, the capacity charges of the day is non-payable by the beneficiary on order of the Commission if any application made by any of the beneficiary.

For this purpose, outages of the unit(s)/station (planned and forced) up to the 15% in a year to be construed as the valid reason for not pumping water or not generating power.

In the event of total machine outages in a year >15%:

Total capacity charges (recovered during the year adjusted on prorata basis):

$$(ACC)_{adj} = (ACC) R \times (100 - ATO) / 85$$

Where,

(ACC)_{adj} – Adjusted Annual capacity Charges

(ACC) R – Annual capacity Charges recovered

ATO - Total Outages in % for the year (forced and Planned)

Provided that the generating stations declare its machine availability daily on day ahead basis for 96 time blocks.

In view of Commission:


1. The power for pumping water to be arranged by the beneficiaries.
2. Commission also of view that O&M @ 2% of the capital cost is reasonable as increased cost of pumped storage scheme would take care of any additional O&M requirement.

Tariff

- Tariff Committee have decided most of the issues on the Tariff and Energy Accounting, except the cost of Pumping Power and its distribution among the Party States. However, 7th meeting of the Tariff Committee recommended that
- "Energy consumed by SSP during Pumping mode should be distributed among beneficiary States in the ratio of their shares in SSP and added to their drawal from Central Sector generation while preparing the Regional Energy Accounting. Tariff for energy consumed for Pumping shall be the pooled Central Sector Tariff."

L-SECTION GARUDESHWAR WEIR


BED LEVEL PROFILE AND FRL FOR GARUDESHWAR WEIR AND SSP

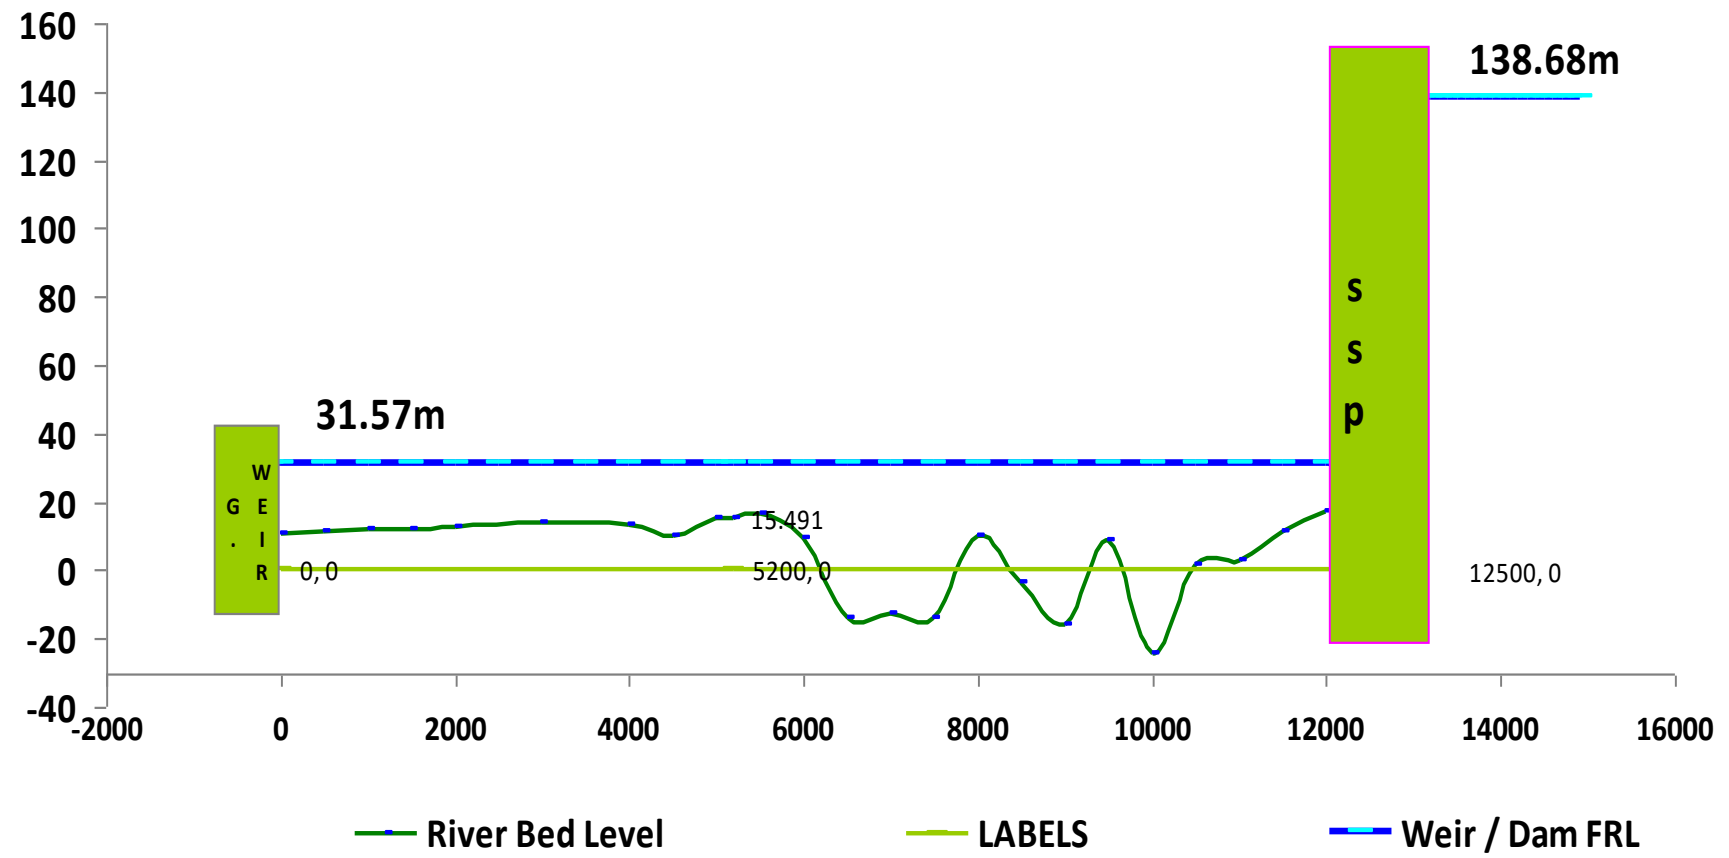


SALIENT FEATURES GARUDESHWAR WEIR

- **LOCATION** : 12.10 km D/s of Sardar Sarovar dam
- **Design discharge** : 69385 Cumecs
- **Full Reservoir Level** : 31.57m
- **Crest Level** : 31.75m
- **Normal Tail Water Level** : 37.30m
- **Gross Storage Capacity** : 8720 HAM (70708 Aft)
- **Dead Storage Capacity** : 5422 HAM (43974 Aft)
- **Live Storage Capacity** : 3298 HAM (26734 Aft)
- **Total length of Weir** : 1137m
- **The poundage** : 34.36 MCM (27850 acre ft.).
- **Operating levels** : +27.33 m to 33.15 m.
- **Storage** : pumping mode operation of RBPH.
- **Pumping for 8 hours**
- **RBPH** : peaking station for 6 hours.


Ghatghar Generation and Pumping mode operation on (31.10.2016)

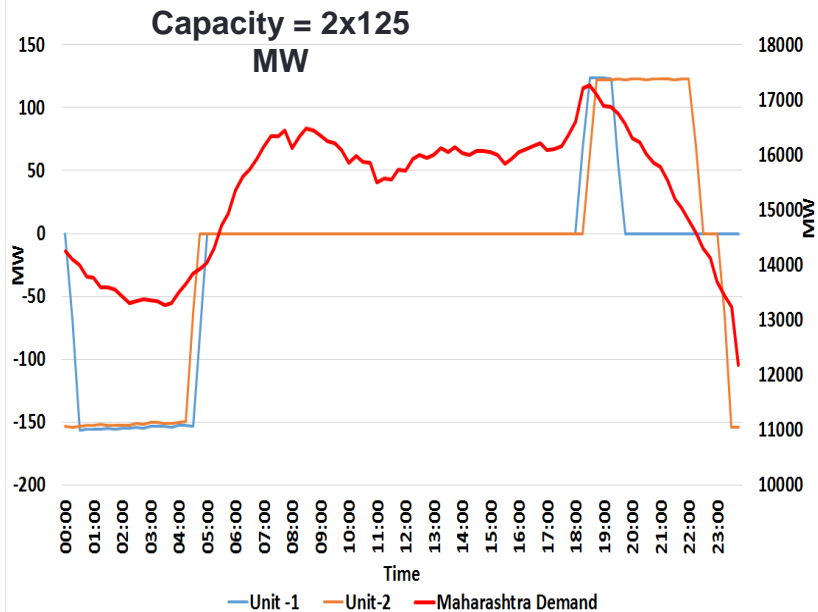


WR Grid Demand Vs Freq. on 31.10.2016

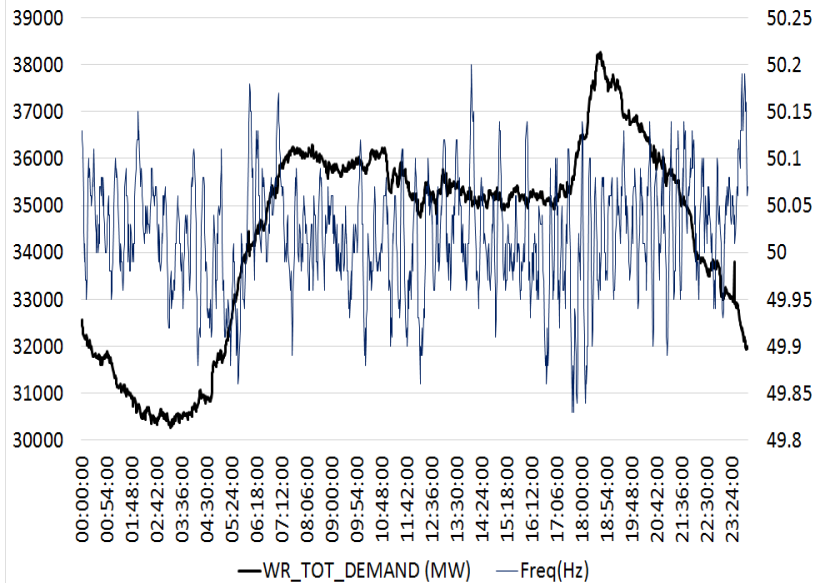


WR Grid Demand Vs Freq. on 31.10.2016

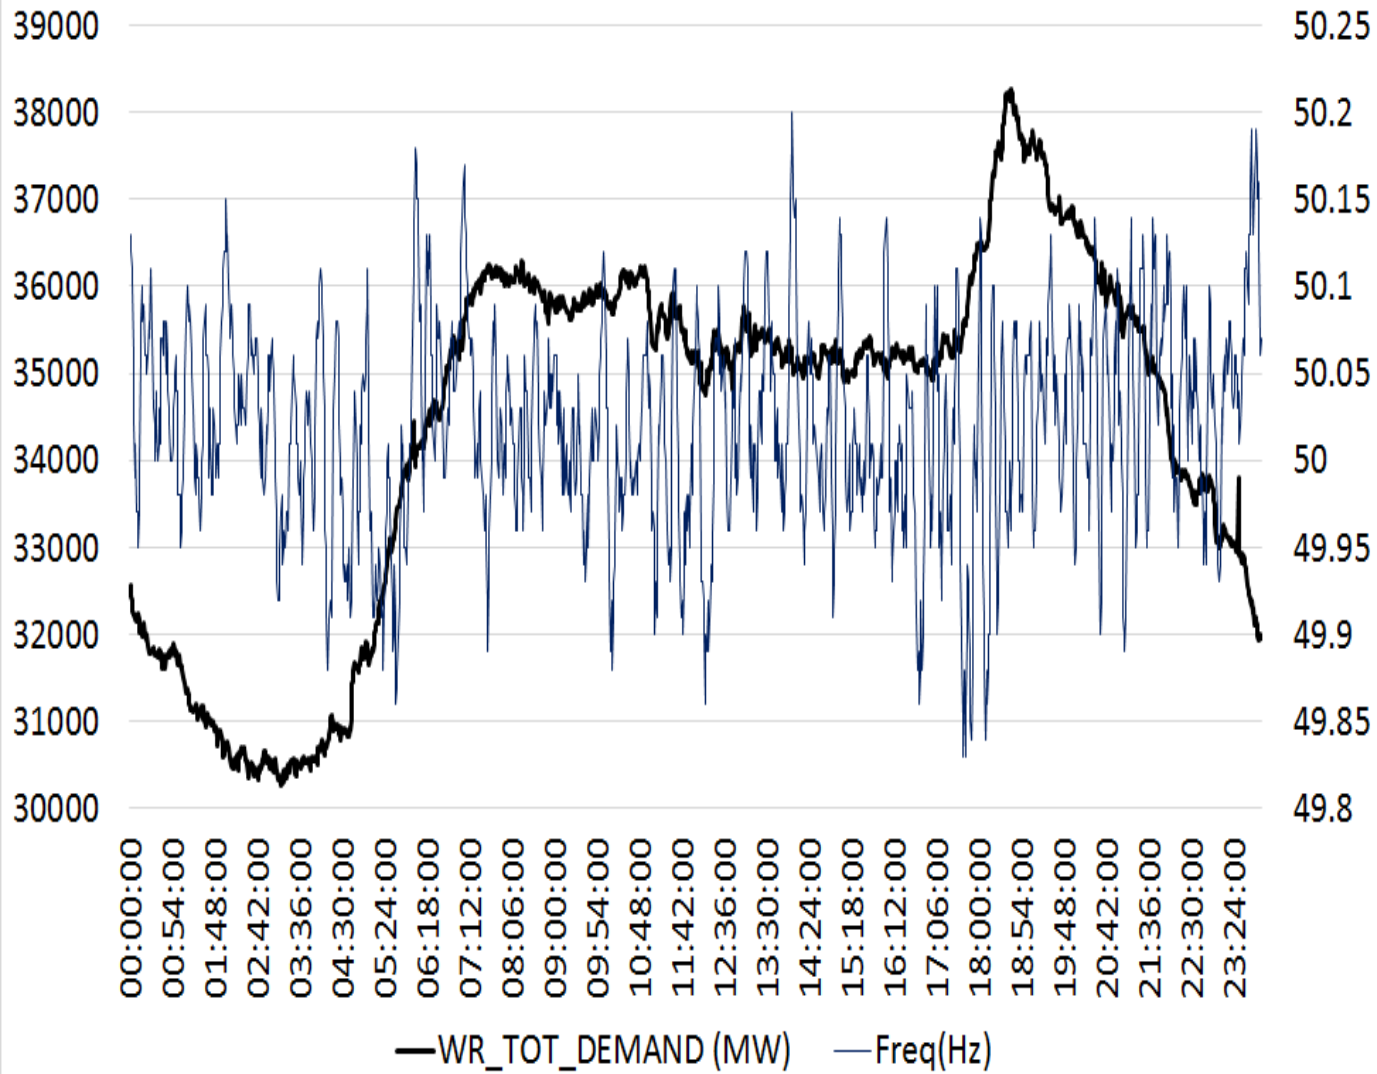

WR (Wind + Solar Generation) (in MW) on 31.10.2016

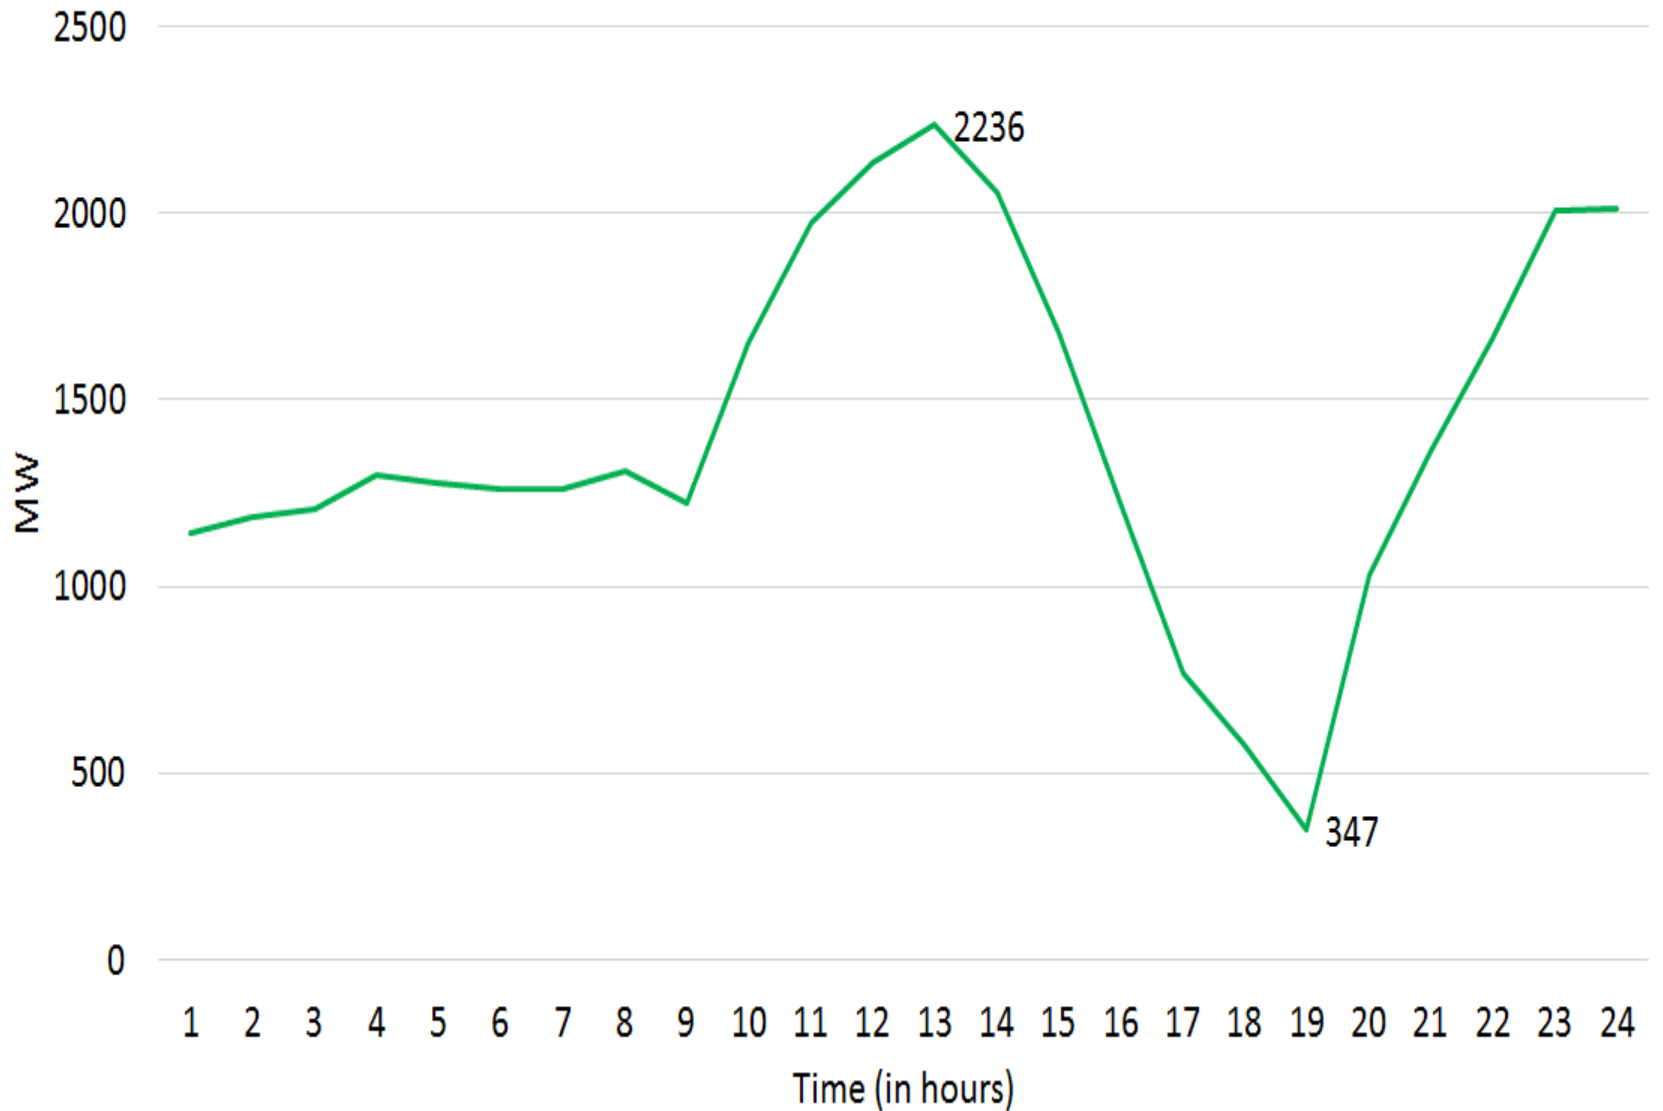

WB DEMAND VS PPSP GEN

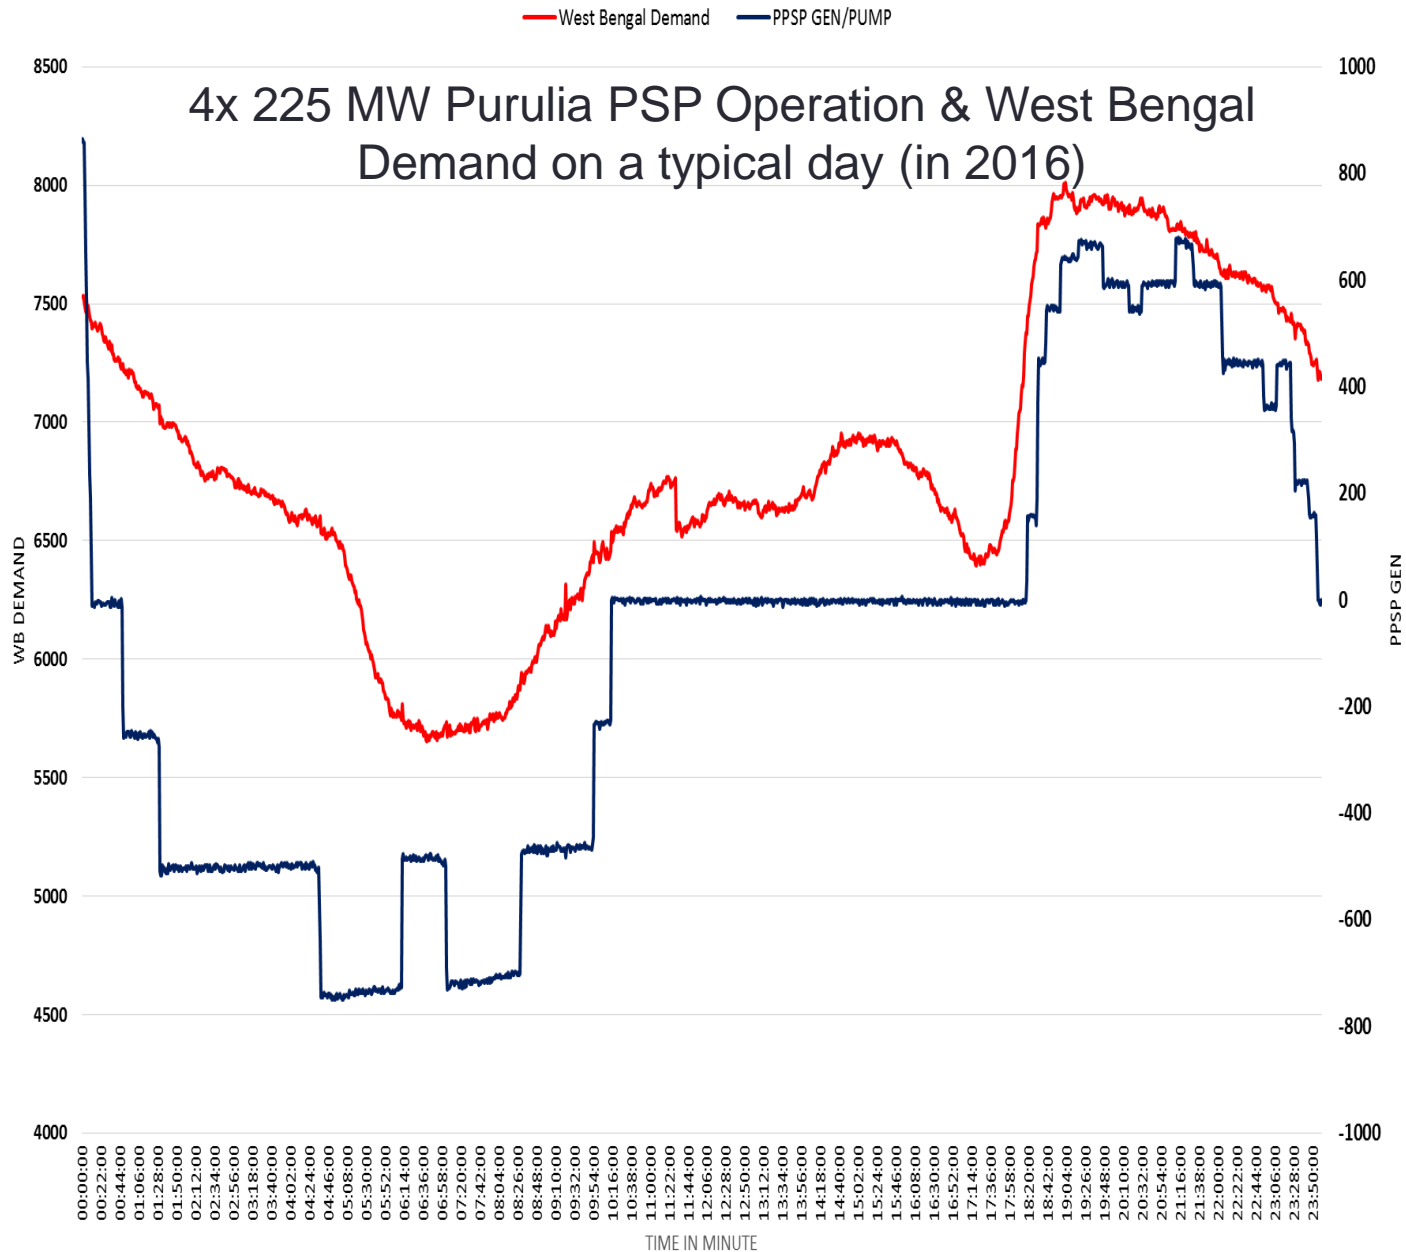

RTO will depend on:

Pumping power made available by the beneficiary States.

Margin for RTO available during off peak hours.

Preference sequence:

i) PTGT

Pump today- generate today during peak hours.

ii) PTGL

Pump today-generate later at the earliest instance

iii) PTWS

Pumped today-water spill to be avoided

Time (hrs)	Pumping Power			
	Available		Not Available	
	RTO	Generation	RTO	Generation
09:00-15:00	No	Yes $W_{RTO} + W_{SSRRC} > 0$	No	Yes $W_{RTO} + W_{SSRC} > 0$
15:00-18:00	Yes $W_{SSRRC} = 0$	Yes $W_{SSRRC} > 0$		Yes $W_{SSRRC} > 0$
18:00-23:00	No	Yes $W_{RTO} + W_{SSRRC} > 0$		Yes $W_{RTO} + W_{SSRC} > 0$
23:00-09:00	Yes $W_{SSRRC} = 0$	Yes $W_{SSRRC} > 0$		Yes $W_{SSRRC} > 0$

Spill of W_{RTO} to be avoided
Here W_{RTO} and W_{SSRRC} means demand from W_{RTO} and W_{SSRRC} respectively.

Recommended:

Simultaneous Pumping and Straight generation not to be permitted.

Sharing of O&M expanses.(to be agreed apriori)

Separate energy account for Straight generation, Pumping Energy & generation from pumped water.

Separate water account to be maintained for pumped water and inflow water

Peak hours may be different for beneficiary States.

Generation from pumped water to be scheduled during low grid frequency in the grid only.

On similar line of RRAS Pumped Storage Scheme to be operated by NLDC

UP- Generation from Pumped water

Down –Reversible turbine operation

A photograph of a sunset over a body of water. The sun is low on the horizon, casting a bright orange and yellow glow across the sky and reflecting on the water's surface. The water is dark with small ripples. In the background, there is a dark silhouette of a forested shoreline. The text "THANK YOU" is overlaid in the center in a bold, white, sans-serif font.

THANK YOU



Integrated Operation Philosophy of Tehri Hydro Power Complex



By

THDC INDIA LTD.



An Overview

General

Tehri Hydro Power Complex (2400MW) is a multipurpose project conceived & designed to store surplus water of the river Bhagirathi during monsoon and releasing stored water after monsoon according to irrigation requirement of UP State and drinking water requirement of UP & Delhi States in addition to provide peaking support to Northern grid. Tehri Hydro Power Complex (HPC) comprises of :

- Tehri HPP (4x250 MW) - Under Operation.
- Koteshwar HEP (4x100 MW) - Under Operation.
- Tehri PSP (4x250 MW) - Under Construction




An Overview

- Tehri Dam is an Earth and Rock fill type storage dam with live storage capacity of 2615MCM.
- Koteshwar Dam, located at about 22km downstream of Tehri Dam, is a Concrete dam with live storage capacity of 35MCM.
- Tehri reservoir stores excess water of River Bhagirathi during monsoon period whereas Koteshwar reservoir serves the purpose of daily regulation of water released from Tehri reservoir.
- After commissioning of Tehri PSP, Koteshwar reservoir will also function as lower reservoir for the Pump Storage Plant.




TEHRI HYDRO POWER COMPLEX

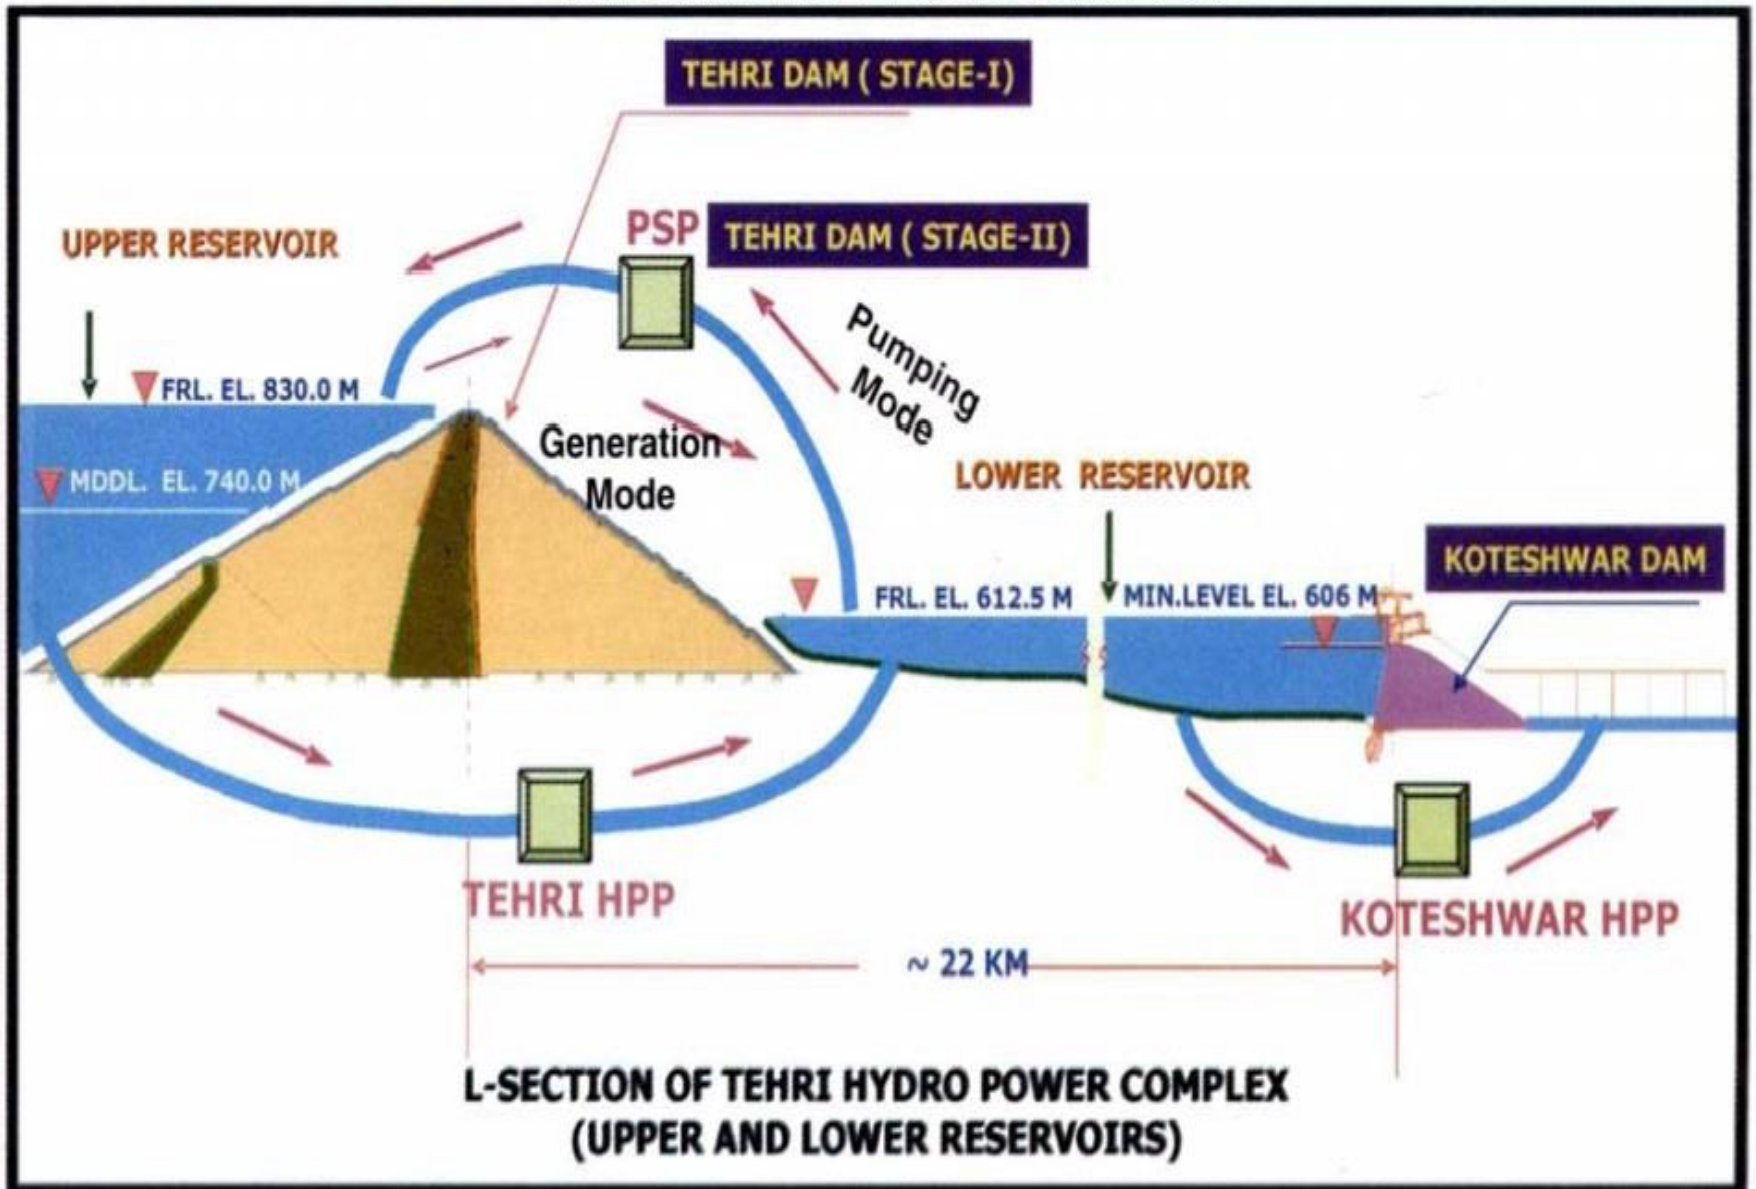



Tehri Reservoir Cycle 10-Daily Basis During Year and Discharge Available for Machines (Based of 90% Dependable year data)

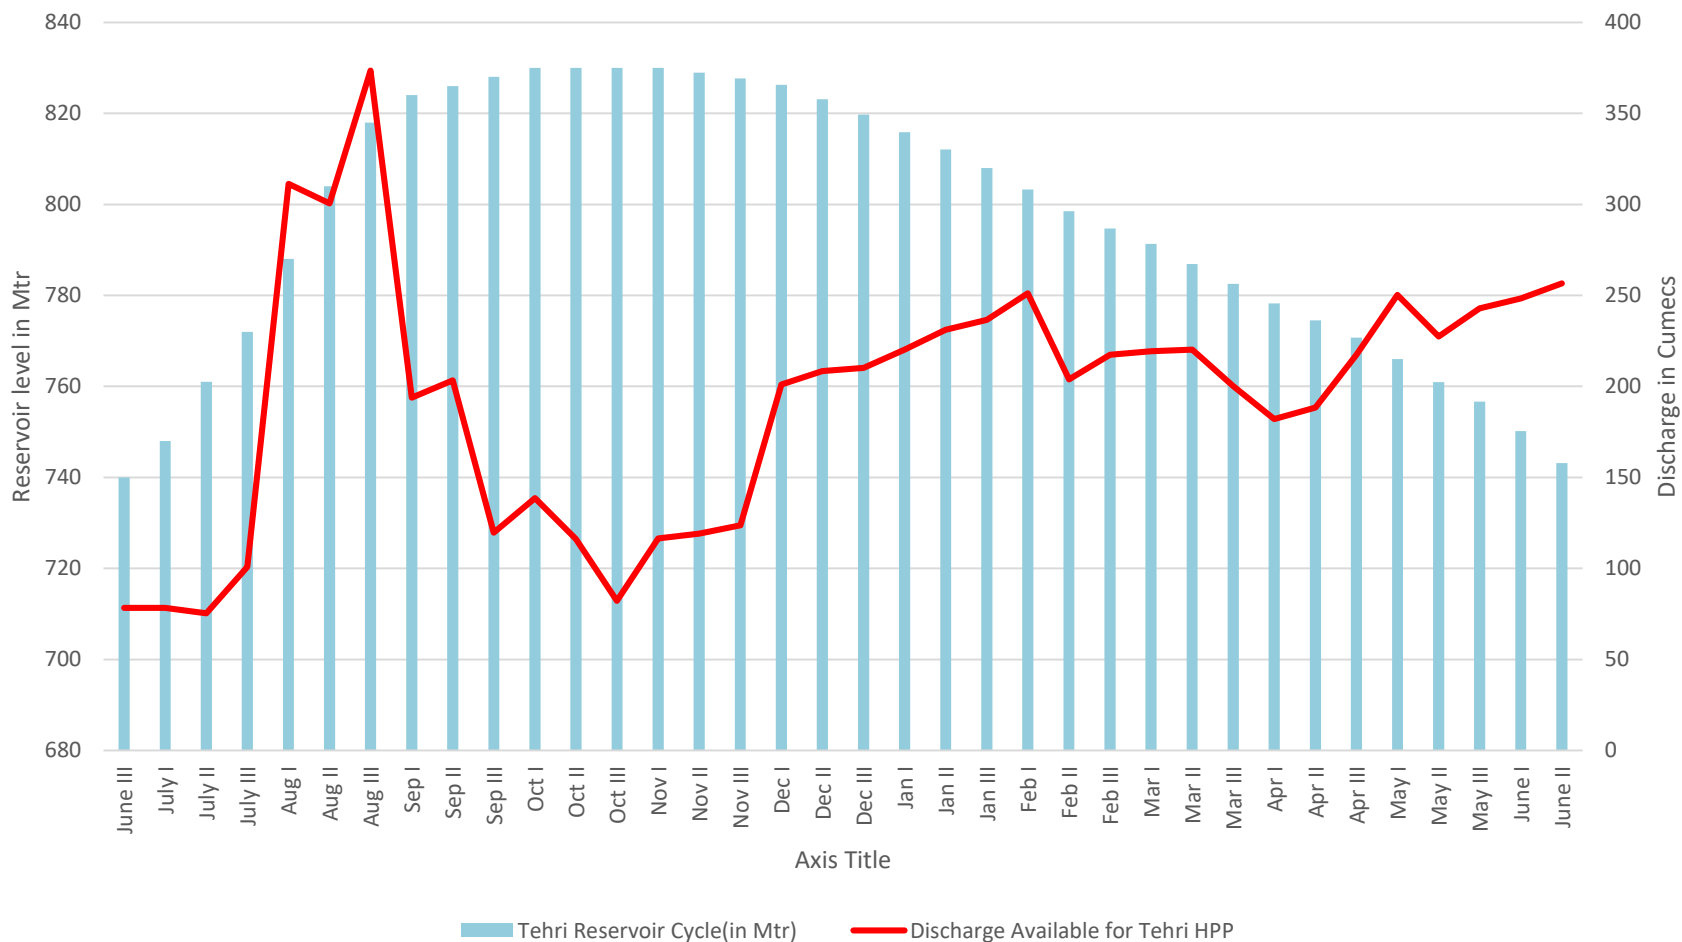

NOTE: Presently, maximum allowable filling of reservoir is EL 825.00Mtr



Hypothesis for Tehri PSP Operation

Non
Monsoon
Period
(270
Days)

7 hours of pumping has been estimated during off peak hours while the volume of pumped water could be "turbined" during the peak hours of the day, with nominal power foreseen in turbine mode.

Monsoon
Period
(100
days)

Extra discharge due to rain falls, no pumping is needed.



Integrated Operation Calculation

A. Capacity of balancing Reservoir for Tehri PSP (Operating range EL 606m to 612m)

- i) Reservoir Capacity = $612 - 606 \text{ m} = 6 \text{ mtr}$
- ii) Capacity of reservoir / mtr = 2.6 MCM
- iii) Gross Capacity Available = 15.6 MCM



Integrated Operation Calculation

B. Pumping Mode

Pumping Discharge Data of Tehri PSP/Machine = 110 Cumecs (109.5 at nominal net Head)

Discharge Data of Koteshwar HEP/Machine = 155 Cumecs (157.93 As per Design)

Time Required for emptying balancing reservoir while 04 Machines of PSP in Pumping mode and 01 unit of KHEP in Generating mode :

Let the time required is 'T'

Volume of water pumped back by Tehri PSP = $T \times (4 \times 110 \times 3600) / 10^6 = T \times 1.584$ MCM

Volume of water release by KHEP = $T \times (1 \times 155 \times 3600) / 10^6 = T \times 0.558$ MCM

Net volume of Water evacuated from balancing reservoir = $T \times (1.584 + 0.558)$ MCM
= $T \times 2.142$

Time Required to evacuate = $T \times 2.142 = 15.6$ MCM

T = 7:16:58 hrs



Integrated Operation Calculation

C. Generating Mode

Discharge Data of Tehri HPP/Machine	=150 Cumecs (146 As per Design)
Discharge Data of Tehri PSP/Machine	=150 Cumecs(146.9 As per Design)
Discharge Data of Koteshwar HEP/machine	= 155 Cumecs (157.93 As per Design)

Time Required to refill balancing reservoir while all 08 Machines of Tehri HPP & PSP and 01 unit of KHEP in Generating Mode :

Let the time required is 't',

$$\text{Volume of Water Release in t hrs from Tehri HPP and PSP} = t \times (8 \times 150 \times 3600) / 10^6 = t \times 4.32 \text{ MCM}$$

$$\text{Volume of Water Release in t hrs from Koteshwar HEP} = t \times (1 \times 155 \times 3600) / 10^6 = t \times 0.558 \text{ MCM}$$

$$\text{Net Volume} = t \times (4.32 - 0.558) = t \times 3.762 \text{ MCM}$$

$$\text{Time Required} = t \times 3.762 = 15.6$$

$$t = 4:08:48 \text{ hrs}$$



Integrated Operation Calculation

C(i). Generating Mode to increase Peaking Time:

Time Required to refill balancing reservoir while all 08 Machines of Tehri HPP & PSP and 04 unit of KHEP in Generating Mode :

Let the time required is t' ,

Volume of Water Release in t' hrs from Tehri HPP and PSP = $t' \times (8 \times 150 \times 3600) / 10^6 = t' \times 4.32 \text{ MCM}$

Volume of Water Release in t' hrs from Koteshwar HEP = $t' \times (4 \times 155 \times 3600) / 10^6 = t' \times 2.232 \text{ MCM}$

Net Volume = $t' \times (4.32 - 2.232) = t' \times 2.088 \text{ MCM}$

Time Required = $t' \times 2.088 = 15.6$

$t' = 7:28:17 \text{ hrs}$



Outcome

For Integrated operation of Tehri PSP,HPP and Koteshwar HEP:

**Total time required in one cycle = T+t = 7:16:58 + 4:08:48 hrs
=11:25:47 hrs**

(i.e 1.75 hrs. Pumping \approx 1 hr. Generation)

- Note:**
- i) Pumping mode considered for Nominal Net Head of 188 Mtr consuming 205 MW in above calculations.**
 - ii) For the purpose of Energy calculation for RE integration, an average of two cycles of Pumping per Day for approx. 300 Days (off monsoon) in a Year might be supported by Tehri PSP. However, planned outages for maintenance are not taken into consideration.**
 - iii) Micro level planning for Koteshwar scheduling will be required to achieve desired Plant Utilisation Factor.**



Issues & Challenges in O&M of Tehri PSP

Sr.No	Issues/Challenges	Proposed Suggestions
01	Tariff calculation & COD was first time introduced in Tariff regulation 2009-14 in detail with generalized approach	IEGC should also be revised considering present scenario of power system and projects constraints.
02	Generating station shall be required to declare its machine availability daily on day ahead basis for all the time blocks of the day in line with the scheduling procedure of Grid Code	However, scheduling shall be entirely depend on margin available in balancing reservoir, hence, provision for flexible scheduling shall be devise in IEGC for PSP
03	Tariff regulation 2014-19 Chapter – 7 Computation of Capacity Charges and Energy Charges Clause 32(5) detailed regarding inflow and its utilization.	case of Common reservoir, accounting of inflow and operation of PSP is entirely different, such scenario shall also be included. Accordingly NRLDC should incorporate necessary provision exclusively for multipurpose hydro projects . Also flexible scheduling shall be devised for such Power Complex .



Issues & Challenges in O&M of Tehri PSP

Sr.No	Issues/Challenges	Proposed Suggestions
04	Central Electricity Regulatory Commission (Indian Electricity Grid Code) (Fifth Amendment) Regulations, 2017. Regulation 5.2 (h) of Part 5 of the Principal Regulations	This amendment restricts the maximum capacity utilization of Generating stations and same will also increase the generating mode operation of Tehri PSP for generating the same MU, hence cycle time for the PSP operation may get affected.



Thank You

Meeting on operationalization of existing pump storage plants (PSPs)

NRPC, New Delhi – 28th June 2017

ECONOMIC VALUE OF PUMPED STORAGE IN A POWER SYSTEM WITH SOLAR PV

Anoop Singh, Kalpana Singh & Parul Mathuria
Dept. of Industrial and Management Engineering
Indian Institute of Technology Kanpur

ISSUES WITH GROWTH OF RENEWABLE ENERGY SOURCES

- Variable renewable energy (VRE) sources like wind and solar are variable and intermittent
- Lack of coincidence with the demand pattern
- Location specific


HOW TO ADDRESS THIS

- i. Better RE forecasting
- ii. Better load forecasting
- iii. Load shifting
- iv. Energy Storage
 - Energy storage systems (ESS) store the surplus generation, utilize it during times of low or no generation

LITERATURE SURVEY

- i. **Black and Strbac (2007)** – quantified storage value, determined fuel costs for conventional and wind generation systems
- ii. **Brown and Lopes et al (2008)** – value of pump quantified as the reduction it causes in fuel costs and dynamic reserves it provides
- iii. **Schill and Kemfert et al (2011)** – game theoretical model in an imperfect market setting
- iv. **Takaagi Masaaki et al (2013)** – marginal value of storage system in an optimal generation mix model
- v. **Denholm Paul et al (2013)** – overall system operations cost with and without storage
- vi. **De Siaternes et al (2016)** – storage value quantified in terms of reduction in CO₂ emissions

PUMPED HYDRO ENERGY STORAGE

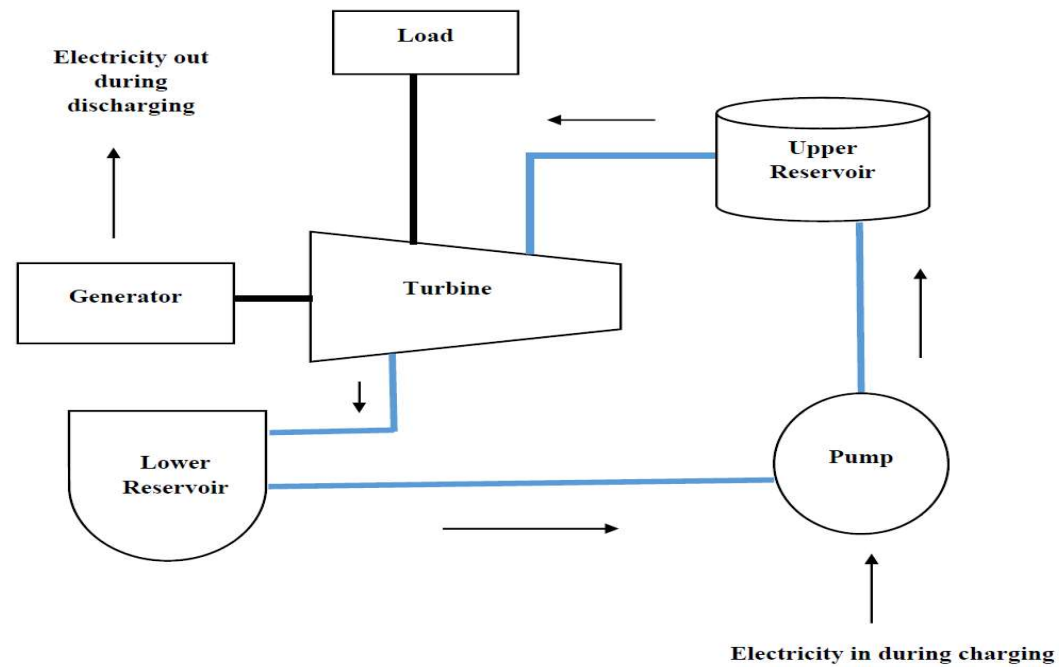

A pumped hydro storage unit

PUMPED HYDRO ENERGY STORAGE (PHES) SYSTEMS

- Well established commercially available storage technology
- Stores and produces electricity from a hydroelectric plant
- Water discharge from upper to lower reservoir during generation
- Water pumped back to upper reservoir from lower to store electricity
- Quick start up and shut down with tighter ramping capabilities
- Ability to track load changes and adapt

Major Pumped Storage Plants in India

Location	State	Capacity (MW)	Year of Commissioning	Upper reservoir capacity (m ³)	Lower reservoir capacity (m ³)
Srisaillam	Andhra Pradesh	6 X 150	2001-2003	6.16 X 10 ⁹	5.44 X 10 ⁹
Sardar Sarobar	Gujarat	6 X 200	2002-2006	5.8 X 10 ⁹	5 X 10 ⁹
Parulia	West Bengal	4 X 225	2007-2008	16.5 X 10 ⁶	16 X 10 ⁶
Ghatghar	Maharashtra	2 X 125	2008	5.87 X 10 ⁶	3.80 X 10 ⁶
Tehri	Uttarakhand	1000	2006	4 X 10 ⁹	.89 X 10 ⁹

OBJECTIVES

1. To evaluate the economic value of ESS like Pumped Energy Storage System in a PV dominated power system
2. A unit commitment power system model is setup to analyse the impact of ESS for VRE source dominated power system.
3. Apply to a 6-bus test case and 30-bus IEEE system


METHODOLOGY

- Security Constrained Unit Commitment (SCUC) model determines optimal order of operation of power generators with the objective of cost minimization while maintaining certain constraints.
- Mixed integer non-linear problem (MINLP) formulated in GAMS
- A model characterizing a power system with PV generating unit, thermal units and pumped hydro energy storage (PHES) unit with two scenarios,
 - i. without pumping action of pumped hydro unit
 - ii. with pumping action of pumped hydro unit

METHODOLOGY

- SCUC model developed with following constraints:
 - i. Power balance
 - ii. Power generation capability limits of units
 - iii. Ramp rate limits
 - iv. Minimum up-time and down-time constraints
 - v. Transmission flow limits of lines

CASE STUDY – 6-bus test system

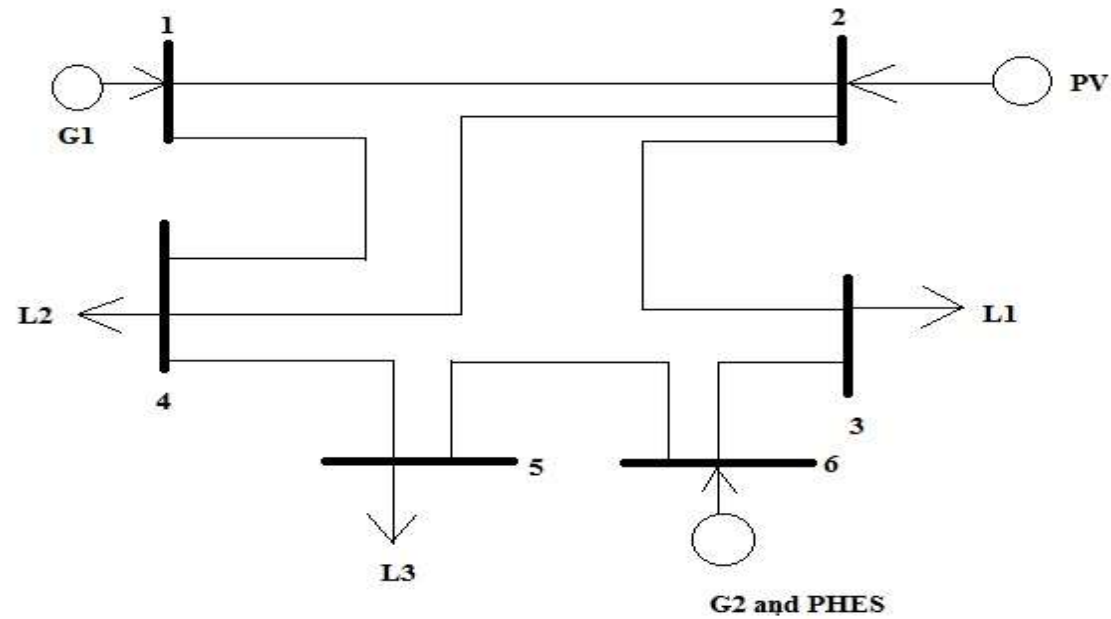


Line diagram of 6-bus test system

SYSTEM CHARACTERISTICS OF 6-BUS TEST MODEL

- The 6-bus test system has :
- 2 thermal units – one coal fired and one gas fired
- 1 PV generating unit
- 1 PHES unit
- Seven transmission lines

30-bus IEEE standard system

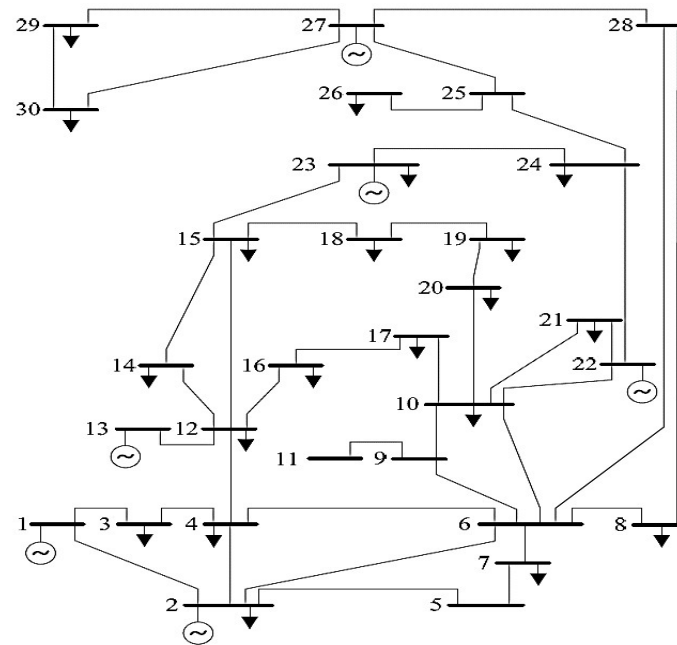

Line diagram of 30-bus standard IEEE system


System characteristics of 30-bus IEEE standard system

- It has 6 generators
- 3 thermal generators – 2 coal based and one gas based
- 2 PV generators
- 1 PHES unit
- 41 transmission lines


RESULTS

- The short term SCUC analysis for a 24-hour duration is carried on the 6-bus test system and 30-bus standard system
- Model formulated was setup in GAMS , solved using SBB solver
- The results compared two actions of PHES unit:
 - I. Without pumping mode of PHES
 - II. With the pumping action of PHES

6-bus system without pump

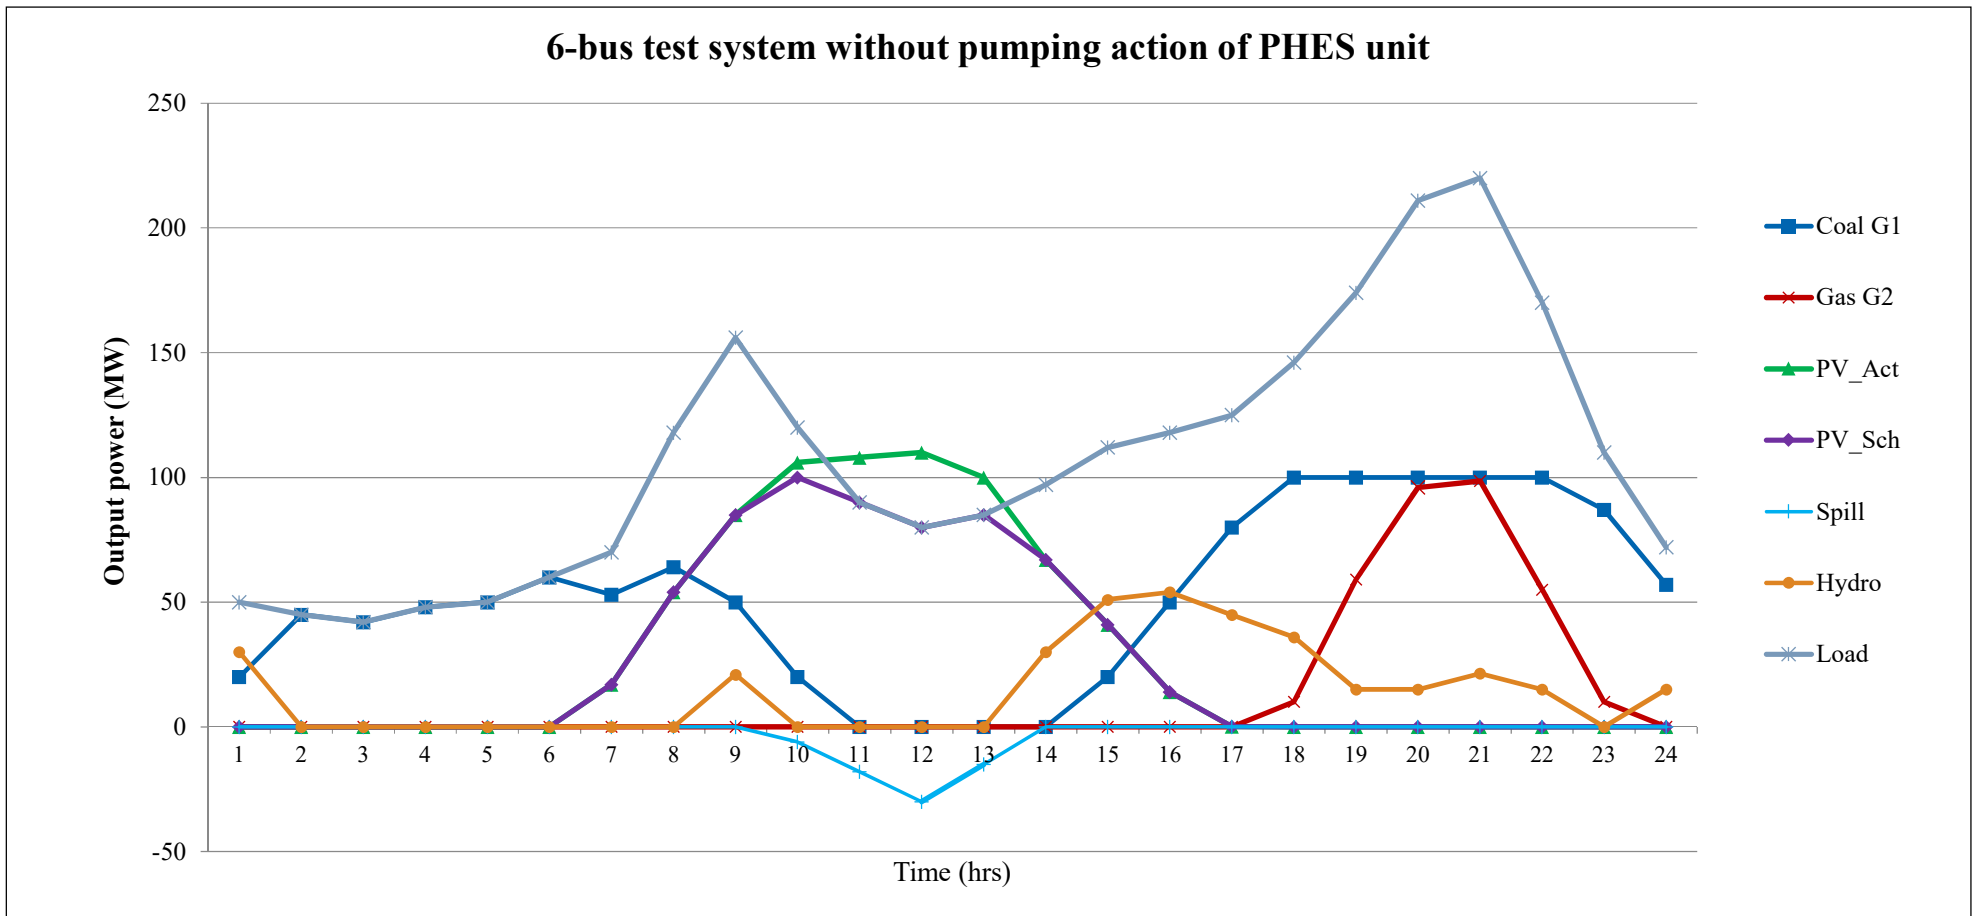


6-bus system with pump

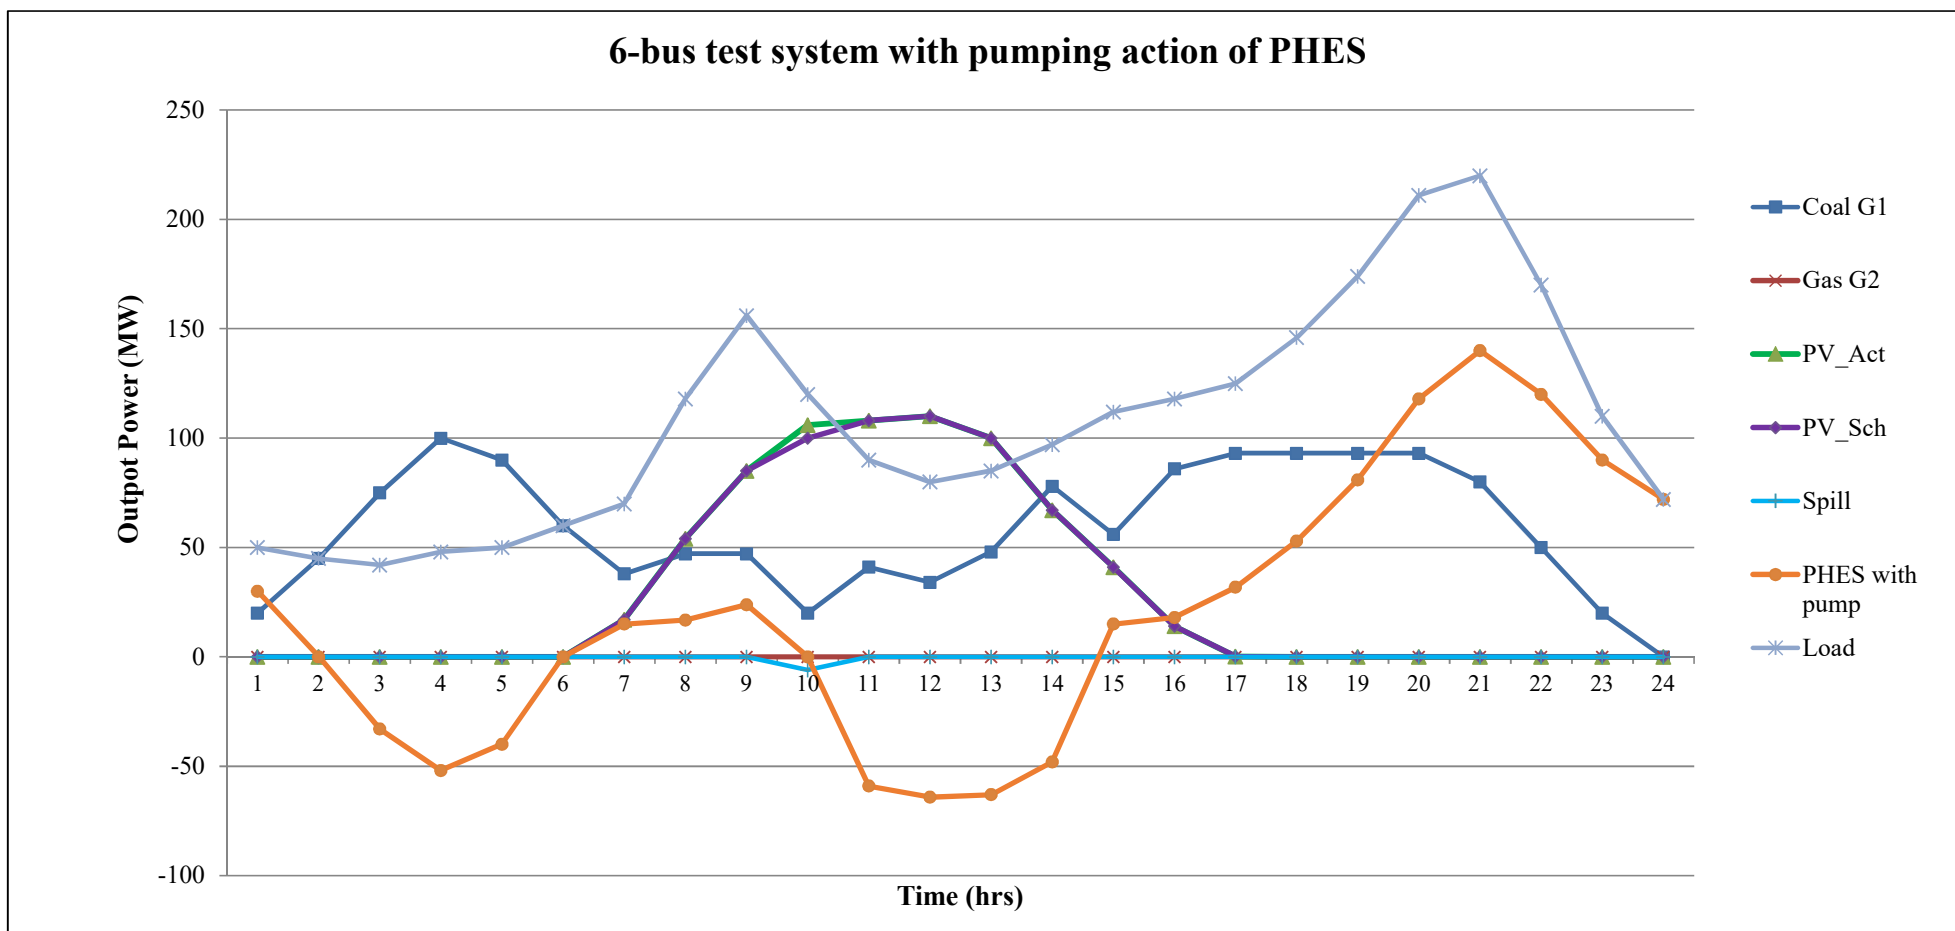

Output results for 6-bus test system


		Without pump	With pump
Total cost of operation (million Rs.)		2.87	2.11
Total generation from thermal units	Coal Unit G1 (MU)	1246	1407
	Gas Unit G2 (MU)	328.5	0
Total Cost of generation from thermal units	Coal Unit G1 (million Rs.)	1.86	2.11
	Gas Unit G2 (million Rs.)	0.88	0
Total load shed (MU)		13	0
Cost of load shedding (million Rs.)		130	0
Per unit cost of system operation (Rs./MWh)		1120	822.4
Per unit cost of energy served (Rs./MWh)		1074.8	822.4

30-bus IEEE STANDARD SYSTEM WITHOUT PUMP

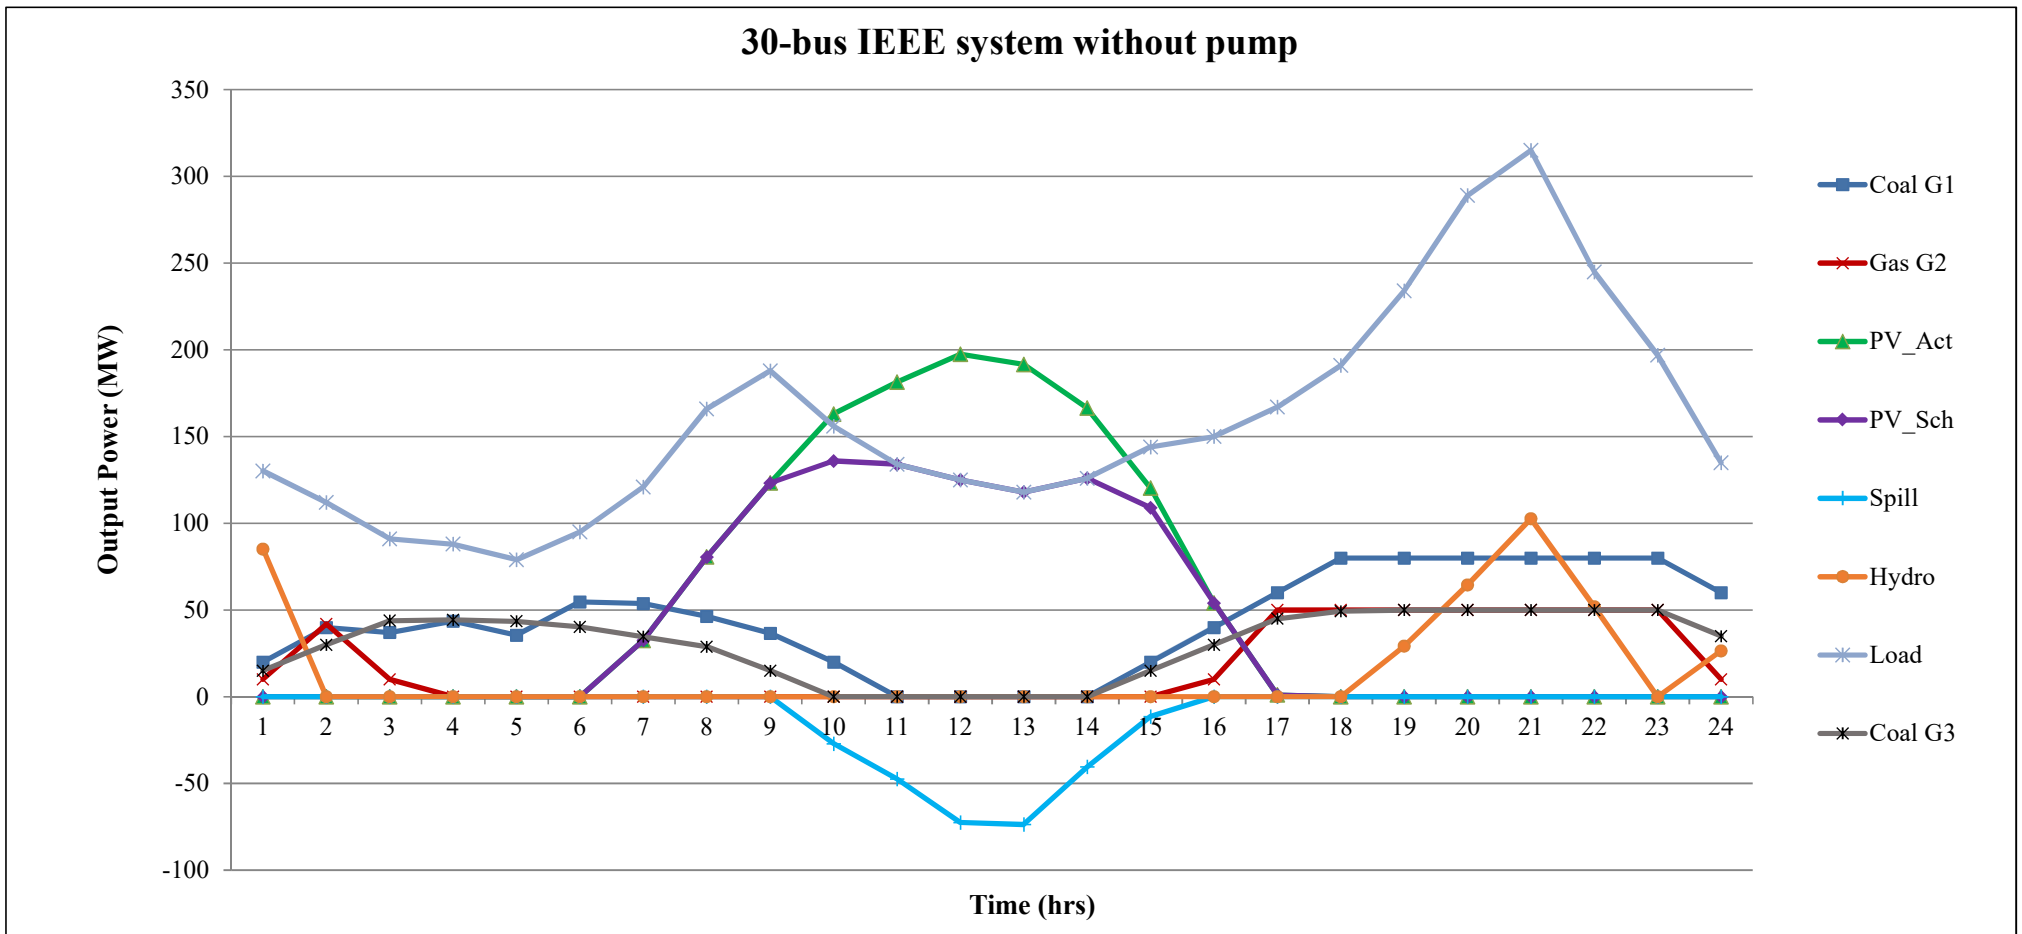

30-Bus IEEE standard system with pump

30 Bus System with pump

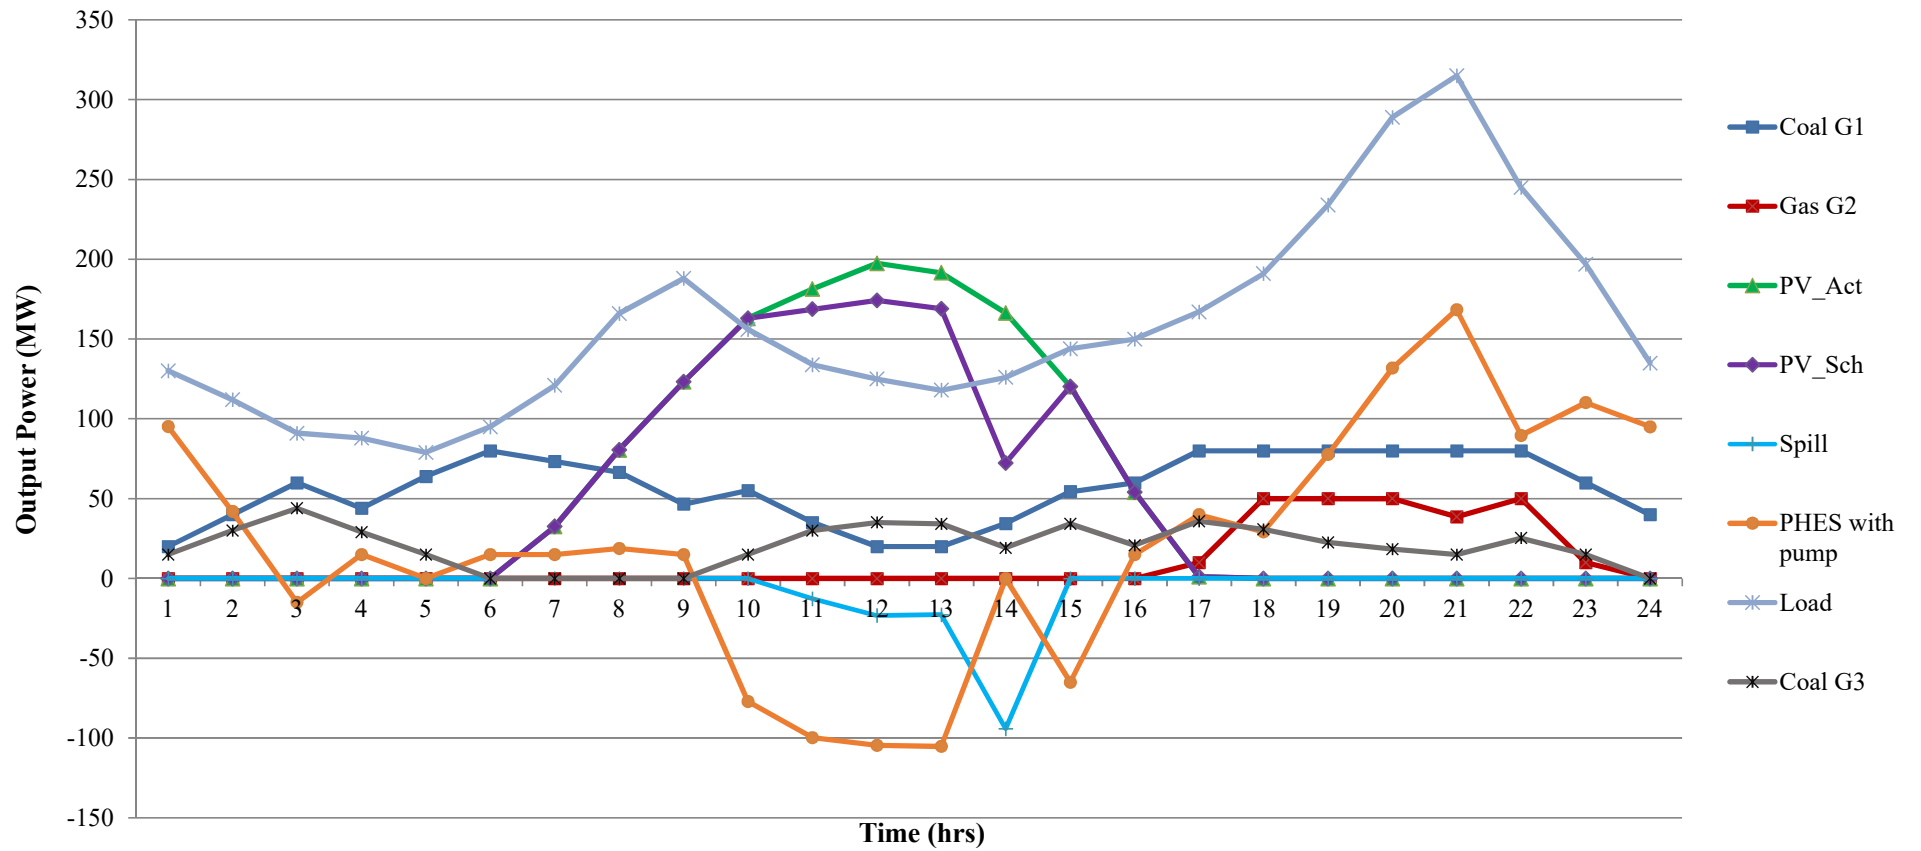

Output results for 30-bus IEEE STANDARD system

		Without pump	With pump
Total cost of operation (million Rs.)		5.57	3.72
Total generation from thermal units	Coal Unit G1 (MU)	1047	1353
	Gas Unit G2 (MU)	432	258
	Coal Unit G3 (MU)	720	484
Total Cost of generation from thermal units	Coal Unit G1 (million Rs.)	1.55	1.9
	Gas Unit G2 (million Rs.)	1.1	0.66
	Coal Unit G3 (million Rs.)	1.14	0.8
Total load shed (MU)		170	33
Cost of load shedding (million Rs.)		1700	330
Per unit cost of system operation (Rs./MWh)		1468	980.4
Per unit cost of energy served (Rs/MWh)		1068.5	901.3

ECONOMIC VALUE OF PUMPED STORAGE

- Assessment of the economic value of pumped storage in the defined power systems
- Assumptions : same SCUC operation and same demand pattern throughout the year
- Life of PHES unit – 30 years
- Discount rate – 15%

6-bus test system	Overall system operation cost without penalty		Overall system operation cost with penalty	
	Without pump	With pump	Without pump	With pump
Daily cost of operation (million Rs.)	2.74	2.11	2.87	2.11
Savings / year (million Rs.)	231		279	
Present value (million Rs.)	1748		2107	
Value of pump facility (million Rs./MW)	8		9.6	

Thus the pumping facility of a hydro unit adds a value equivalent to 9.6 million Rs/MW and 8 million Rs/MW excluding the penalty costs

30-bus IEEE system	Overall system operation cost without penalty		Overall system operation cost with penalty	
	Without pump	With pump	Without pump	With pump
Daily cost of operation (million Rs.)	3.87	3.4	5.57	3.72
Savings / year (million Rs.)	176		676	
Present value (million Rs.)	1330		5107	
Value of pump facility (million Rs./MW)	6		23	

Thus the pumping facility of a hydro unit adds a value equivalent to 23 million Rs/MW and 6 million Rs/MW excluding the penalty costs

CONCLUSIONS

- Spillage reduced by 91% in 6-bus test system, by 44% in 30-bus IEEE standard system
- In a 6-bus test system, presence of pump reduced cost by 26.5 % and by 23.48% excluding the penalty cost
- Translates to present value of Rs. 9.6 million /MW including and Rs. 8 million/MW without the cost of unserved energy
- In a 30-bus test overall reduction of 33.24% in the cost of system operations (with pump) and 15.6% without the penalty costs
- The present value of pumped storage facility is Rs. 23.2 million /MW and Rs. 6 million /MW without the penalties.
- Study highlights that power system (society) is loosing economic benefit of investments made in PHES.
- PHES can help assist Greater penetration for VRE.

Thank You

www.iitk.ac.in/ime/anoops

anoops@iitk.ac.in

Selected Readings

- “Power Sector Reform in India: Current Issues and Prospects”, Energy Policy, Elsevier, Volume 34, Issue 16, November 2006.
- <http://dx.doi.org> enter the following doi:10.1016/j.enpol.2004.08.013
- “Towards a Competitive Market for Electricity and Consumer Choice in Indian Power Sector”, Energy Policy Vol. 38 4196-4208, 2010. (Elsevier)
- <http://dx.doi.org> enter the following doi:10.1016/j.enpol.2010.03.047

Selected Readings

- Anoop Singh, Tooraj Jamasb, Rabindra Nepal, and Michael Toman, Cross-Border Electricity Cooperation in South Asia, World Bank Policy Research Working Paper (PRWP), #WPS7328, 2015.
- Anoop Singh, Jyoti Parikh, K.K. Agrawal, Dipti Khare, Rajiv Ratna Panda and Pallavi Mohla, “Prospects for Regional Cooperation on Cross-Border Electricity Trade in South Asia”, 2013, IRADe, New Delhi
- “Power Sector Reform in India: Current Issues and Prospects”, Energy Policy, Elsevier, Volume 34, Issue 16, November 2006.
- “Towards a Competitive Market for Electricity and Consumer Choice in Indian Power Sector”, Energy Policy Vol. 38 4196-4208, 2010. (Elsevier)
- “Analysing Efficiency of Electric Distribution Utilities in India: a Data Envelopment Analysis” (with Dilip Kumar Pandey), IAEE International Conference, Stockholm 19-23 June, 2011.

Selected Readings

- “Analysing Efficiency of Electric Distribution Utilities in India: a Data Envelopment Analysis” (with Dilip Kumar Pandey), IAEE International Conference, Stockholm 19-23 June, 2011.
- “Modelling Economic Efficiency of Renewable Energy Policies: A Multi-State Model For India”, Accepted for World Renewable Energy Congress, 17-19 Oct. 2011, Bali, Indonesia. (with Sundeeep Chowdary).
- “Economics, Regulation and Implementation Strategy for Renewable Energy Certificates in India” in India Infrastructure Report 2010, Oxford Univ. Press.
- “Towards a Competitive Market for Electricity and Consumer Choice in Indian Power Sector”, Energy Policy Vol. 38 4196-4208, 2010. (Elsevier)
- “A Market for Renewable Energy Credits in the Indian Power Sector”, Renewable and Sustainable Energy Review journal, Elsevier, 2009.
- “Economics of Iran-Pakistan-India Natural Gas Pipeline: Implications for Energy Security in India”, Economic and Political Weekly, Vol. XLIII, No. 7 2008.
- “Power Sector Reform in India: Current Issues and Prospects”, Energy Policy, Elsevier, Volume 34, Issue 16, November 2006.

Courses, Workshops and Conferences

- Short Term Course “Challenges and Implementation Issues post Electricity Act 2003: Regulatory, Policy & Technical Solutions”, 10-14 April, 2004
- International Conference on “Power Market Development in India: Reflections from International Experience”, 19-21 April, 2005
- National Workshop on “Project Financing for Energy and Infrastructure Sector”, April 19-22, 2007
- 2nd National Workshop on “Project Financing for Energy and Infrastructure Sector”, April 24-27, 2008
- Capacity Building Programme for Officers of Electricity Regulatory Commissions, 30th June - 5th July, 2008

Courses, Workshops and Conferences (contd.)

- 2nd Capacity Building Programme for Officers of Electricity Regulatory Commissions, 3-8 August, 2009
- 3rd Capacity Building Programme for Officers of Electricity Regulatory Commissions, 23-28 August, 2010
- Energy Conclave 2010, 8-15 Jan. 2010
- 4th Capacity Building Programme for Officers of Electricity Regulatory Commissions, 18-23 July, 2011
- 5th Capacity Building Programme for Officers of Electricity Regulatory Commissions, 18-23 Oct., 2012

Further Readings

- “Analysing Efficiency of Electric Distribution Utilities in India: a Data Envelopment Analysis” (with Dilip Kumar Pandey), IAEE International Conference, Stockholm 19-23 June, 2011.
- “Modelling Economic Efficiency of Renewable Energy Policies: A Multi-State Model For India”, Accepted for World Renewable Energy Congress, 17-19 Oct. 2011, Bali, Indonesia. (with Sundeeep Chowdary).
- “Economics, Regulation and Implementation Strategy for Renewable Energy Certificates in India” in India Infrastructure Report 2010, Oxford Univ. Press.
- “Towards a Competitive Market for Electricity and Consumer Choice in Indian Power Sector”, Energy Policy Vol. 38 4196-4208, 2010. (Elsevier)
- “A Market for Renewable Energy Credits in the Indian Power Sector”, Renewable and Sustainable Energy Review journal, Elsevier, 2009.
- “Economics of Iran-Pakistan-India Natural Gas Pipeline: Implications for Energy Security in India”, Economic and Political Weekly, Vol. XLIII, No. 7 2008.
- “Power Sector Reform in India: Current Issues and Prospects”, Energy Policy, Elsevier, Volume 34, Issue 16, November 2006.

Courses, Workshops and Conferences

- Short Term Course “Challenges and Implementation Issues post Electricity Act 2003: Regulatory, Policy & Technical Solutions”, 10-14 April, 2004
- International Conference on “Power Market Development in India: Reflections from International Experience”, 19-21 April, 2005
- National Workshop on “Project Financing for Energy and Infrastructure Sector”, April 19-22, 2007
- 2nd National Workshop on “Project Financing for Energy and Infrastructure Sector”, April 24-27, 2008
- Capacity Building Programme for Officers of Electricity Regulatory Commissions, 30th June - 5th July, 2008


Courses, Workshops and Conferences (contd.)

- 2nd Capacity Building Programme for Officers of Electricity Regulatory Commissions, 3-8 August, 2009
- 3rd Capacity Building Programme for Officers of Electricity Regulatory Commissions, 23-28 August, 2010
- Energy Conclave 2010, 8-15 Jan. 2010
- 4th Capacity Building Programme for Officers of Electricity Regulatory Commissions, 18-23 July, 2011
- 5th Capacity Building Programme for Officers of Electricity Regulatory Commissions, 18-23 Oct., 2012

For ppts of above programs, visit
www.iitk.ac.in/ime/anoops

**PUMPED STORAGE PLANTS
IN
SOUTHERN REGION**


SR Hydro Jan 2016 to Dec 2016

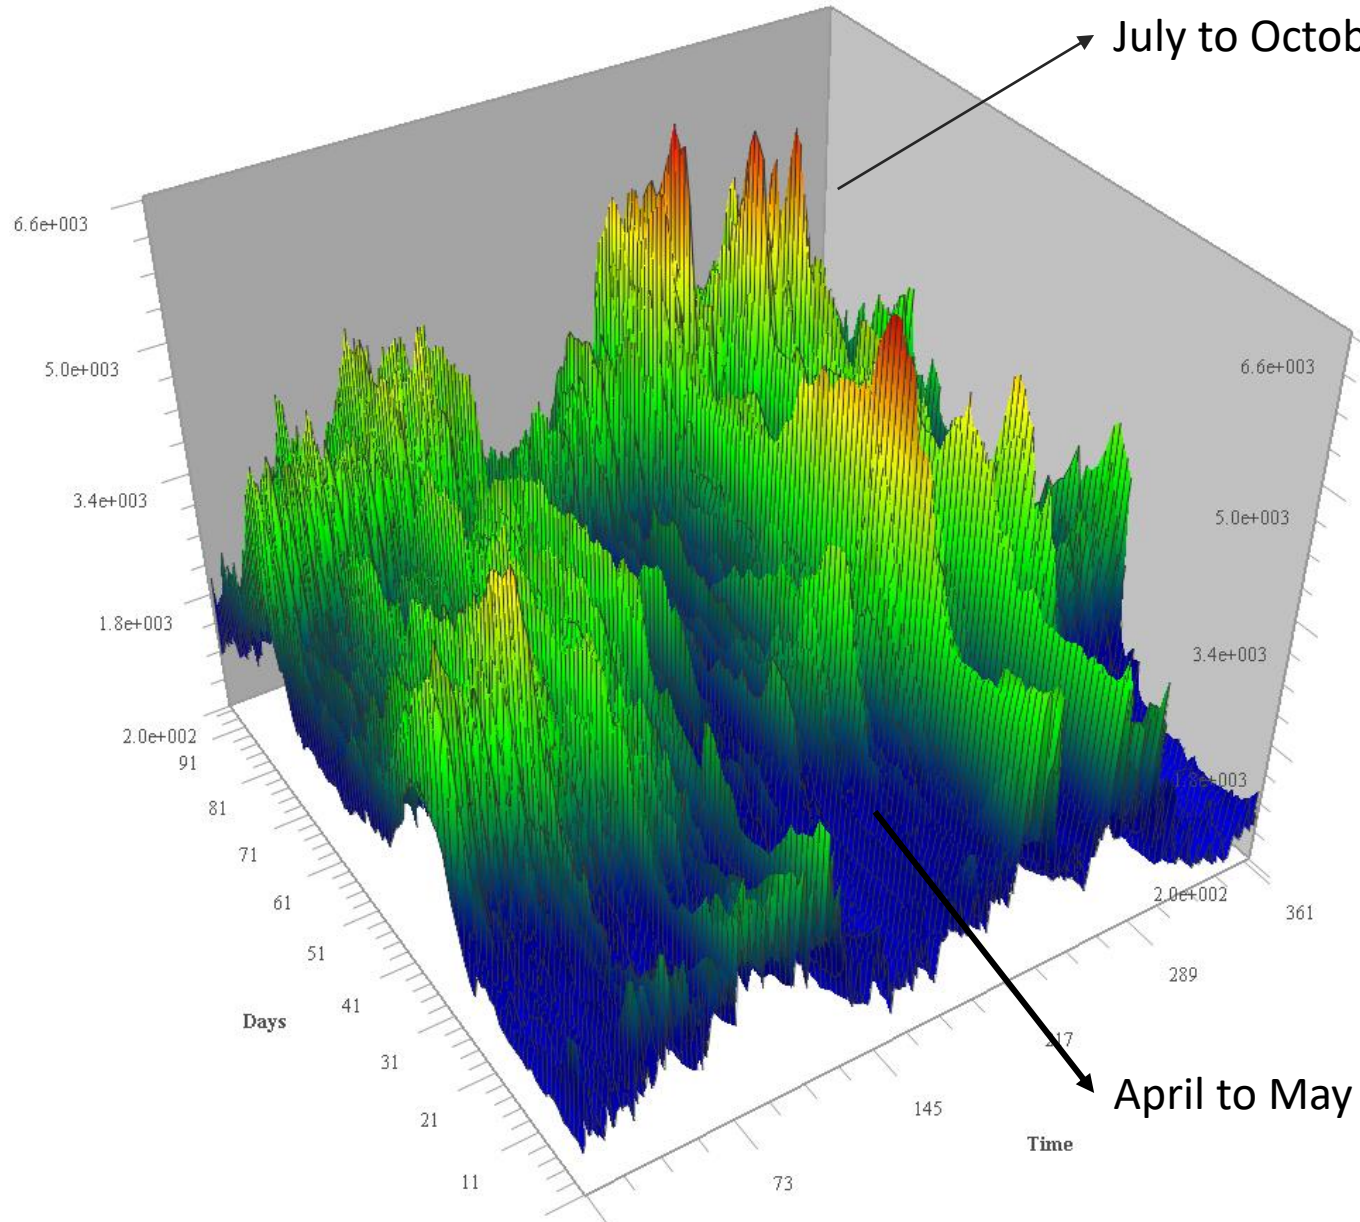

- Southern Regional Hydro is Highly Monsoon Dependent
- Hydro is Mostly utilized for the morning and the Evening Ramps
- During Summer due to depletion of Reservoir Levels less generation
- During Monsoon higher generation to avoid spillage
- **MAXIMUM GENERATION: 6681 MW**

Hydro Maximum VS Installed Capacity


- This Graphs represents the following
 - Sum of each State's Maximum Generation / Total SR Hydro Installed Capacity
 - Some Days the Utilization Factor has reached as High as 72%.
- On an Annual Basis SR Capacity Utilization Factor is 38%

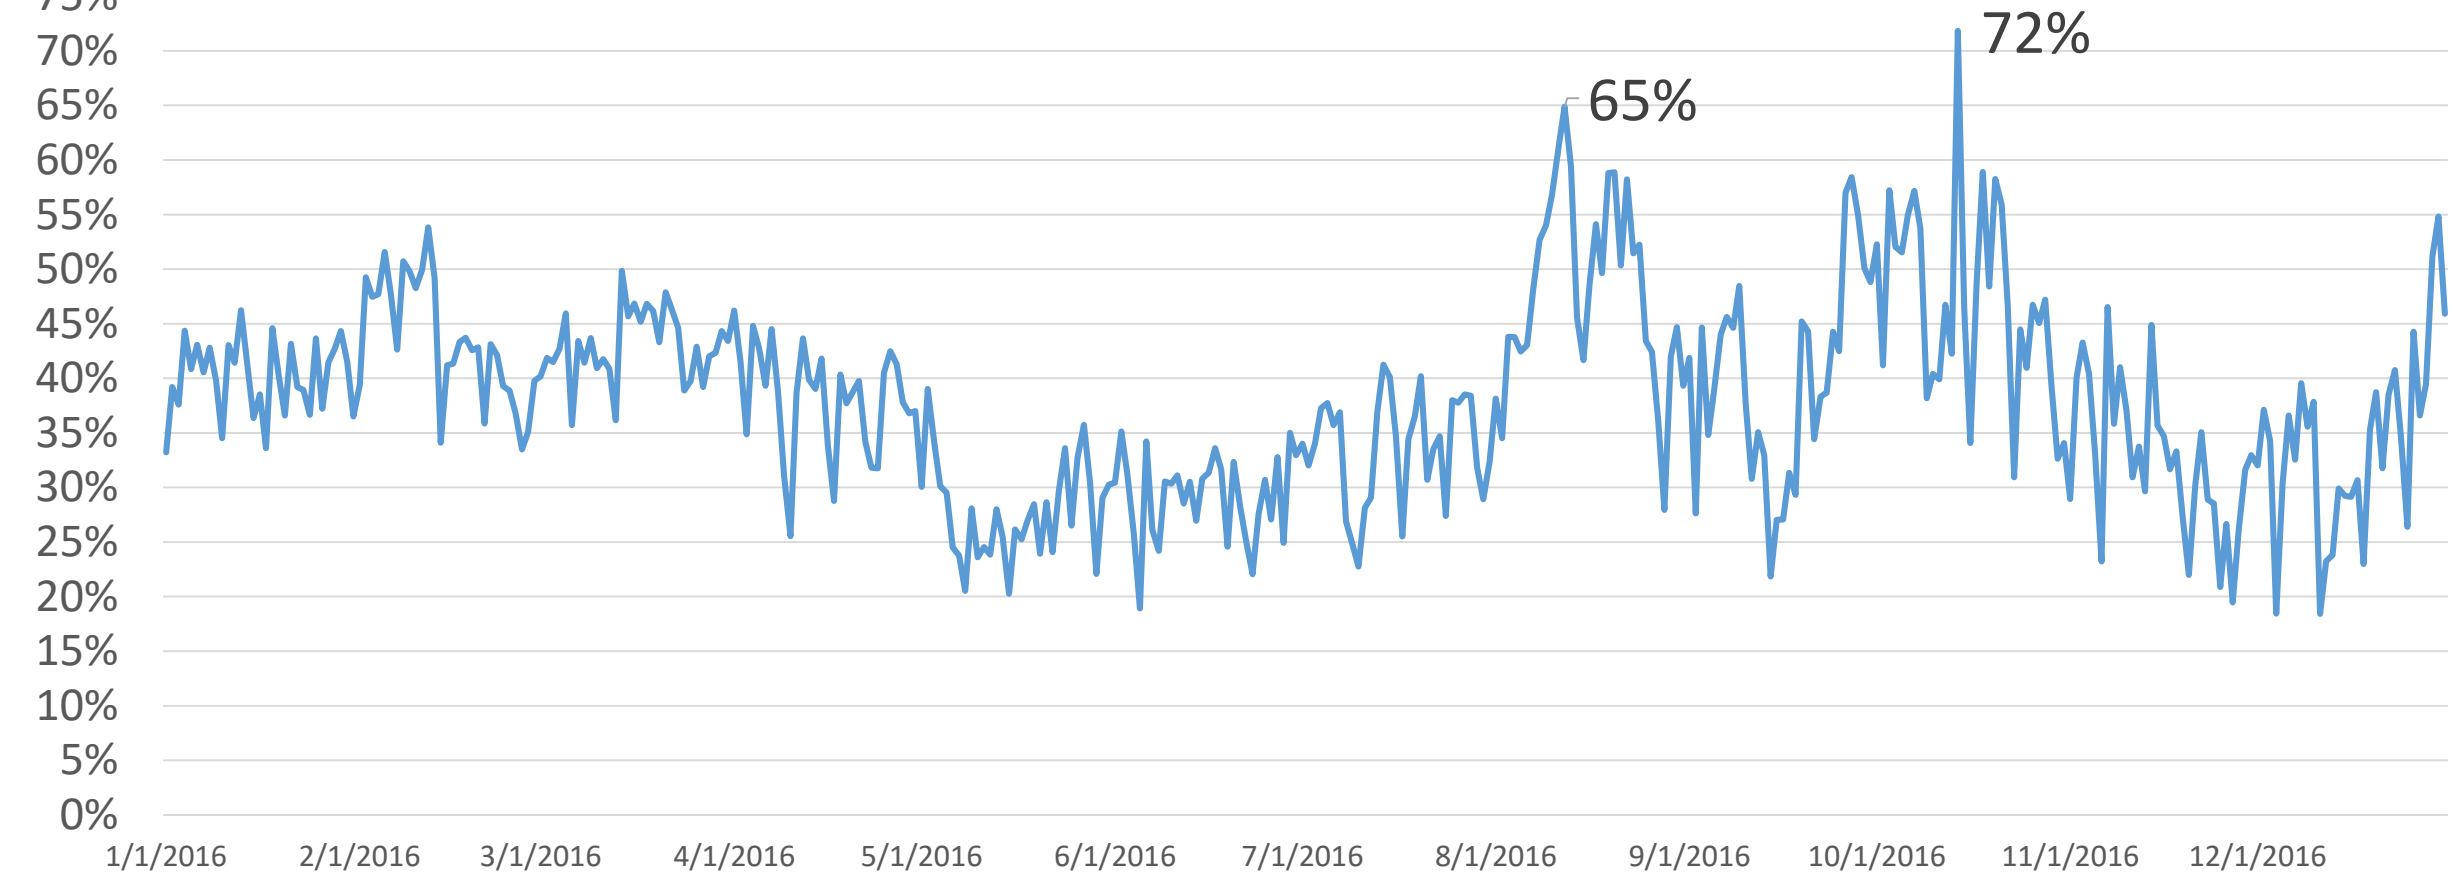

PUMPED STORAGE INSTALLED CAPACITY IN SR

- SRISAILAM LB :
 - Krishna River , Telangana
 - 900 MW (6 X 150 MW)
- NAGARJUNSAGAR :
 - Krishna River , Telangana
 - 705.6 (7 X 100.8 MW)
- KADAMPARAI :
 - Kadamparai River, Tamil Nadu
 - 400 MW (4 X 100 MW)
- TOTAL SR CAPACITY : 2005 MW


KRISHNA BASIN HYDRO MAP

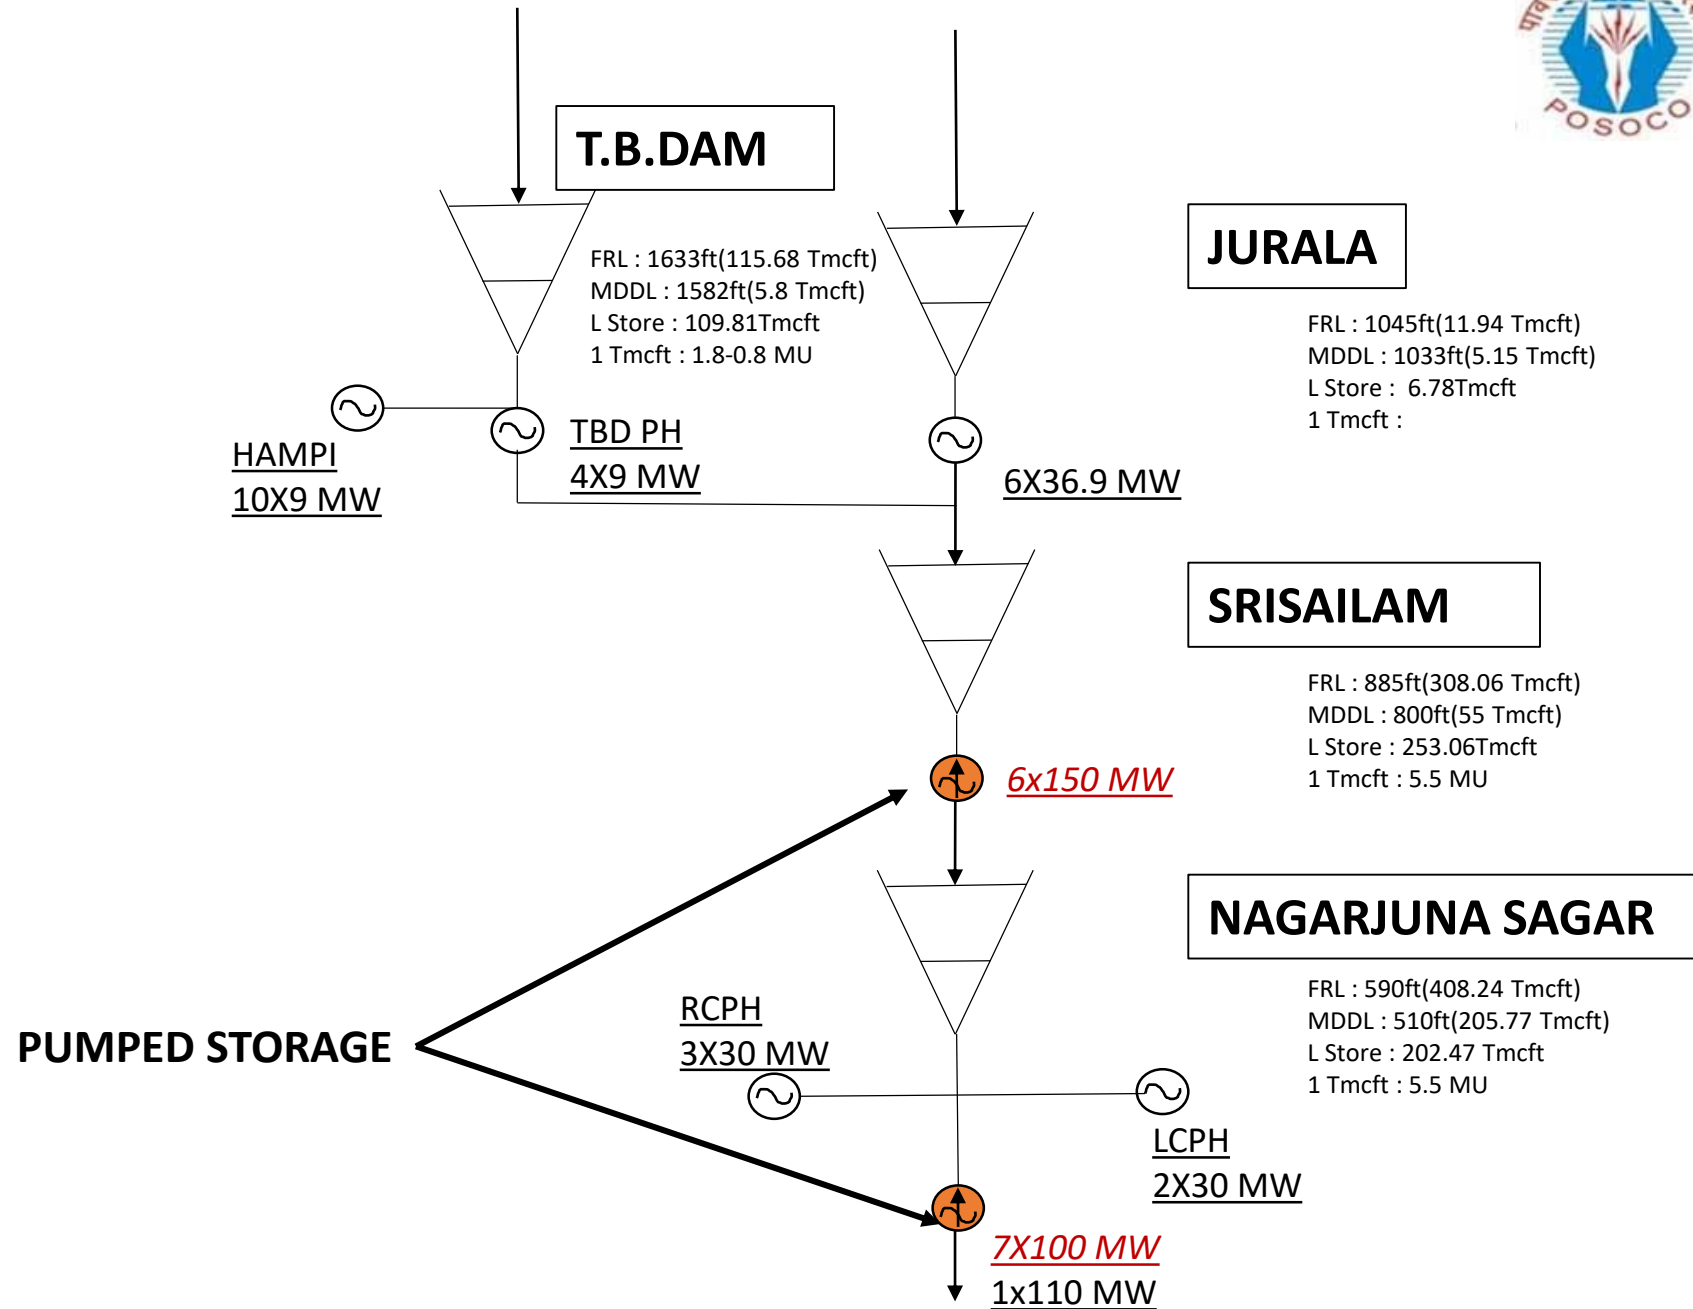

SRISAILAM LB



Duration Curve of Srisailam LB For 2016(I/C = 900 MW)

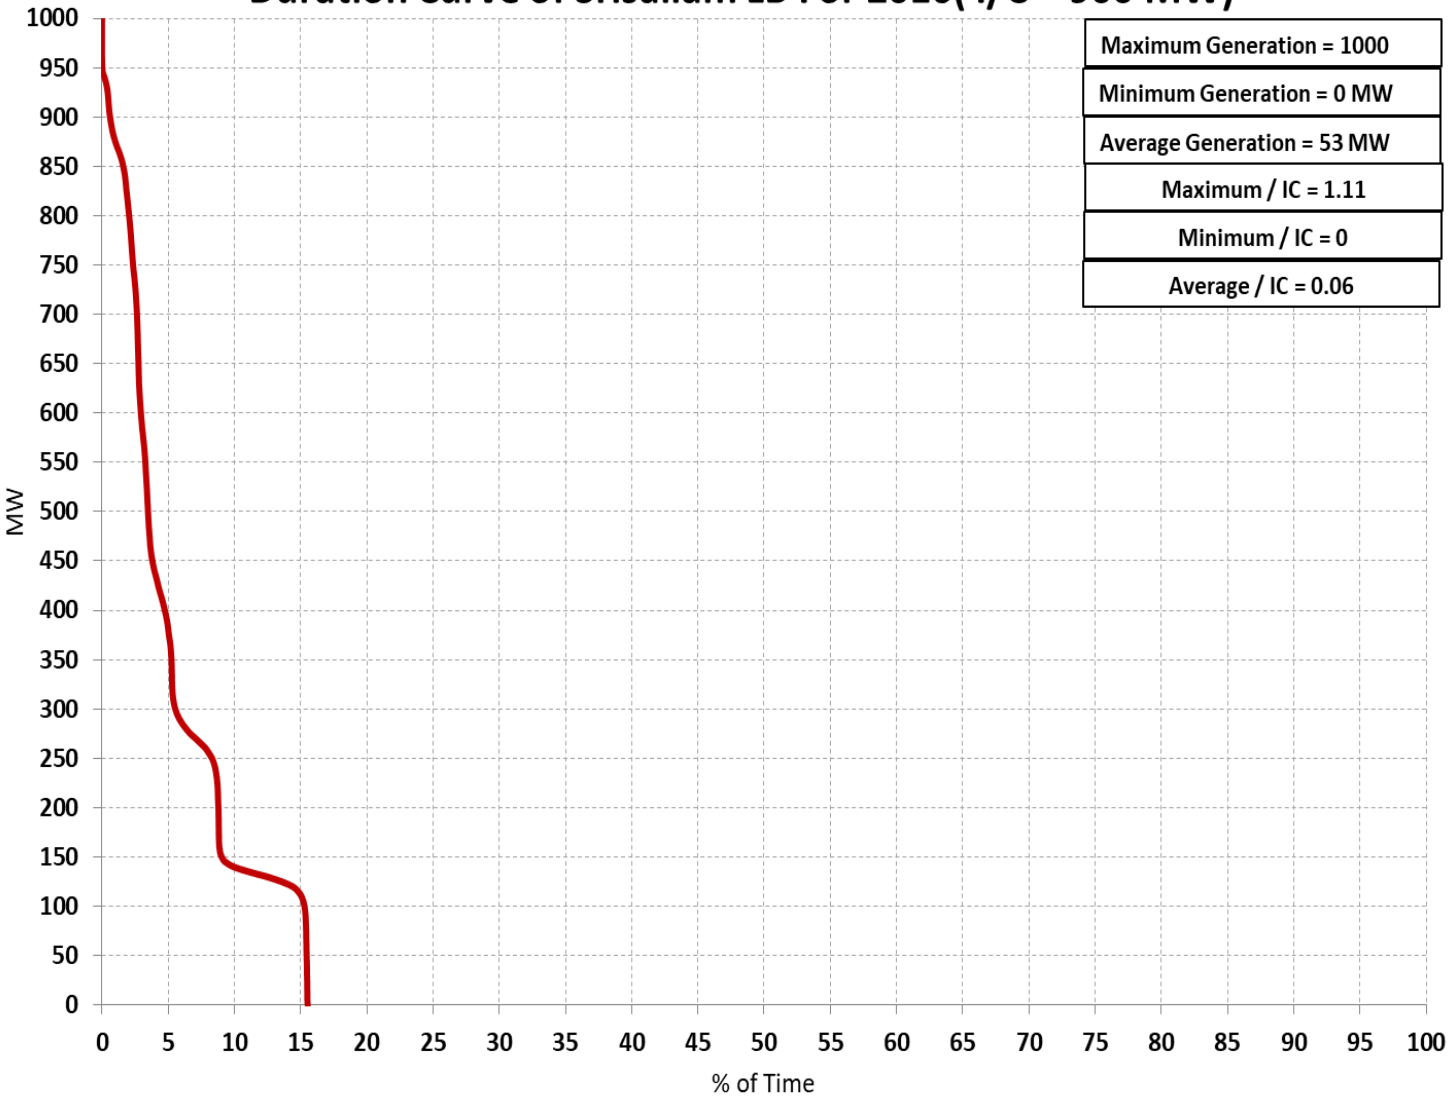


- **Turbine Type** : Francis Turbine
 - All Machines can be run in Condenser mode.
 - Time Taken – 3 to 4 Hours with 45 Min. Gap
 - No hurdles faced due to Upstream flow, Balancing reservoir, etc.
- **Irrigation Requirement** : Usually During Summers on the request 3.5 MU/ Day is being scheduled
- **Transmission Constraint** : No Transmission Constraints
- **Generation Constraint** :
 - Dam is under the control of Krishna Irrigation Dept. In case of additional requirement due to grid conditions, special permission is to be obtained.
 - Cannot be Operated less than 110 MW due to Vibration
 - Pump Operation dependent on Nagarjunsagar Dam Level as Srisailam Tail Race WEIR is under repair
 - No specified limitations on no. of start - stops

Constraints in Operation at Srisaillam LB

- 540 ft level was required at Nagarjunasagar for pump mode operation at Srisaillam LB. Generally, water is above this level for about 2-3 months in a year.
- There is a weir between Srisaillam Reservoir and Nagarjunasagar Reservoir which is used for pumping operation. The weir was not operational since last two years. Attempts to repair the weir have not been successful. Issue had been taken up with CEA/CWC also.

Nagarjunsagar HEP (1x110 + 7 x 100 MW)

Duration Curve Of Nagarjunsagar for 2016(I/C = 815.6 MW)

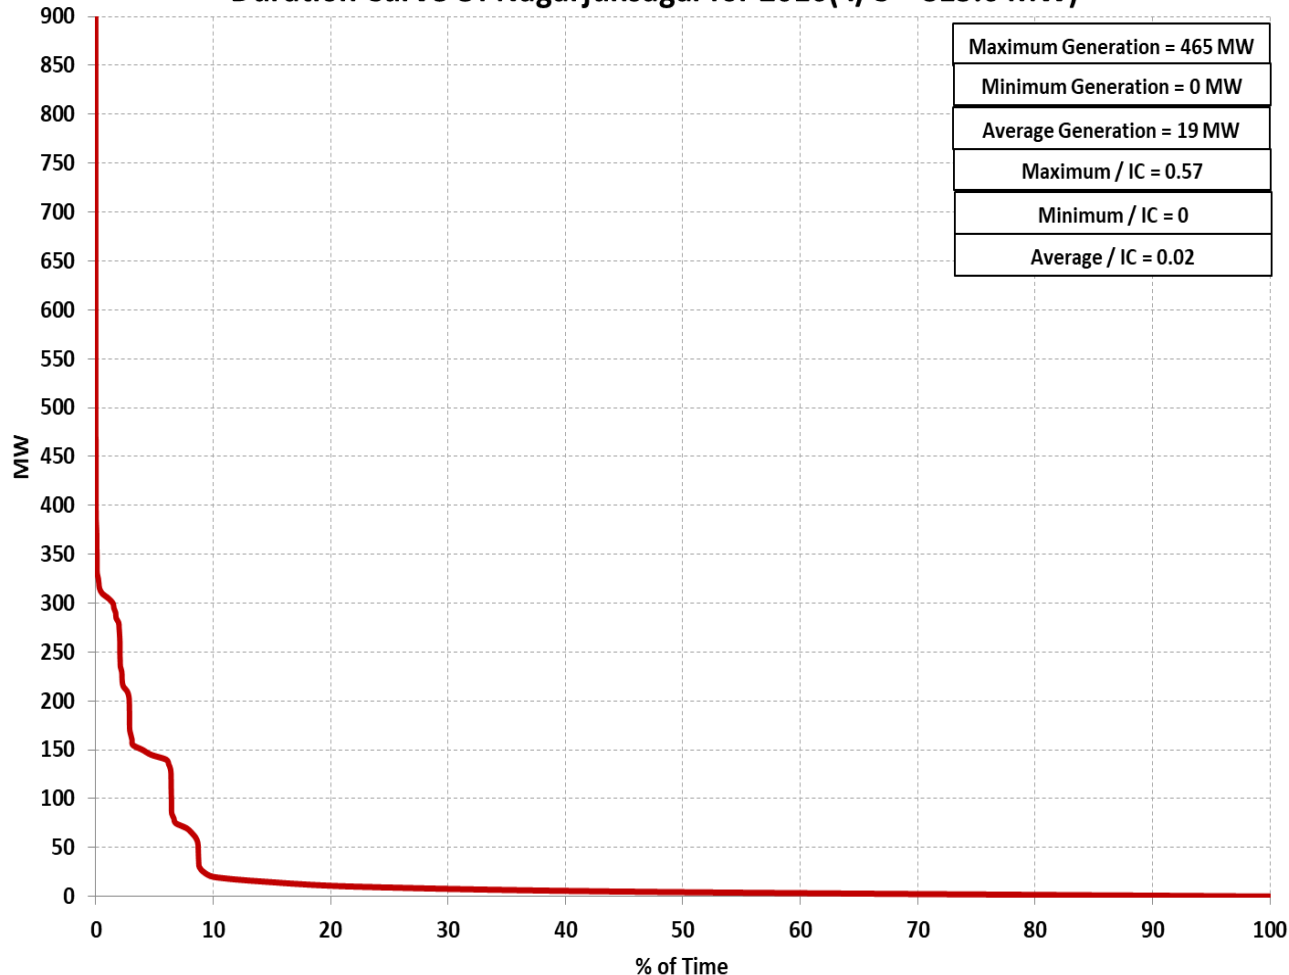


- **Turbine Type** : Francis Turbine
 - All Machines can be run in Condenser mode except U#1.
 - Time Taken –4 min for starting and 8 min for full load
 - No hurdles faced due to Upstream flow, Balancing reservoir, etc.
- **Transmission Constraint** : No Transmission Constraints
- **Generation Constraint** :
 - Dam is under the control of Krishna Irrigation Dept. In case of additional requirement due to grid conditions, special permission is to be obtained.
 - Vibration observed when generation is less than 65 MW for Unit#1 & 55 MW for Unit#2 to 8.
 - No specified limitations on no. of start/stops operations

Constraints in Operation at Nagarjunsagar

- Shifting of lift irrigation pumps to avoid possible submergence
- 7 TMC of water is required in the Tail Pond Reservoir for pumping operation, out of which, 6 TMC was dead storage while one TMC could be utilized for pumping operation
- It was noted that for pumping mode, the level required in Tail Pond Reservoir was higher than the MDDL for 2x25 MW generating station. Further Tail Pond generating station to operate its unit when water level is above the level required for pump mode and whenever discharge was there from main Nagarjunasagar Reservoir
- Each unit takes around 20 – 30 minutes from stand – still to pumping mode.

KADAMPARAI HEP (4 X 100 MW)

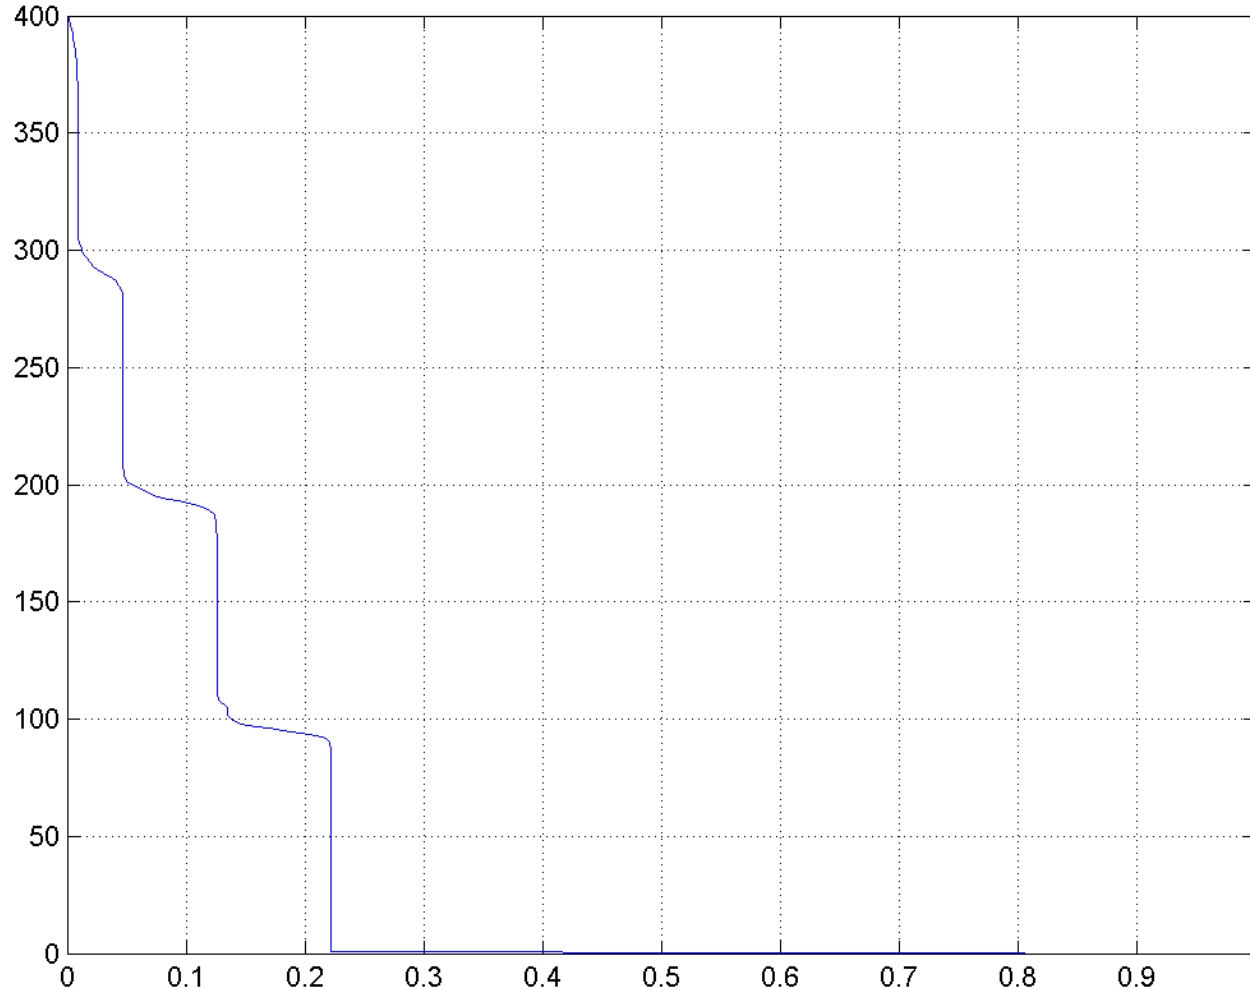

- **Turbine Type** : Reversible Francis Turbine
- **Irrigation Requirement** :
 - No Irrigation Requirement.
- **Transmission Constraint** :
 - Low Voltage Issues
- **Generation Constraint** :
 - Availability of water


Mode	Condition	Response Time
Generator	Stand still to on-line	5 min
Generator	On-line to full load	Few seconds
Motor	Stand still to Synchronous condenser	9 min
Motor	Synchronous condenser to Pump	1 min

Kadamparai Pumped Storage

- Kadamparai hydroelectric pumped storage plant is located in Anamalai hills in Coimbatore district of Tamil Nadu in Southern Region (SR). Upper reservoir of the plant is Kadamparai dam and Lower reservoir of the plant is lower Aliyar dam
- The power house is located underground with 4 no's of reversible Francis Turbine units each having a generating capacity 100 MW. Index plan of Kadamparai project is shown in

Unit #	Date of Commissioning
1	17.10.1987
2	26.02.1988
3	12.04.1989
4	16.12.1988

3D Plot of Kadamparai Generation and Pump Operation during 2016

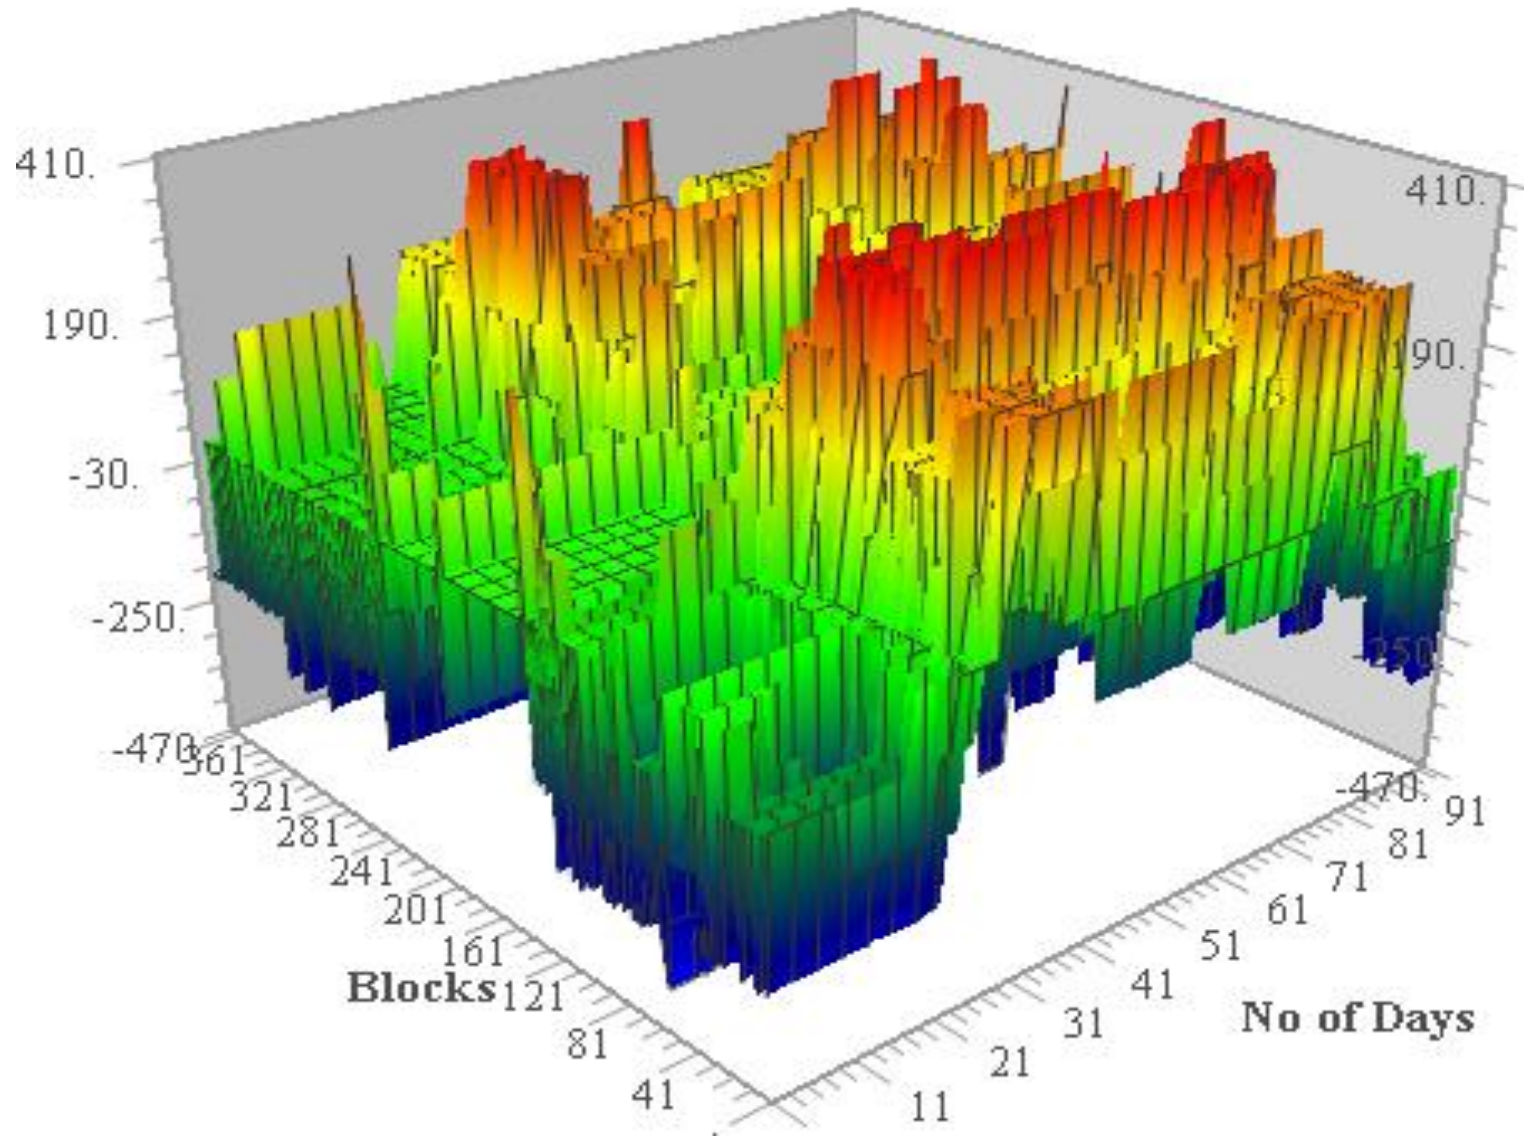


Constraints in Operation at Kadamparai


- Low voltage problem in Kadamparai
 - Due to low voltage, stator of the motor draws more current which may cause damage to the windings.
 - ICT Tap Change was facilitated by SRLDC at Udumalpet SS to maintain the voltages at Kadamparai SS.
 - Reactive power shortage at 230 kV and below of Kadamparai substation.
- Water availability due to monsoon.

Kadamparai Pumped Hydro Plant Monthly CF %



Jan 2013 to Jan 2017

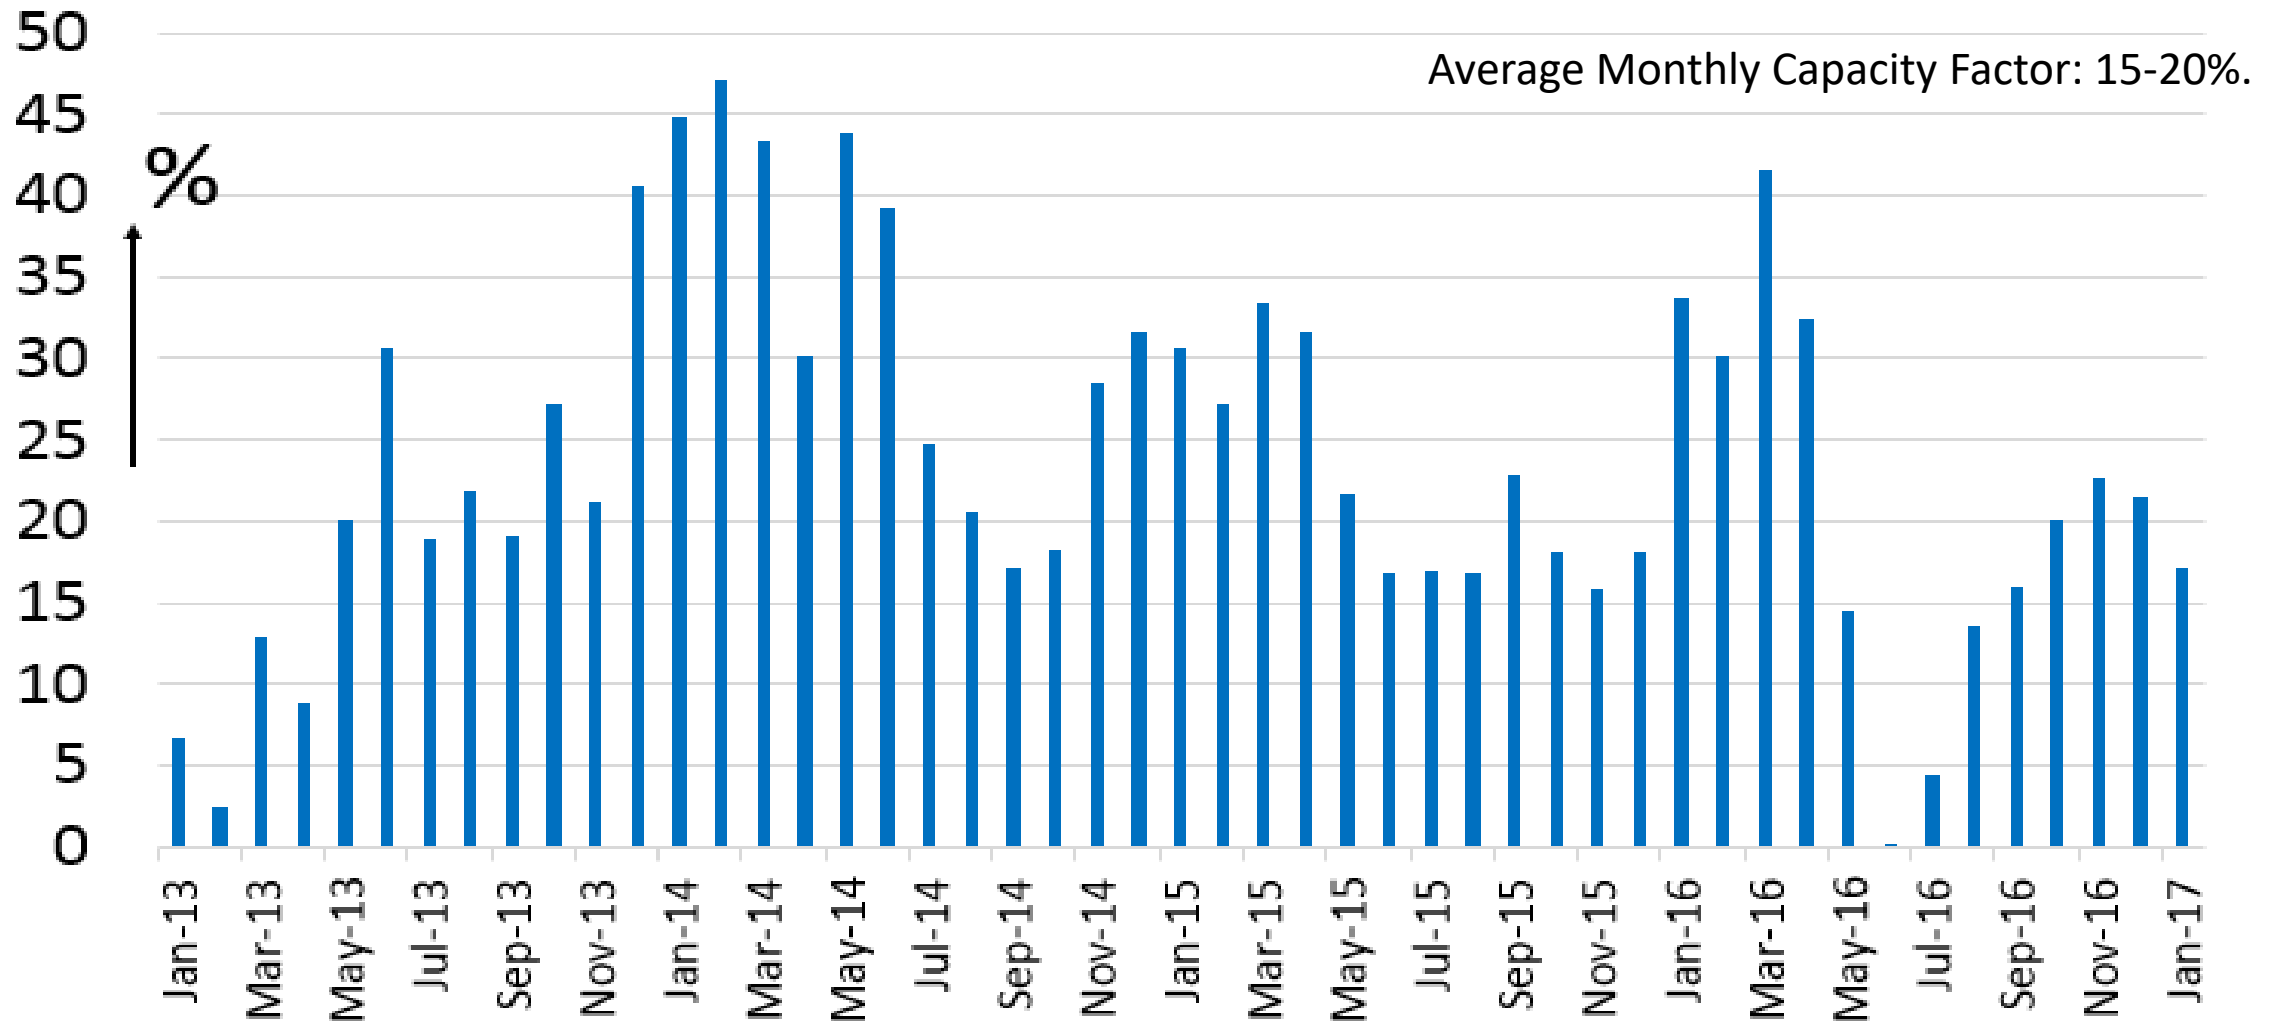

Kadamparai Pumped Hydro Plant Monthly Generation MU and Pump MU Jan 2013 to Jan 2017

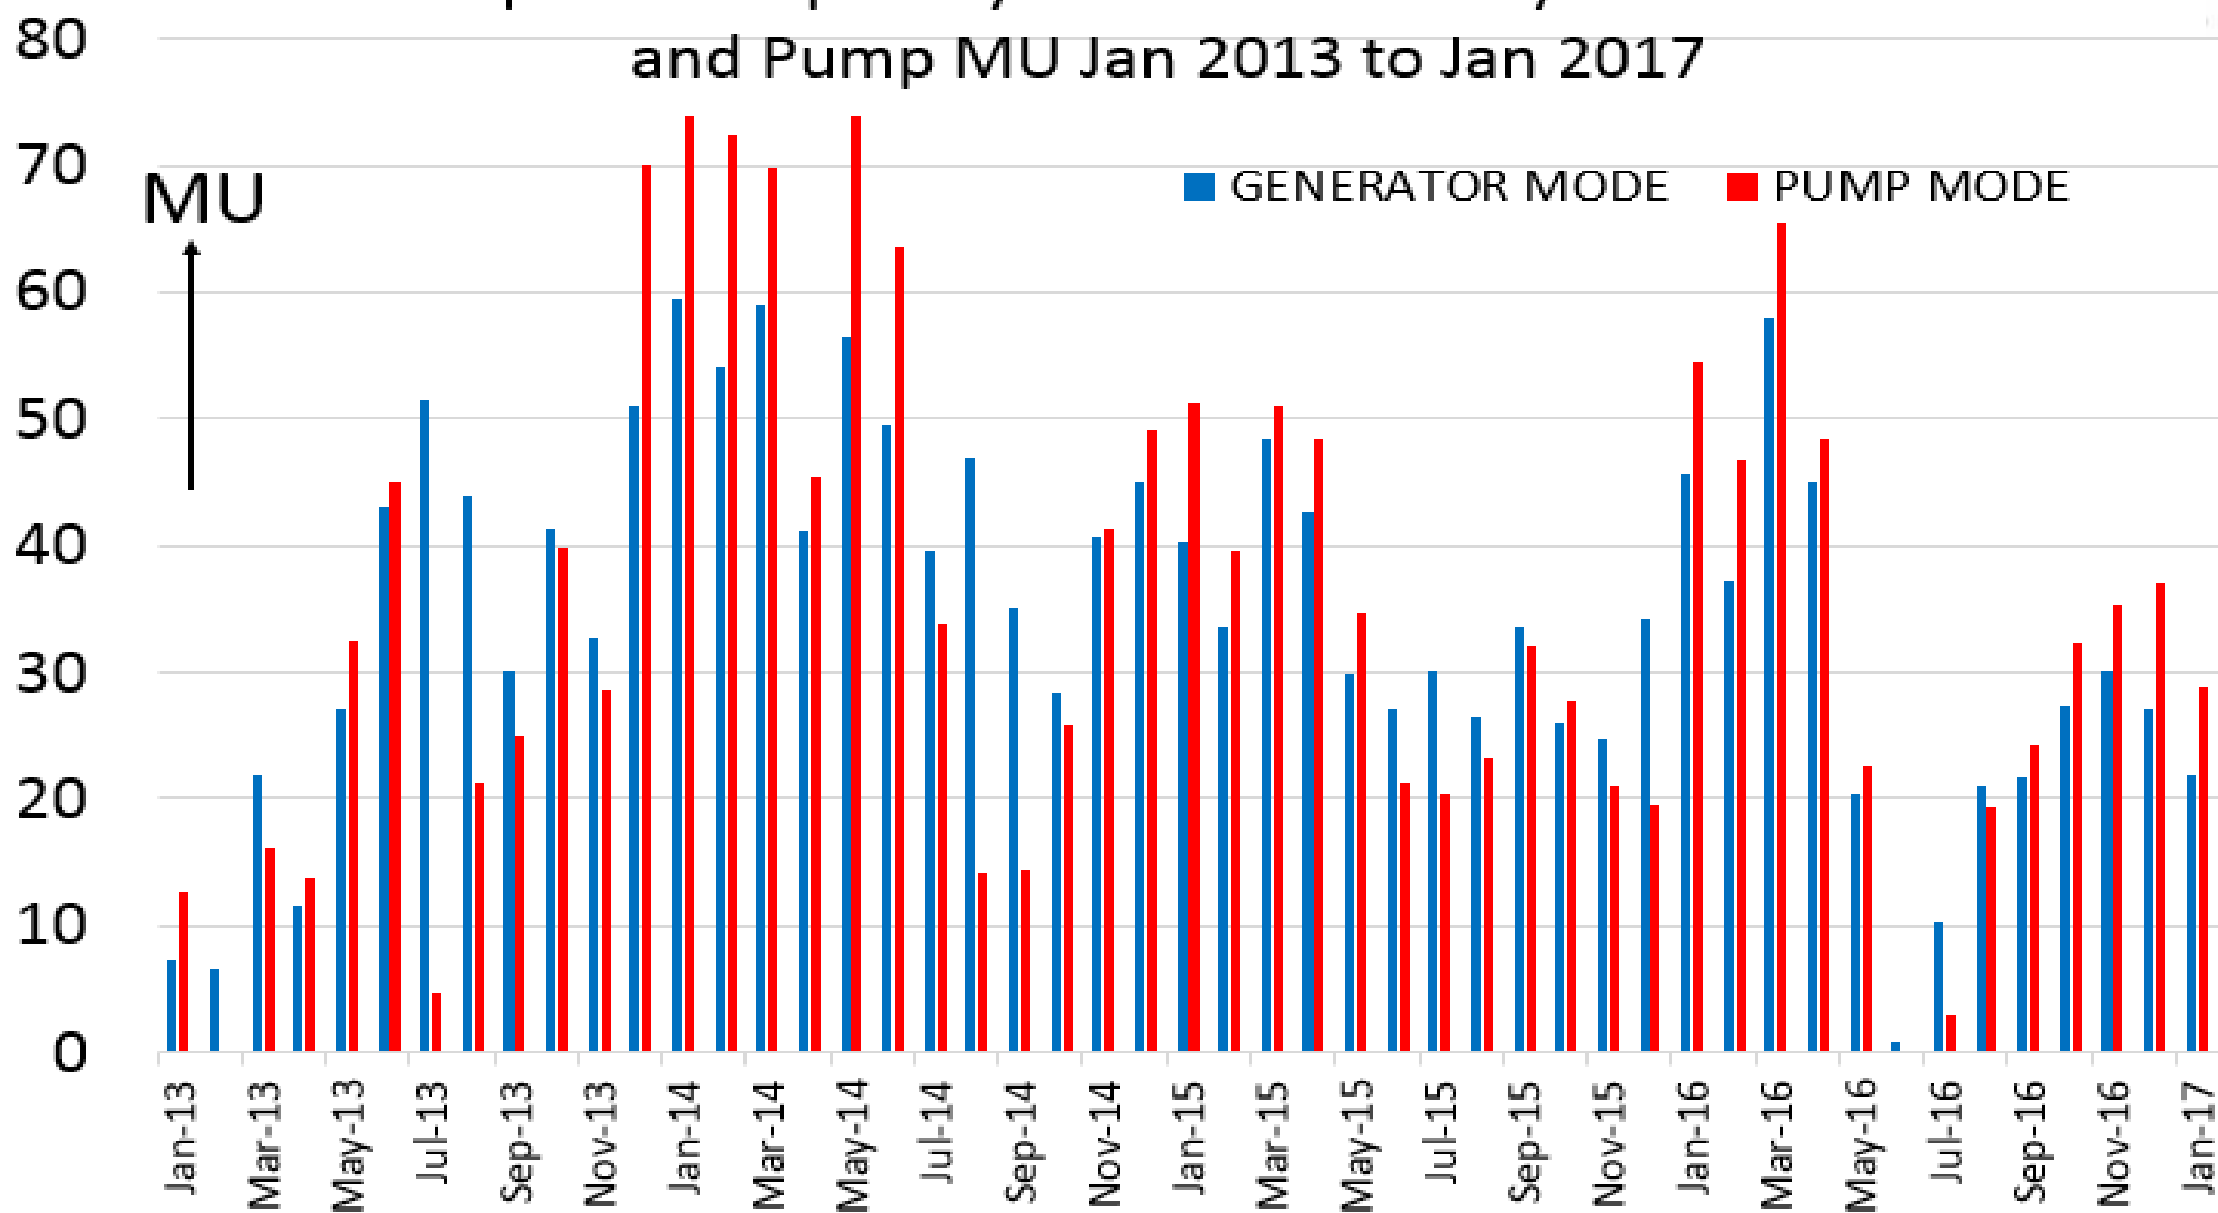


CASE : Kadamparai Generation/Pump during Wind Season

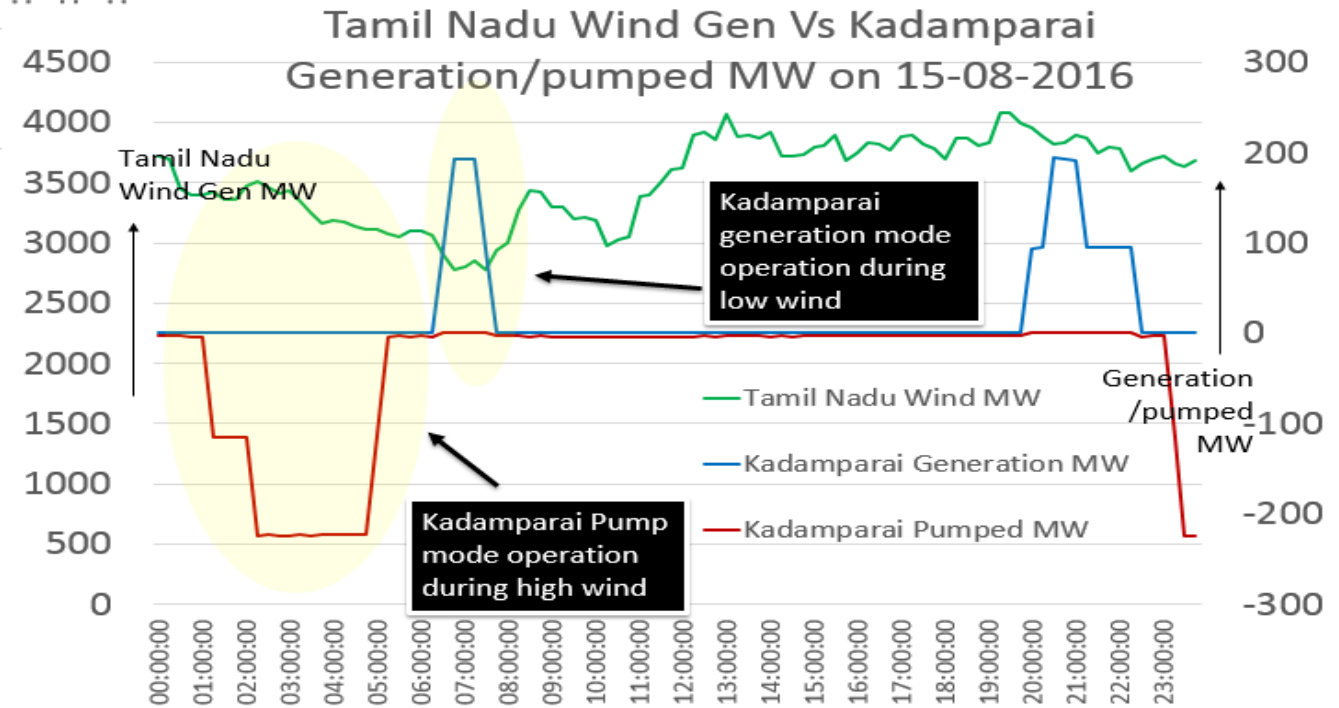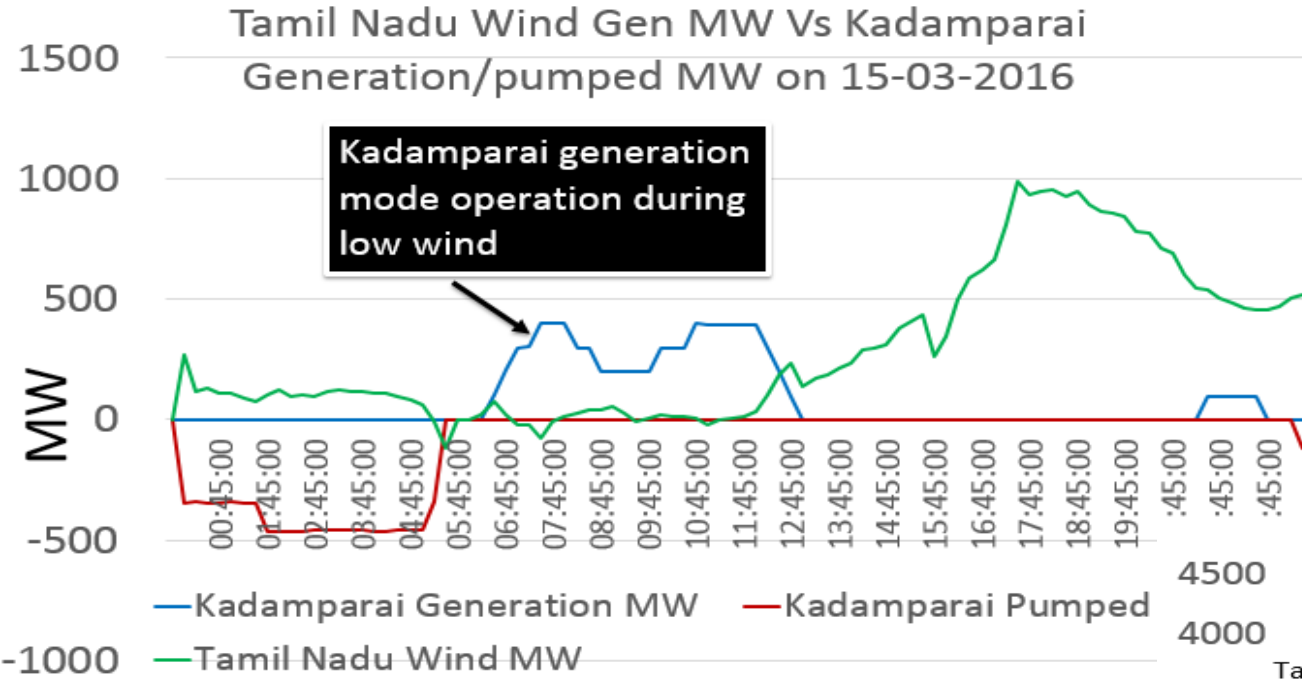


CASE : Kadamparai Generation/Pump and TN Drawl



Tamil Nadu State Drawl MW Vs Kadamparai Generation/pumped MW on 11-05-2016

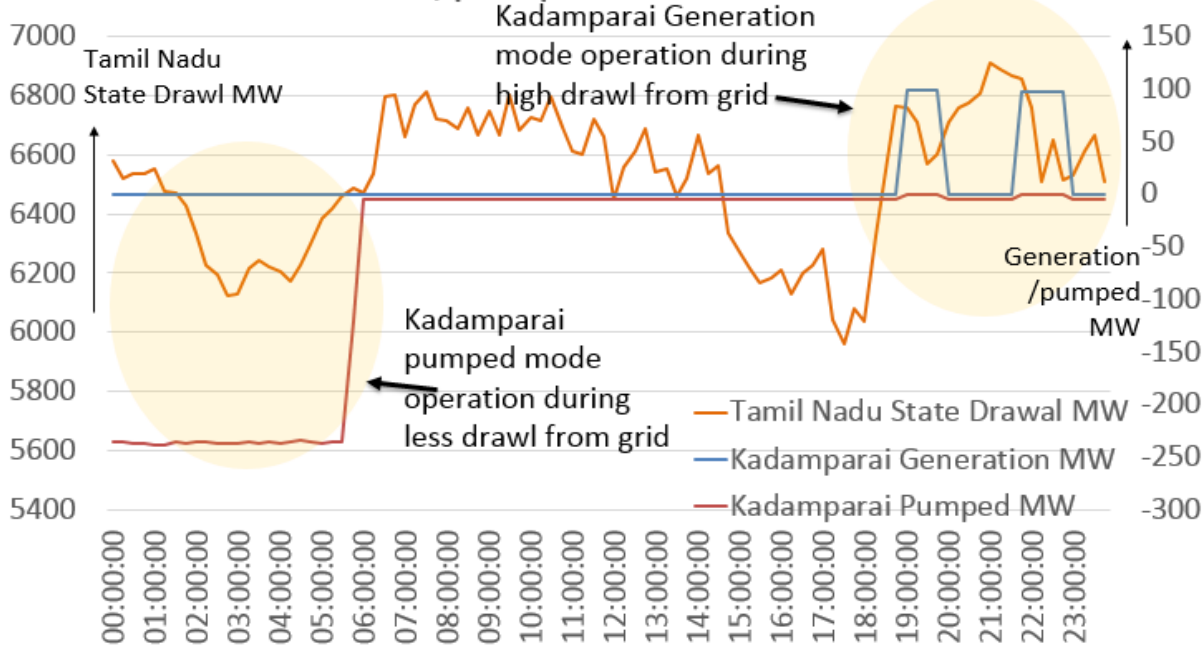


Tamil Nadu State Drawl MW Vs Kadamparai Generation/pumped MW on 11-05-2016

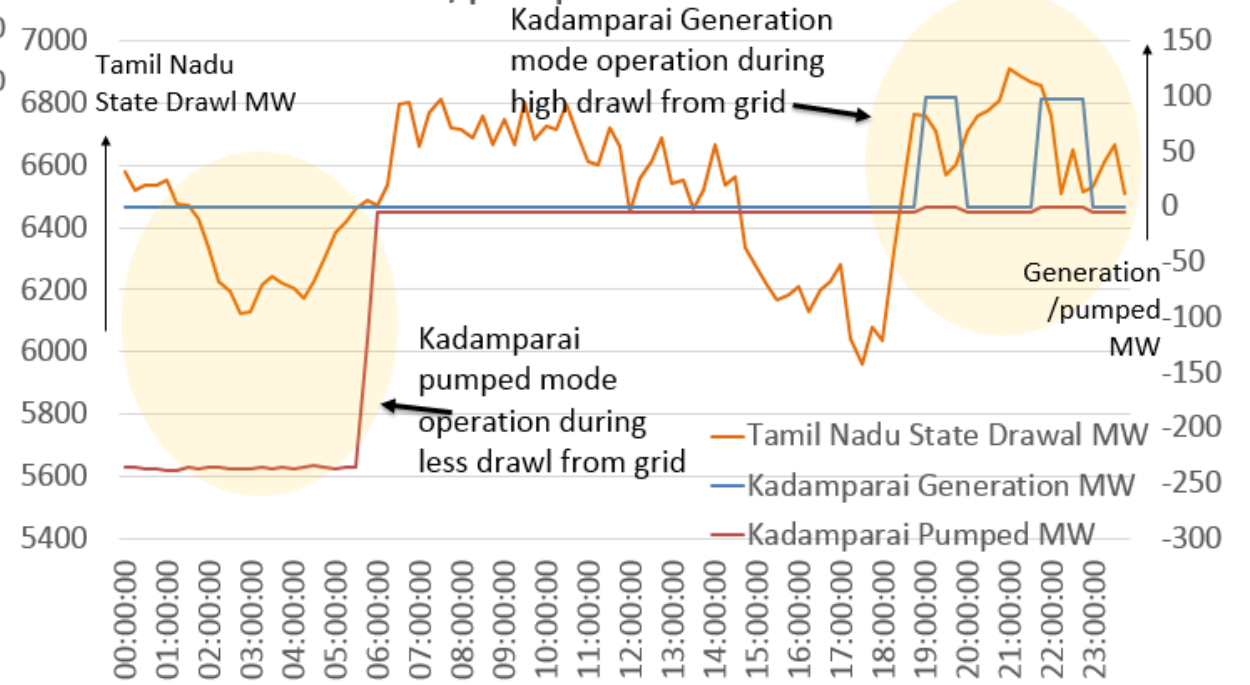


Kadamparai Day Wise Pump and Generation

Operation in no of blocks

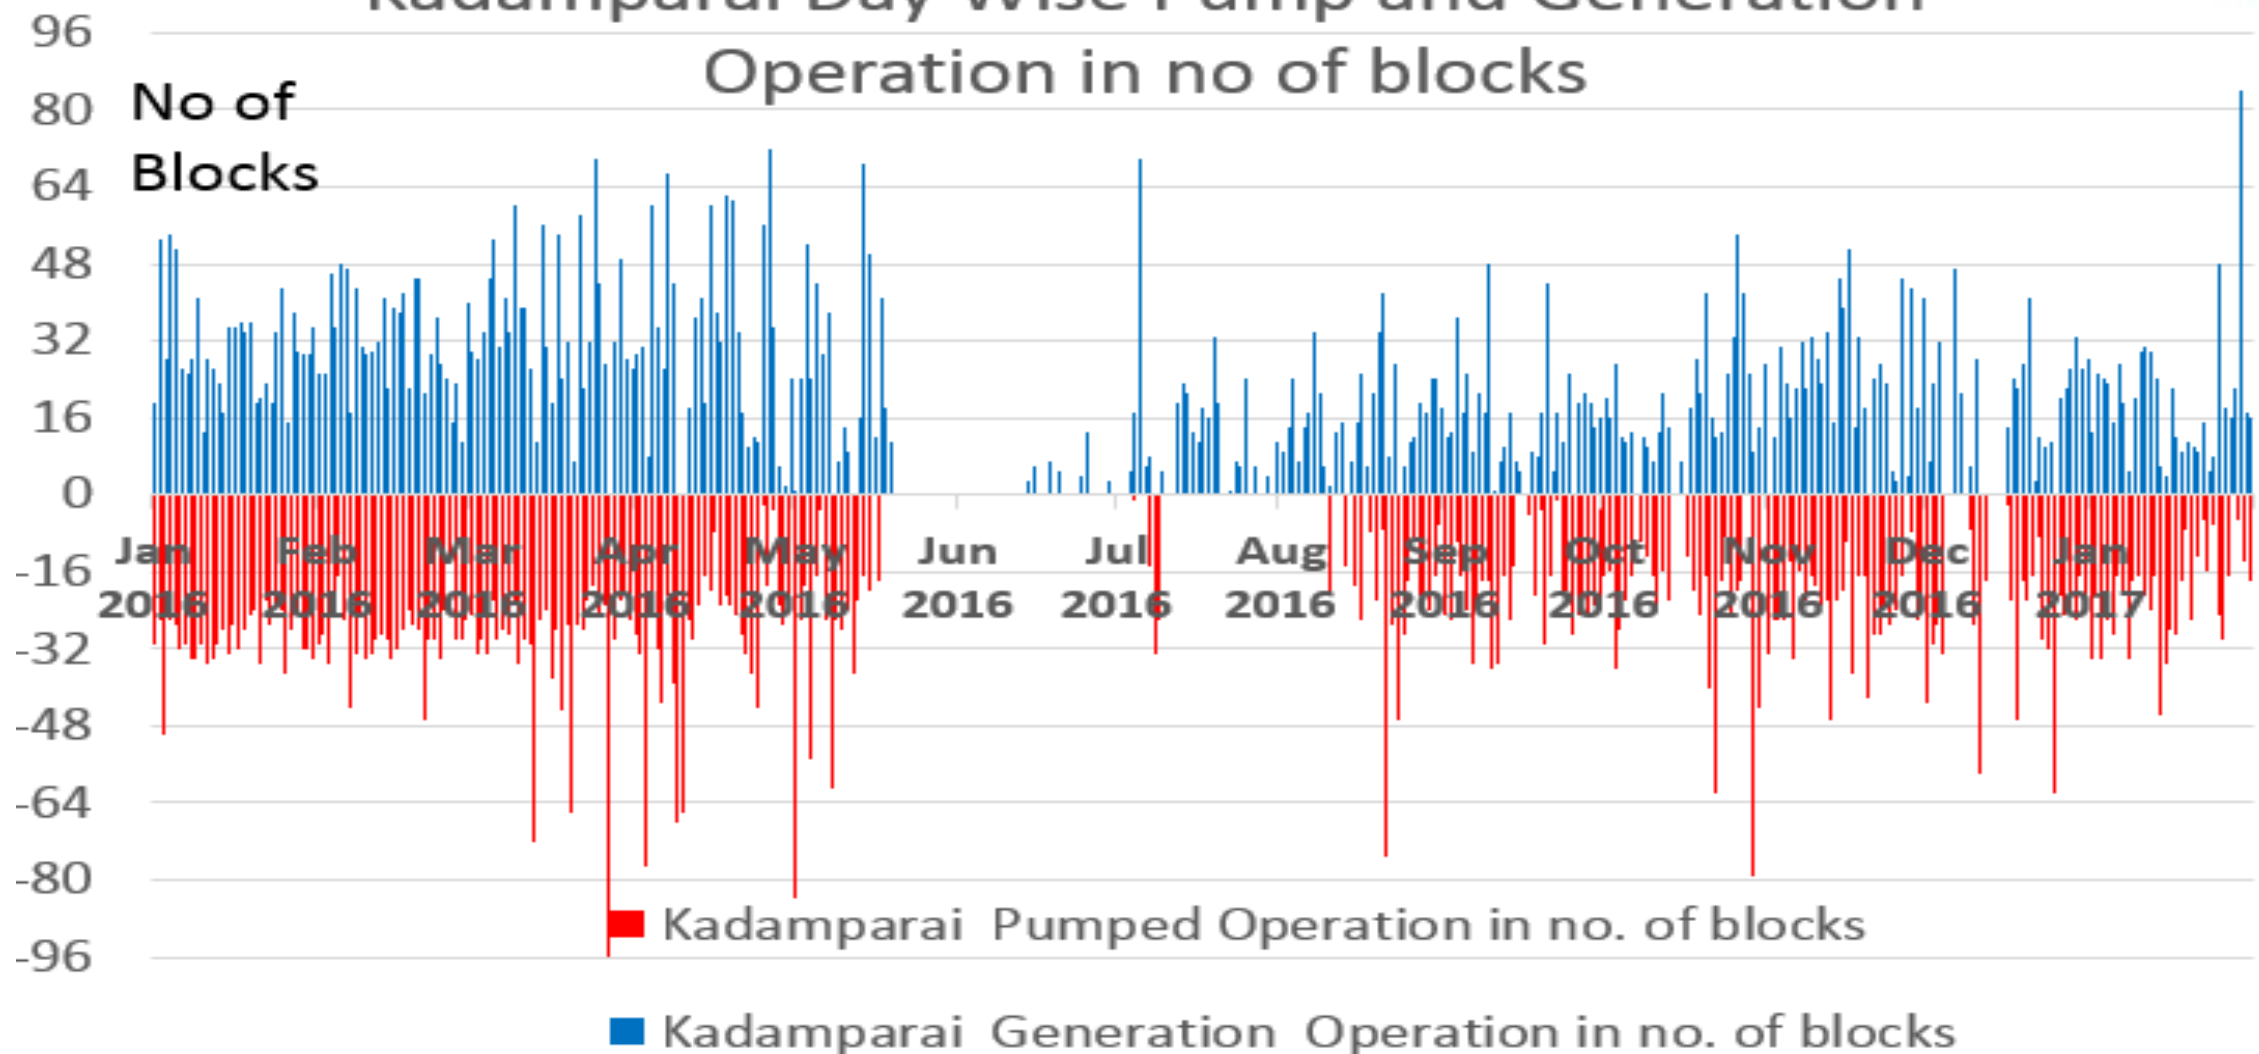

Kadamparai Day Wise Generation and Pumping in MU with Design MU

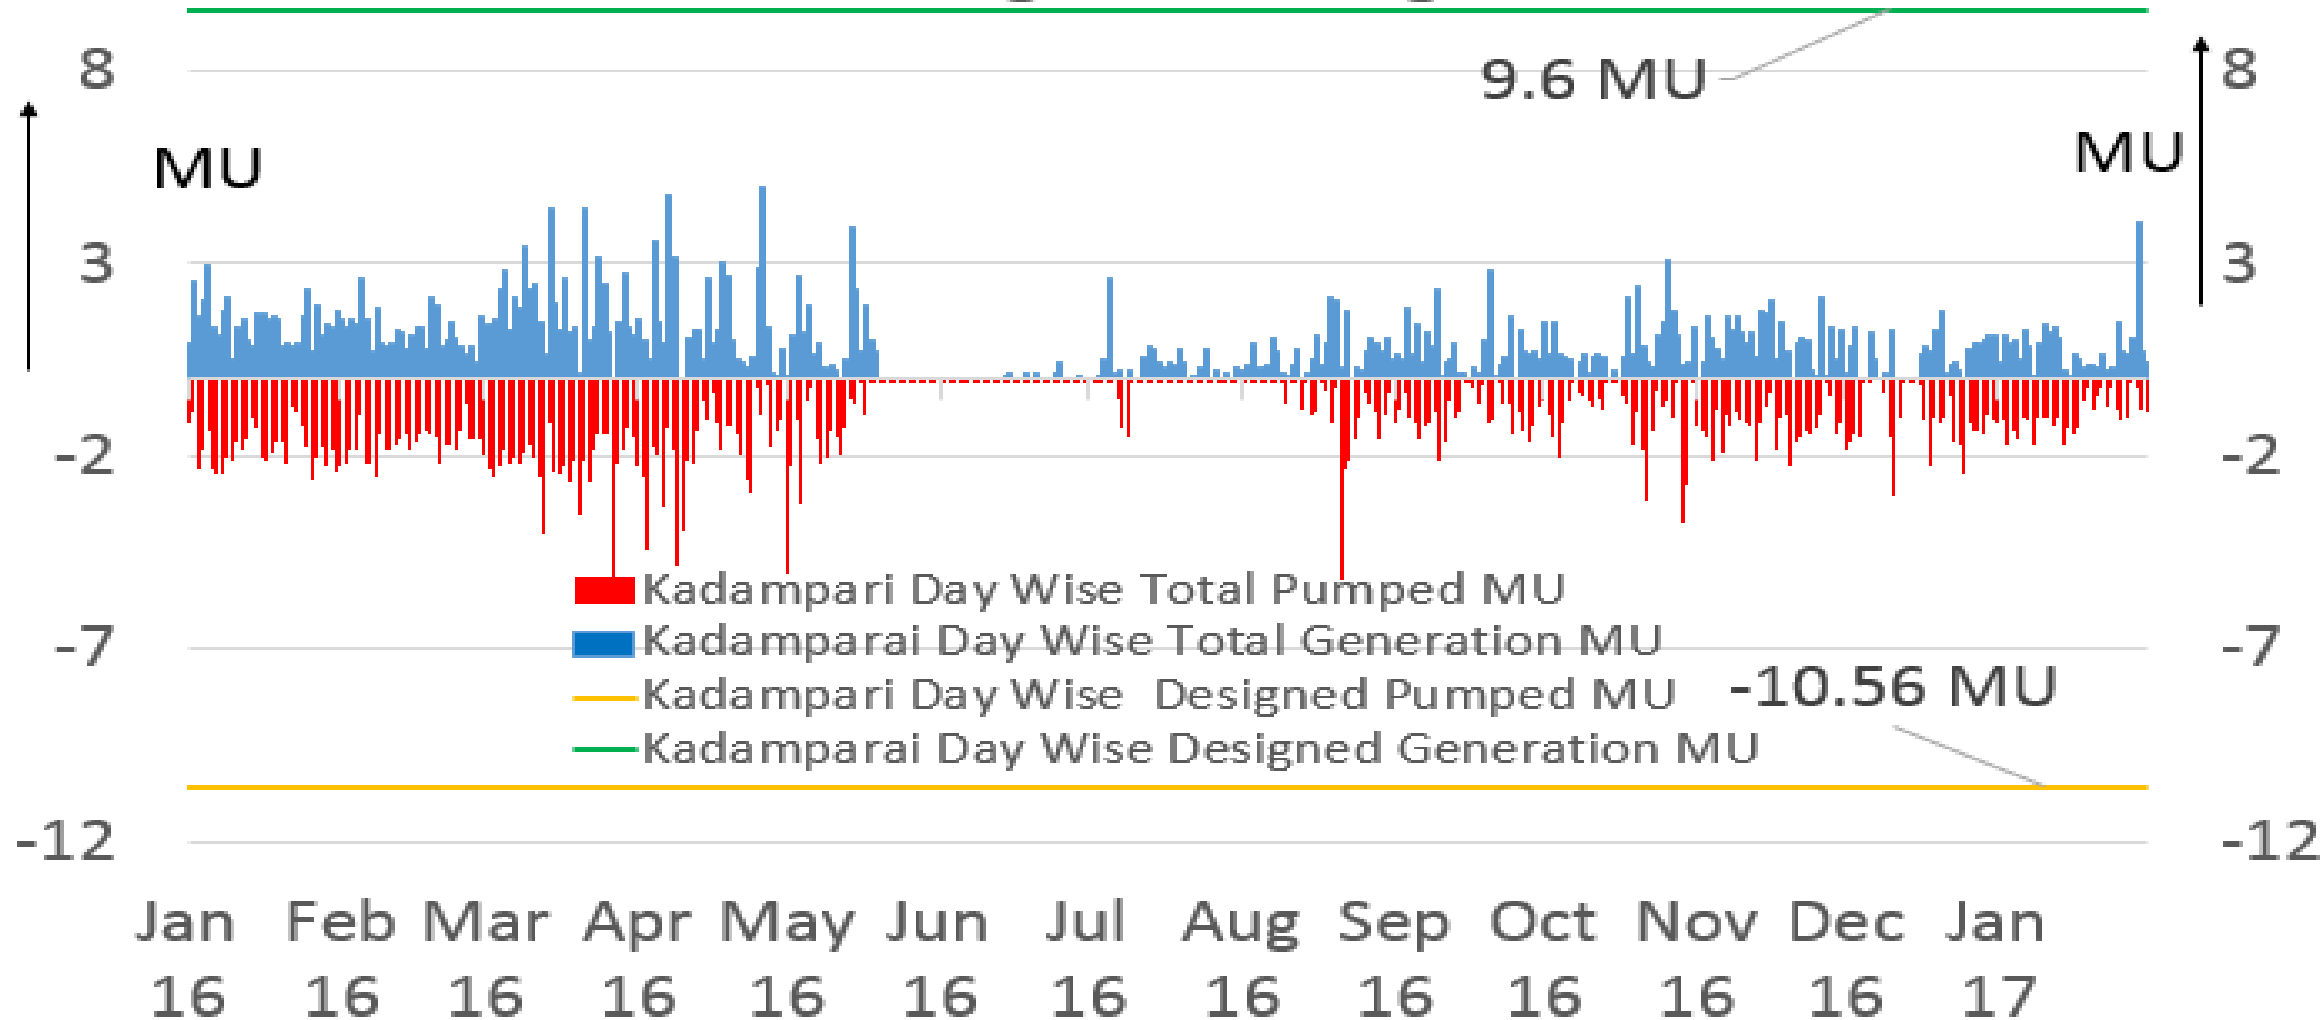

Pump Mode Operationalisation Points to Ponder

SRPC

28.06.2017

(Status update as informed in the Special Meeting convened at Hyderabad on 28.04.2017 to discuss TS-AP issues)

PSPs existing in SR

- **TSTRANSCO:** Nagarjunasagar($1 \times 110 + 7 \times 100.08$) MW
- Pump mode operation possible: $7 \times 100.08 = \mathbf{705.6}$ MW
- **TSTRANSCO:** Srisailam LBPH(6×150) MW
- Pump mode operation possible: $6 \times 150 = \mathbf{900}$ MW
- **TANTRANSCO:** Kadamparai (4×100) MW
- Pump mode operation possible: $(4 \times 100) = \mathbf{400}$ MW

Out of Total Capacity of 2005 MW 1300 MW is operational. (Srisailam and Kadamparai)

1. Pump mode Operation of Nagarjunasagar

- APGENCO had informed that the tail pond reservoir would be handed over to TSGENCO shortly
- APGENCO said there are no lift irrigation pumps to be elevated
- TSGENCO informed that there were certain legal issues (on account of submergence) which were being addressed and likely to be resolved in 4-5 months. TSGENCO said there were two lift irrigation pump schemes which were required to be elevated(will be done after issues on account of submergence are addressed)
- 7 TMC of water is required in the Tail Pond reservoir for pump mode(6 TMC for dead storage + 1 TMC could be used for Pump Mode Op.)
- Unit-I(110 MW) can be used in generation mode. Other 7 units(100.8 MW each) can be used in both generation + pumping modes. It could take around 20 to 30 minutes for pumping operation for each of the unit.

- Units need to be tested in pump mode through their OEM M/s Hitachi
- It was noted that for pumping mode, the level required in Tail Pond Reservoir was higher than the MDDL for 2x25 MW generating station under APGENCO. TSGENCO had suggested that APGENCO station may operate its unit when level is above the level required for pump mode and whenever discharge was there from main Nagarjunasagar Reservoir. Tail Pond Reservoir was constructed for the purpose of pump mode operation which needs to be met. APSLDC/APTRANSCO had stated that generation would be based as per AP's grid requirement/stipulated discharges.
- TSSLDC had stated that the water being pumped back should be at the disposal of TSSLDC

RECOMMENDATIONS

- TSGENCO to address all issues for filling up the Tail Pond Reservoir ie legal issues, elevating the lift irrigation schemes etc. TSGENCO to test the pump mode operation through their OEM M/s Hitachi.
- It was felt that the issue of the discharges (quantum/time duration) / mechanism for enabling pump mode operation/utilization of the water pumped back could be referred to CEA /MoP for further guidance and suitable directions. This would help in utilization of Nagarjunasagar units in pump mode in optimal manner especially with the higher renewable integration.

2. Srisaillam Pumps

- TSGENCO had informed that 540 ft level was required at Nagarjunasagar for pump mode operation at Srisaillam LB. Generally, water is above this level for about 2-3 months in a year.
- On a query, TSGENCO informed that there was a weir after Srisaillam units and before Nagarjunasagar Reservoir which was used for pumping operation. The weir was not operational since last two years. Attempts to repair the weir had not been successful. Issue had been taken up with CEA/CWC also.
- Options were with regard to reconstruction of weir with advanced technology, diversion of water for reconstruction, relocation etc. Since, project was capital intensive assistance from PSDF could be sought. It could take 2 years once the project is approved.
- TSSLDC stated that the water being pumped back should be at the disposal of TSSLDC.

RECOMMENDATIONS

- It was felt that the issue of weir could be taken up with CEA /MoP for further advice/guidance/funding. Though it could take 2-3 years for completion but in perspective plan with high targets of renewables, this would be useful in pump mode operation at Srisaillam and balancing of RE.
- It was felt that issue regarding discharges (quantum/time duration) / mechanism for enabling pump mode operation/utilization of the water pumped back could be referred to CEA /MoP for further guidance and suitable directions. This would help in utilization of Srisaillam units in pump mode in optimal manner especially with the higher renewable integration.

3. Kadamparai Pump mode Operation

- 3 out of 4 pumps are available for operation
- Commercial framework and an incentive scheme is to be designed – for Regional balancing
- TANTRANSCO stated that the issue was under examination and they may come up with some proposal

PROPOSAL/STUDIES FOR PUMPED STORAGE OPERATION

ANDHRA PRADESH

- AP is preparing DPR for Pumped Storage Scheme at Upper Sileru(New Scheme). DPR 1000 MW is at finalisation stage.

KPCL

- KPCL has placed LOA no. LOT/PSP/Sharavathy/3230 dated 06.01.2017 on M/s WAPCOS Ltd for preparation of detailed project report on Sharavathy Pumped Storage Scheme. As a part of the assignment, M/s WAPCOS has submitted the Draft PFR on 05.05.2017 wherein an installed capacity of 2000 MW has been proposed. Draft PFR has been submitted to MoEF for first stage clearance of ToR and for obtaining prior Environmental clearance for conducting CEIA study on 14.06.2017.
- The PFR for Varahi Pumped storage scheme is being prepared by KPCL. Topographical survey has been done across Varahi River on the downstream of tailrace. PFR is under preparation for Varahi Pumped Storage scheme.

KSEB

- Feasibility studies are under progress attached to Idukki and Pallivasal Generating Stations. At Idukki preliminary study is for around 750 MW

TAMIL NADU

- For MW approached for Environmental Clearance


Kadampai Pumped Storage Scheme
by
SLDC, Chennai

welcome to kadamparai pumped storage




cavern view



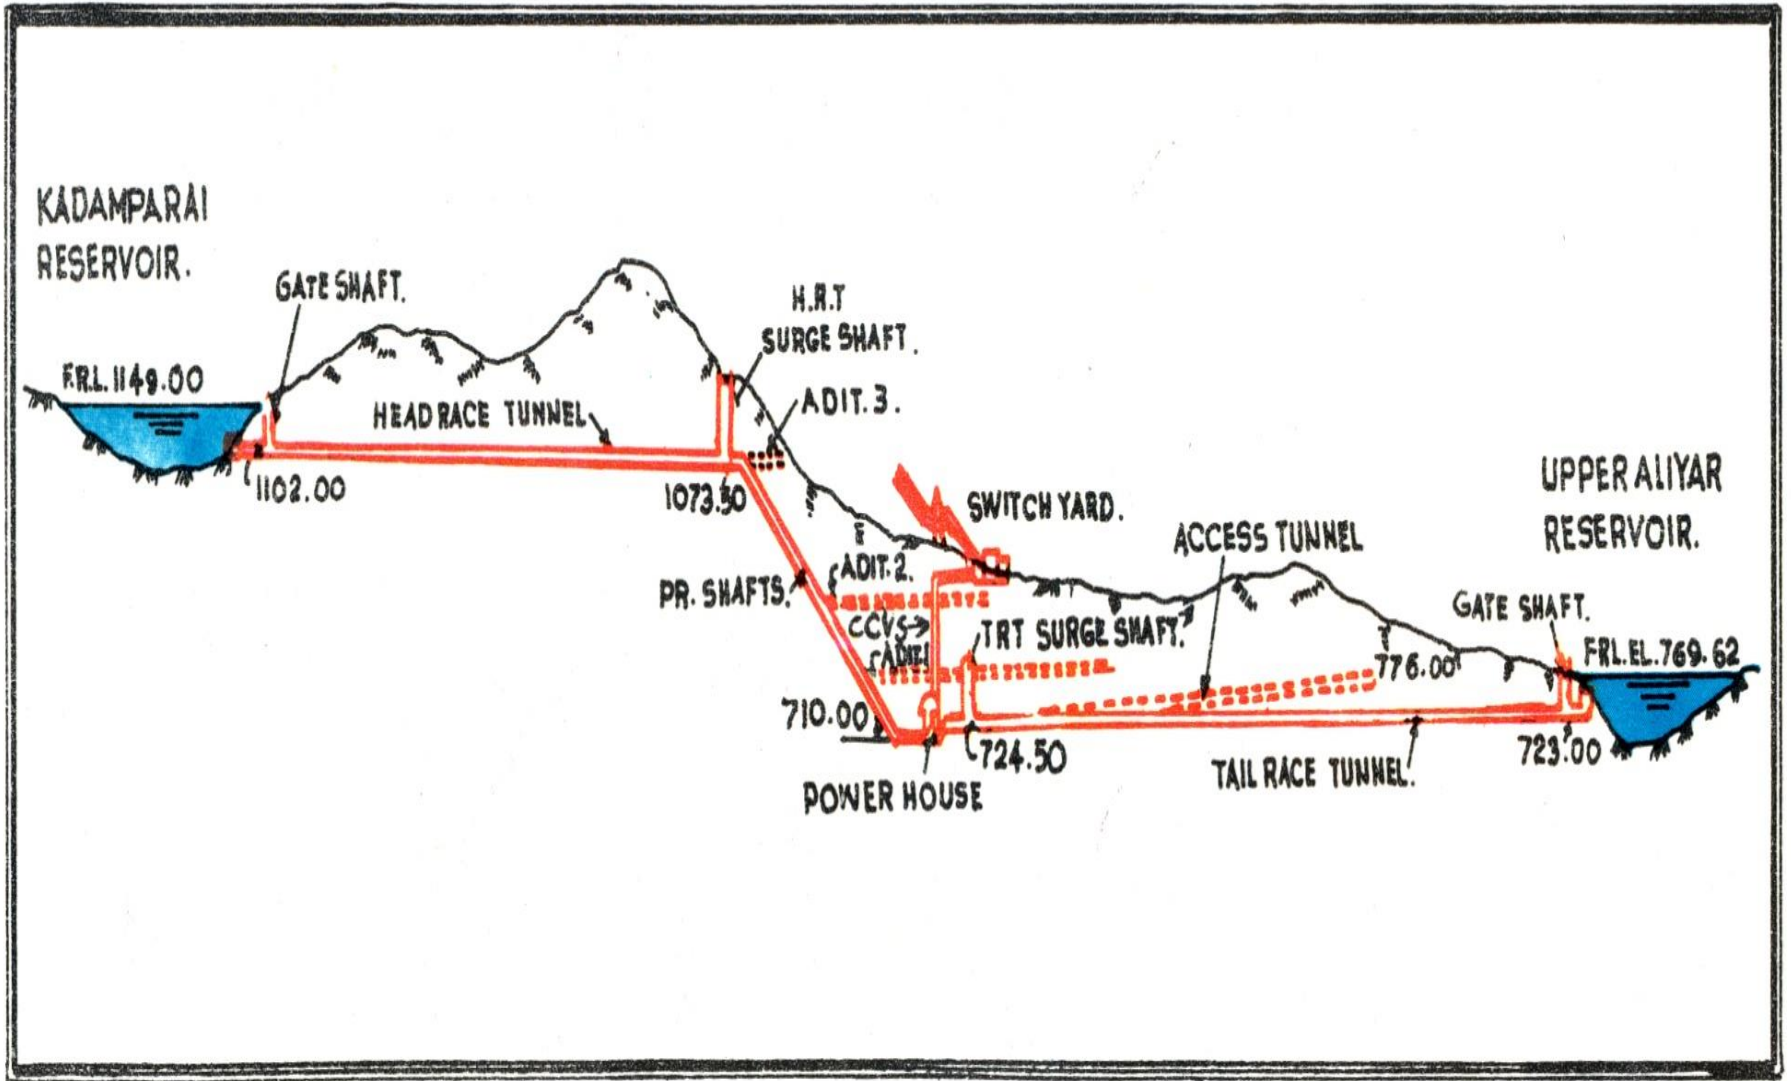

KADAMPARAI TO UPPER ALIYAR RESERVOIR — PROFILE

3D view of pumped storage

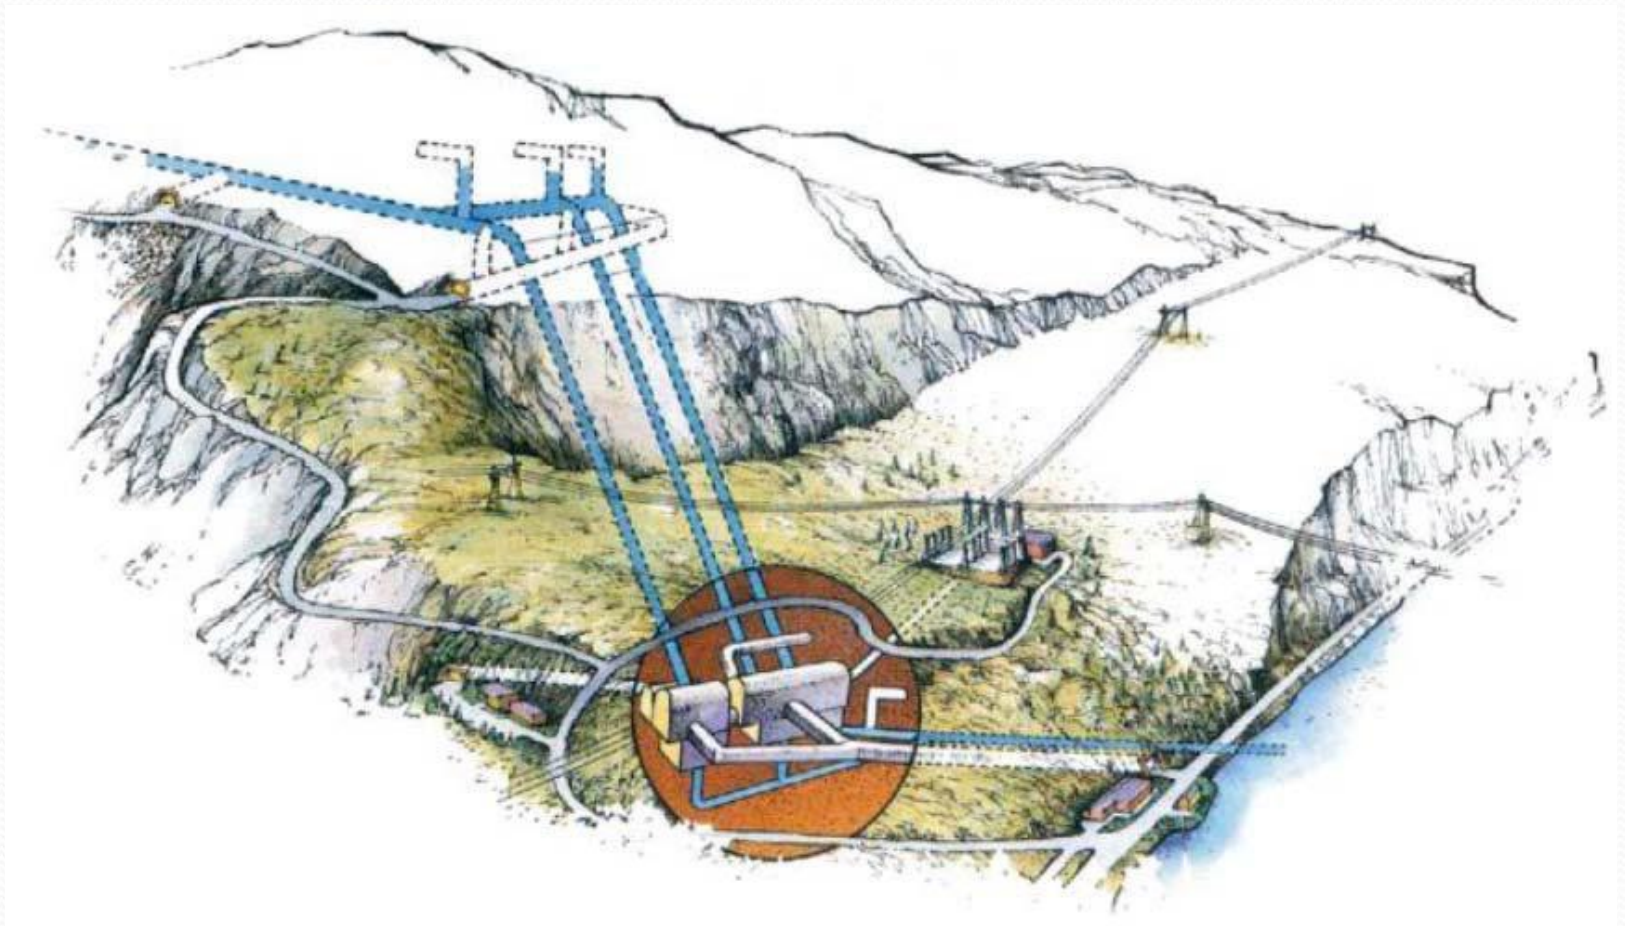

kadamparai - "A boon for power availability in the southern grid".



view of outdoor end termination after erection.



Kadamparai pumped storage.

- In the Kadamparai Power House (capacity 4x100 MW), the water for power generation is taken from Kadamparai Dam and delivered to Upper Aliyar Dam.
- During non peak hour, the water in Upper Aliyar Dam is pumped to Kadamparai dam by pumping operation.

POWERHOUSE Commissioning Particulars

Number & Capacity of the Machine	4 X 100 MW
Date of commissioning of Units	1) 17.10.1987
	2) 26.02.1988
	3) 12.04.1989
	4) 16.12.1988

Turbine Operating Parameters

Make of Generator / Turbine	
	UNIT 1 GEC BOVING UNITED KINGDOM
	UNIT 2,3&4 BHEL INDIA
Type of Turbine	Francis Reaction Reversible
HEAD for each Power House	
a)Maximum	1) 395 mts (GENERATOR MODE) 2) 413 mts (PUMP MODE)
b)Minimum	1) 323 mts (GENERATOR MODE) 2) 341 mts (PUMP MODE)
Speed of Machine	500 rpm

Generation Capacity of one UNIT

Generation Details	Generation in Lakh Unit	Water discharge in Mcft
Per Unit /Hour Generation @full load (100 MW)	1 Lakh Units	3.7 Mcft
All the four Units run between 18.00 Hrs to 22.00 Hrs (i.e. 04 Hours)	16.00 L.U	59.2 Mcft.
Equivalent water Pumped Details	Consumption in Lakh Unit	Water Stored
Per Unit/ hour consumption and water stored	1.1 Lakh Units.	3.00 Mcft
If four Units are run as PUMP mode the time required for the above discharge (59.2 Mcft) Pump Running Hours 05 Hrs	22 L.U.	59.2 Mcft

Kadamparai Dam Particulars (Upper Reservoir)

Height of dam in Ft.	221.45
FRL in Ft.	3770
Storage in Mcft.	1089
MDDL in feet	3648
Dead storage in Mcft	140.57

Upper Aliyar Dam (Bottom Reservoir) Particulars

Height of the Dam	265
Full Reservoir level in feet	2525
Storage in MCft	937.89
Dead Storage in MCft	23.1

Minimum Draw Down Level for pump operation at 2445 feet and dead storage is 209 Mcft at Upper Aliyar Dam

Grid frequency prior to 2002

- Grid was operated at lower frequency (i.e between 48.5Hz & 49.0Hz) for more times till 2002 and less surplus power was available during off peak time.
- Surplus power was available in the grid during National holidays,& on Sundays by which time two or three units were utilized as pump at Kadamparai.

Frequency limitation for pump operation at Kadamparai.

- Frequency for pump operation at Kadamparai is designed between 49.5Hz and 50.5Hz .
- The motor input required is about 110 MW at rated speed.
- If all the four units are operated as pump, then the power input required at station end is about 440 MW.
- First time, on 12-02-2003 only, all the four units were put on pump mode though the station was commissioned in 1989.

Pump performance-contd

2010-11	--	612 MU
2011-12	--	532 MU
2012-13	--	335 MU
2013-14	--	493 MU
2014-15	--	511 MU
2015-16	--	414 MU
2016-17	--	330 MU
2017-18	--	9 MU only (upto 26.06.17)

The present status of Kadamparai PSS as a Spinning Reserve

- Due to failure of monsoon in the year 2016-17 and the monsoon has not set in 2017-18 which leads to very poor storage in Kadamparai Dam i.e. only 158 Mcft excluding silt level.
- With this Alarming present level, Kadamparai PSS can not be used as generating mode. During sudden withdrawal of wind, this 400 MW of generation can not be utilized due to acute storage. Hence Kadamparai can not be used as a spinning reserve.

Contd

- Due to failure of monsoon in the year 2016-17 and the monsoon has not set in 2017-18 which leads to very poor storage in Upper Aliyar am i.e. only 125 Mcft excluding silt.
- With this Alarming present level, Kadamparai PSS can not be used as Pump mode. During this high wind season, the Kadamparai cannot be put into pump mode operation which draws consumption from 110 MW to 440 MW from the grid.
- This leads to difficulty in absorption of RE power to the quantum of 440 MW during this wind season.

Role of Hydro Power Generating sources in balancing power requirement due to high RE generation

- The Hydro generation:
- 2006-07 : 6292 MU
- 2007-08 : 6455 MU
- 2008-09 : 5386 MU
- 2009-10 : 5640 MU
- 2010-11 : 5105 MU
- 2011-12 : 5354 MU
- 2012-13 : 2905 MU
- 2013-14 : 5085 MU
- 2014-15 : 5186 MU
- 2015-16 : 4633 MU
- 2016-17 : 2505 MU

Contd...

- The present nett storage in pykara and kundha group is 2400 mcft only against the nett storage of 16600 mcft which is corresponding to 14% only.
- Since Tamil Nadu is deprived of hydro potential very much, role of hydro power generating sources in balancing power requirement in view of the increased generation from renewable energy sources is very much deplete.
- Tamil Nadu has to judiciously operate the hydro generation to meet out the summer demand till the onset of next monsoon.

Conclusion

- Because of less hydro storage due to failure of monsoon, the cheapest hydro sources are used as peaking station only to meet out the Tamil Nadu grid demand judiciously.



- Thank You

KADANA HYDRO ELECTRIC PROJECT

GUJRAT STATE ELECTRICITY COPRORATION LIMITED



CAPACITY : 4x60MW

COMMISSOINING DATE OF UNIT NO. 1,2,3 &4

Unit No.	Date Of Commissioning	Make
Unit No. 1	31/01/1990	CKD Blansko
Unit no. 2	28/08/1990	CKD Blansko
Unit no . 3	02/01/1998	BHEL (CKD Blansko)
Unit No. 4	08/07/1998	BHEL (CKD Blansko)

KADANA HYDRO POWER STATION

Sr. No.	Description	Date
1	Kadana HPS commissioned[4x60 MW]	1991-98
2	Machines operated in generation mode only	1991-2004
3	Trial for pump mode operation taken	2004
4	Pump mode operation machine Hrs.130 [7.955MUs]	2004-05
5	Pump mode operation machine Hrs.34 [2.112 MUs]	2005-06

OBSERVATION DURING PUMP MODE

- ▶ KHEP has initiated to put one by one unit into pump mode operation as demanded/requirement by CEA/SLDC. Previously in year 2004-05 unit were run into pump mode but machine was not operated smoothly.
- ▶ **During operation of PMO following observation noticed.**
 1. High eddy current drawn in reactor.
 2. Frequent rotor earth fault observed resulting puncture of slip ring insulated bolts.
 3. Vibration observed at the dam and penstock area.
 4. Rise of TGB temperature and machine vibration.

OPERATION STATUS OF UNIT NO.1,2,3 &4 ON PUMP MODE

Sr No	Description	Unit				Remarks
		1	2	3	4	
1	First Trial Date	10.03.04	02.03.04	12.03.04	07.03.04	
2	Last Trial Date	16.06.04	11.06.04	06.06.04	06.06.04	
3	No of Trials					
	(a) less than 1 Hr	9	10	14	17	
	(b) between 1 hr & 3 hrs	11	1	1	6	
	(c) More than 3 hrs	NIL	1	NIL	1	
4	Max Running hours achieved in a trial	0.55 hrs on 15.06.04	4.55 hrs on 05.04.04	01.34 hrs on 06.04.04	4.3 hrs on 04.04.04	
5	Up to date running of machine on trial basis	05.39 hrs	08.44 hrs	03.10 hrs	17.58 hrs	
	(a) Step by Step local (Manual)	9	10	14	17	
	(b) Step by Step from Control Room (UCR)	Nil	2	1	3	
	(c) C/R Auto	Nil	Nil	Nil	Nil	Not desirable
6	Major Observations / Problems	Maximum Vibrations (Horizontal) at turbine guide bearing & temperature: 4.32 Microns, Max temperature less than 40 ^o C	Maximum Vibrations (Horizontal) at turbine guide bearing & temperature: 8.44 Microns, Max temperature less than 60 ^o C	Maximum Vibrations (Horizontal) at turbine guide bearing & temperature: 44.7 Microns, Max temperature less than 69.4 ^o C	Maximum Vibrations (Horizontal) at turbine guide bearing & temperature: 18.4 Microns, Max temperature less than 66.2 ^o C	Temperature setting has been increased by BHEL up to 72 ^o C (Minutes for increasing in setting of temp is drawn on date 12.06.04). BHEL has recommended max vibrations at bearing (horizontal) 50 Microns

Effort for the restoration of pump mode operation .

- Meeting held on Dt: 6/08/2015 with M/s BHEL at Bhopal regarding feasibility of pump mode operation of KHEP units . The detail discussed regarding problem faced during pump mode trial of KHEP unit during 2005 .

Conclusion of Meeting :

- M/s BHEL Bhopal opinion that the looking to the past record machines should not be operated in pump mode operation.
- As per requirement of SLDC letter dtd. 9/10/2015 ,KHEP again asked to M/s. BHEL and OEM M/s CKD Balnsko or the budgetary offer for the pump mode operation of KHEP units.
- M/s CKD Blansko had visited during march 2016 and submitted their proposal During may 2016 for the refurbishment and up gradation of unit no 1 for the pump mode operation at the cost of Rs:63.69 croers .

- KHEP is also requested to M/s Voith Hydro Noida to submit budgetary offer for to operate KHEP units on PMO vide Email Dt: 23/1/2017. In response M/s Voith Hydro Noida had visited KHEP site on Dt:13/14/2/2017. study in detail. Brief presentation displayed at CO on Dt :15/2/2017 and assured that they will submit their offer in short and KHEP are awaiting offer from M/s Voith.
- Also ,KHEP requested to M/s BHEL Bhopal to visit CO for the discussion on the feasibility of pump mode operation of KHEP. M/s BHEL Bhopal had visited CO on Dt: 12/4/2017 and discussed regarding past issue during PMO of KHEP units. M/s BHEL had suggested to carried ABC of units and run unit on generation mode. The data of generation mode to be collected and after analysis of generation mode operational data M/S BHEL will suggest about the feasibility of KHEP units on PMO.
- For ABC analysis checking the healthiness turbine for pump mode operation the principal approval received from C.O and tender under progress.
- Moreover, OEM M/s CKD Balnsko had plan to visit KHEP during 11/7/2017 to 20/7/2017 for the Pump mode operation of KHEP units.
- During visit of expert team of CKD Balsnko the BHEL and member of (Hydro) / CE(HEPR) remains present it was discussion and decided during the review meeting of committee was held 18/05/2017 at NPMC hall 2nd Floor Sharm Shakti Bhavan New Delhi.


Thank You



Operation of Ghatghar, Paithan & Bhira Hydro Pumped Storage Plants in Maharashtra

Presentation by
State Load Despatch Centre, Airoli
28th June-2017

Ghatghar Layout

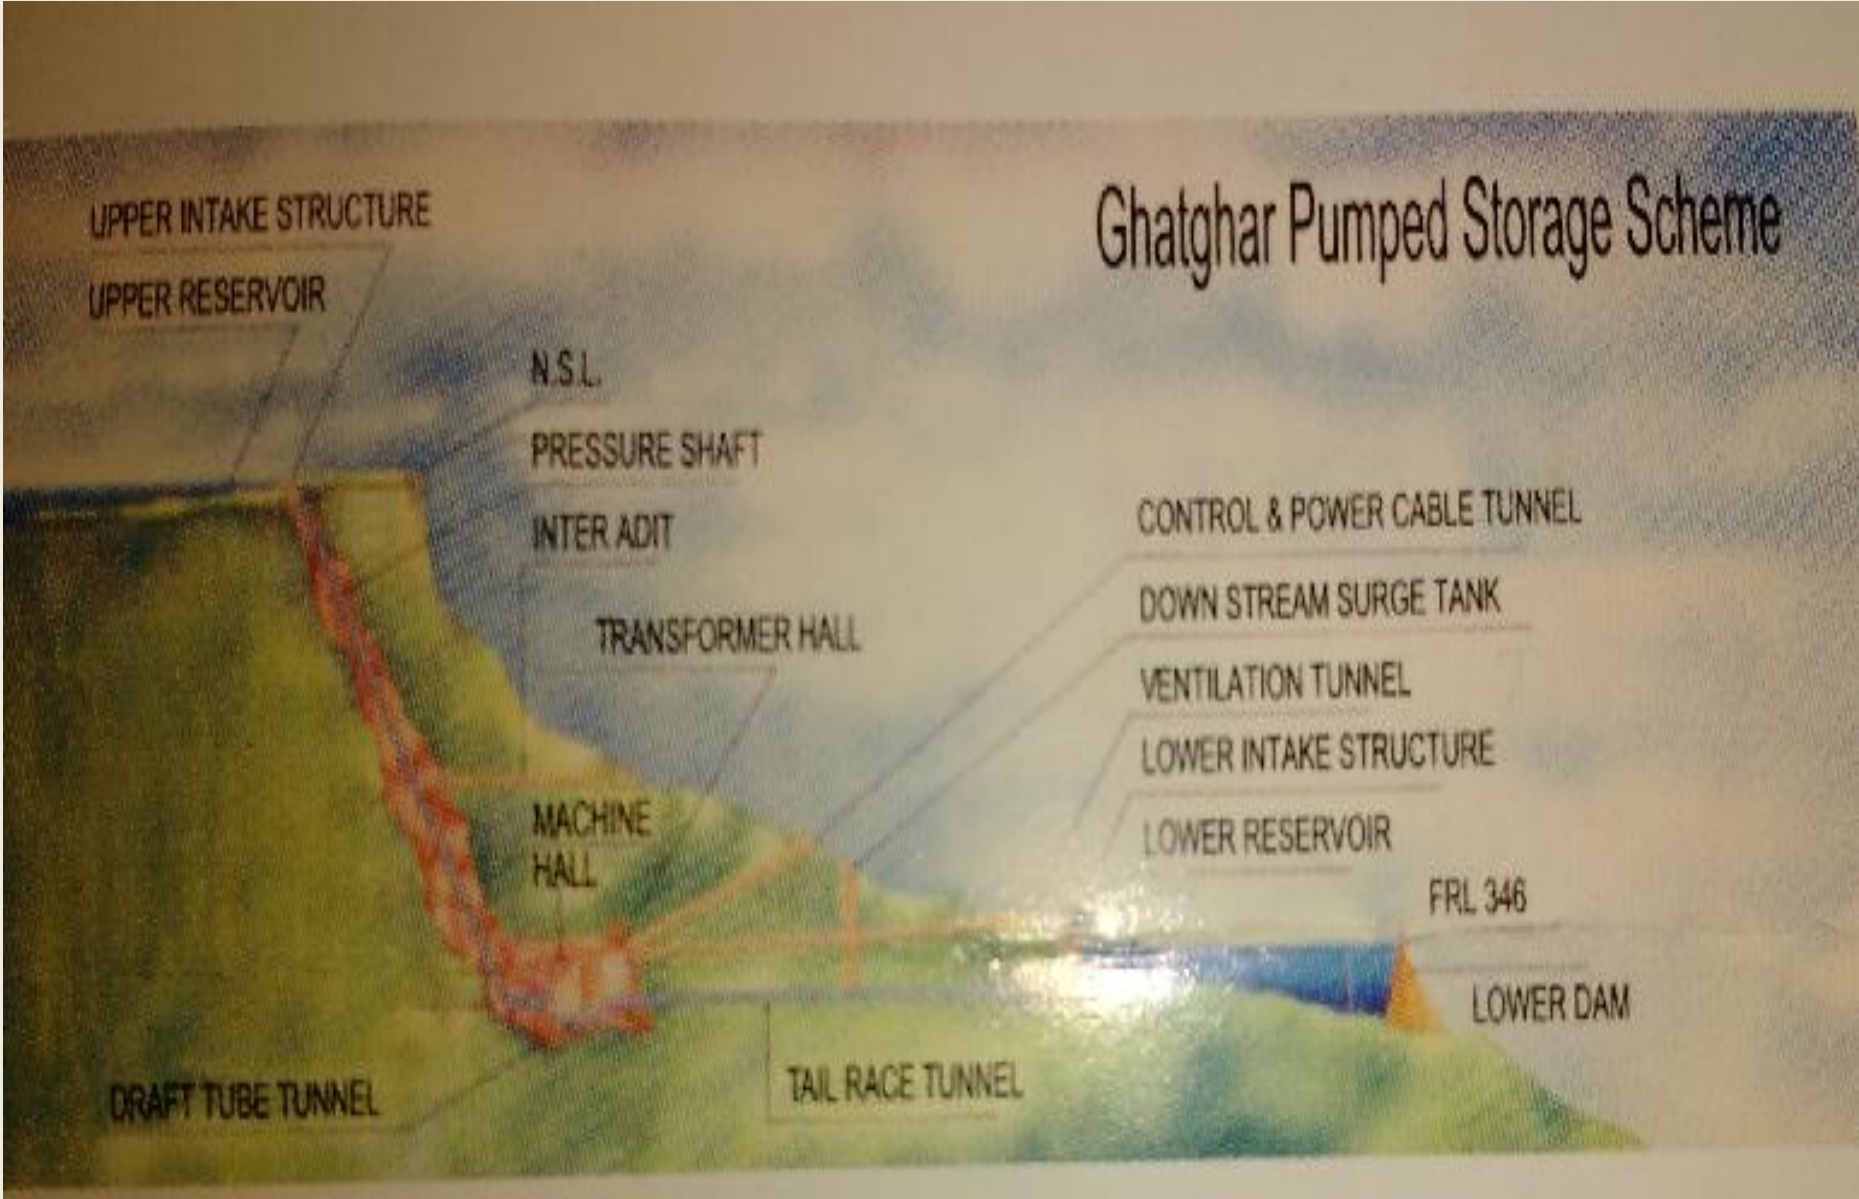

Ghatghar Pump Storage Operation

- **A. Plant details:-**
- Unit 1 (125MW) Commissioned on 08.04.2008
- Unit 2 (125MW) Commissioned on 21.06.2008

- 1) Capacity : 2 units (250 MW) Reversible Francis Turbine Pumps & Generator
- 2) Rated Head : 410 m (Generation Mode) & 430 m (Pumping Mode)
- 3) Rated Discharge 37.40 m³/sec
- 4) Daily hours of Generation : 6 hours
- 5) Daily hours of Pumping : 7 hours.
- 6) Max yearly generation possible : 469.5 Mus
(Running 2X125MW , Daily 6 hrs for 313 day for year)
- 7) Max yearly energy required for pumping : 645.372 Mus.
- 8) Power House Type : Under Ground
- 9) Black start facility : 2 x 1250 KVA, 11 KV Diesel Generating sets.
- 10) Generator speed:- 500 R.P.M.

B. Hydrology	Upper Dam	Lower Dam
District	Ahemadnagar	Thane
River	Pravara	Shai Nalla
Catchment Area Storage	18.43 sq. km.	2.50 sq. km
Dead Storage	0.66 mm ³	0.08 mm ³
Live Storage	6.05 mm ³	3.57 mm ³
MDDL	750.25 m	310.00 m
MWL	756.25 m	347.00 m

C. Grid connectivity:-

- Bus configuration : 1 main + 1 Auxiliary Bus
- Lines connected
- 220 KV Ghatghar-Nasik
- 220 KV Ghatghar-Bapgaon-Kalwa
- 220 KV Ghatghar-Vashala-Raymond-Nasik
- 220 KV Ghatghar-Jindal steel- Padghe

D.Black start Facility:-

- Both units can be black started with help of DG sets in case of Black out.



E . Day-to-Day routine operation.

1.) Generation mode operation in the following conditions

- Morning peak hours and Evening peak hours (2 x 125 MW) or whenever required
- To reduce over drawl from central grid at low frequency.
- Units are available within 15 min from giving instruction
- Once taken as generator unit is operated for minimum 1 hour.
- Injection supporting to Nasik and Padghe Bus.

2.) Pumping mode operation in the following conditions

- Generally during night off peak hours or between reduction of day demand and before evening peak
- The pumping demand is 2X150 MW
- Pumping operation to reduce under drawl from Central grid at high frequency.
- Pumping /generation mode is also taken for controlling network loading in adjacent area.
- Once taken as Pump unit is operated for minimum 1 hour

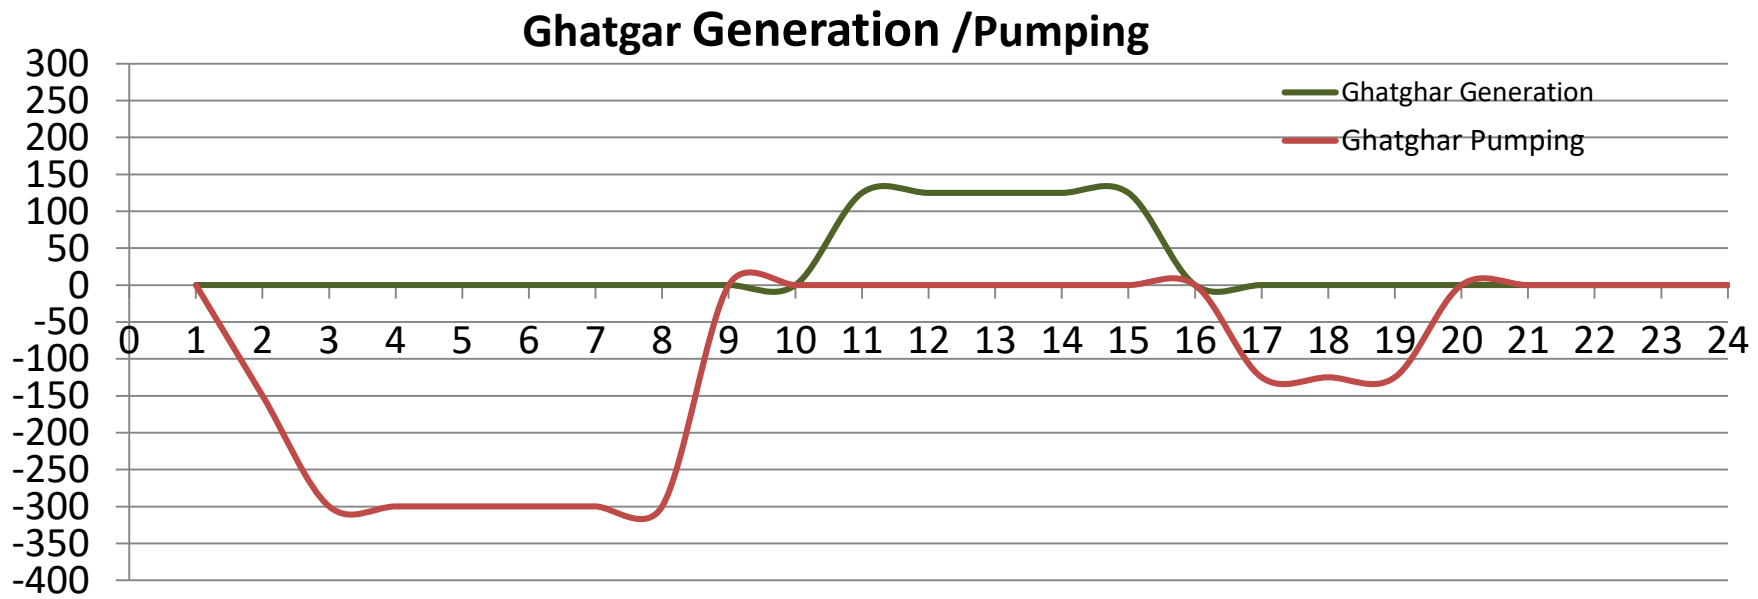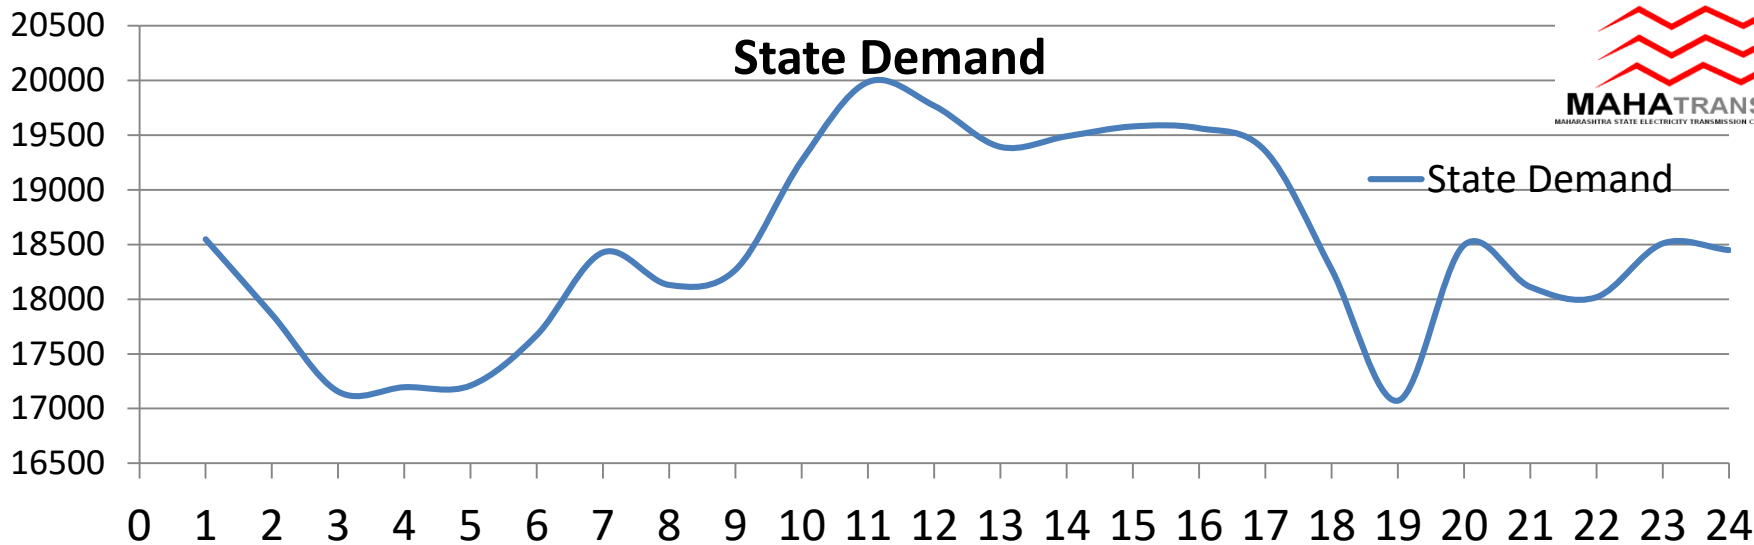

Date:- 14 April 2016

Month	Max Demand (MW)	Corresponding Min. Demand (MW)	Difference
Apr-15	20204	16731	3473
May-15	20367	16079	4288
Jun-15	19761	16537	3224
Jul-15	20141	16502	3639
Aug-15	18982	15174	3808
Sep-15	19681	15662	4019
Oct-15	21414	17421	3993
Nov-15	20760	15837	4923
Dec-15	19554	15291	4263
Jan-16	18647	13340	5307
Feb-16	19458	14178	5280
Mar-16	19866	16133	3733
Apr-16	20522	17749	2773
May-16	20451	16659	3792
Jun-16	20318	16940	3378

Energy injected by Ghatghar PSP in Maharashtra Grid

Sr.No.	Year	2013-14	2014-15	2015-16
	Month			
1	April	17.338	18.724	21.654
2	May	18.610	27.413	20.815
3	June	34.409	29.625	22.827
4	July	26.616	35.371	21.932
5	August	20.116	24.079	27.520
6	September	14.354	18.487	27.782
7	October	17.592	23.040	21.055
8	November	24.174	17.180	38.905
9	December	59.799	31.809	37.622
10	January	60.508	22.627	29.534
11	February	51.483	33.439	14.849
12	March	38.915	29.787	12.839
<u>Total for the year (Mus)</u>		<u>383.914</u>	<u>311.581</u>	<u>297.334</u>

Installed Capacxity in MW :-- 2x125 MW Units
GENERATION & PUMPING DATA for FY 2015-16

Date	GENERATION				PUMPING			
	UNIT-1		UNIT-2		UNIT-1		UNIT-2	
	Gen.	Generation Service Hrs	Gen.	Gen. Service Hrs	Pumping Consumption	Pumping Service Hrs	Pumping Consumption	Pumping Service Hrs
	ABT Meter		ABT Meter		ABT Meter		ABT Meter	
Mus.	Mus.		Mus.		Mus.			
Apr-15	13.048	103:10	9.222	69:58	15.247	102:55	14.578	102:00:00
May-15	11.524	93:10	9.290	75:38	7.026	45:25	18.852	124:10:00
Jun-15	13.001	105:30	9.827	80:20	13.947	91:14	17.816	117:58:00
Jul-15	11.320	91:40	10.612	86:35	11.386	74:15	22.497	148:25
Aug-15	17.389	142:05	10.131	81:50	17.53	115:00	20.914	138:45
Sep-15	15.156	122:50	12.625	103:00	15.873	103:30	20.668	133:45
Oct-15	10.845	87:45	10.211	83:23	16.138	104:33	12.54	82:15
Nov-15	20.015	162:10	18.202	148:30	25.665	168:20	23.846	159:45
Dec-15	18.161	150:27	18.824	153:17	27.539	181:10	20.996	139:30
Jan-16	17.352	141:20	11.736	96:02	21.805	142:32	17.995	119:45
Feb-16	8.713	70:50	6.041	49:20	11.475	74:30	6.523	42:10
Mar-16	3.432	27:58	9.336	76.21	5.625	36:10	12.633	81:47


Conclusion

- Even though the capacity of Ghatghar PSP is $2 \times 125 = 250$ MW is small compared to Maharashtra State Demand which is more than 22,000 MW, it is supporting to cater peak demand and consume power in surplus scenario.
- Ghatghar PSP proved useful in relieving congestion or constraints in case of line or unit tripping or disturbance.
- Ghatghar PSP can be modeled as an example for operation to support grid in generator and pumping mode as well.
- Ghatghar PSP is also used as a black start in case of grid failure
- Black Start Mock is regularly carried out, latest on 18.11.2016

Bhira Hydraullic Layout



TATA POWER COMPANY
BHIRA GENERATING STATION
HYDRAULIC LAYOUT

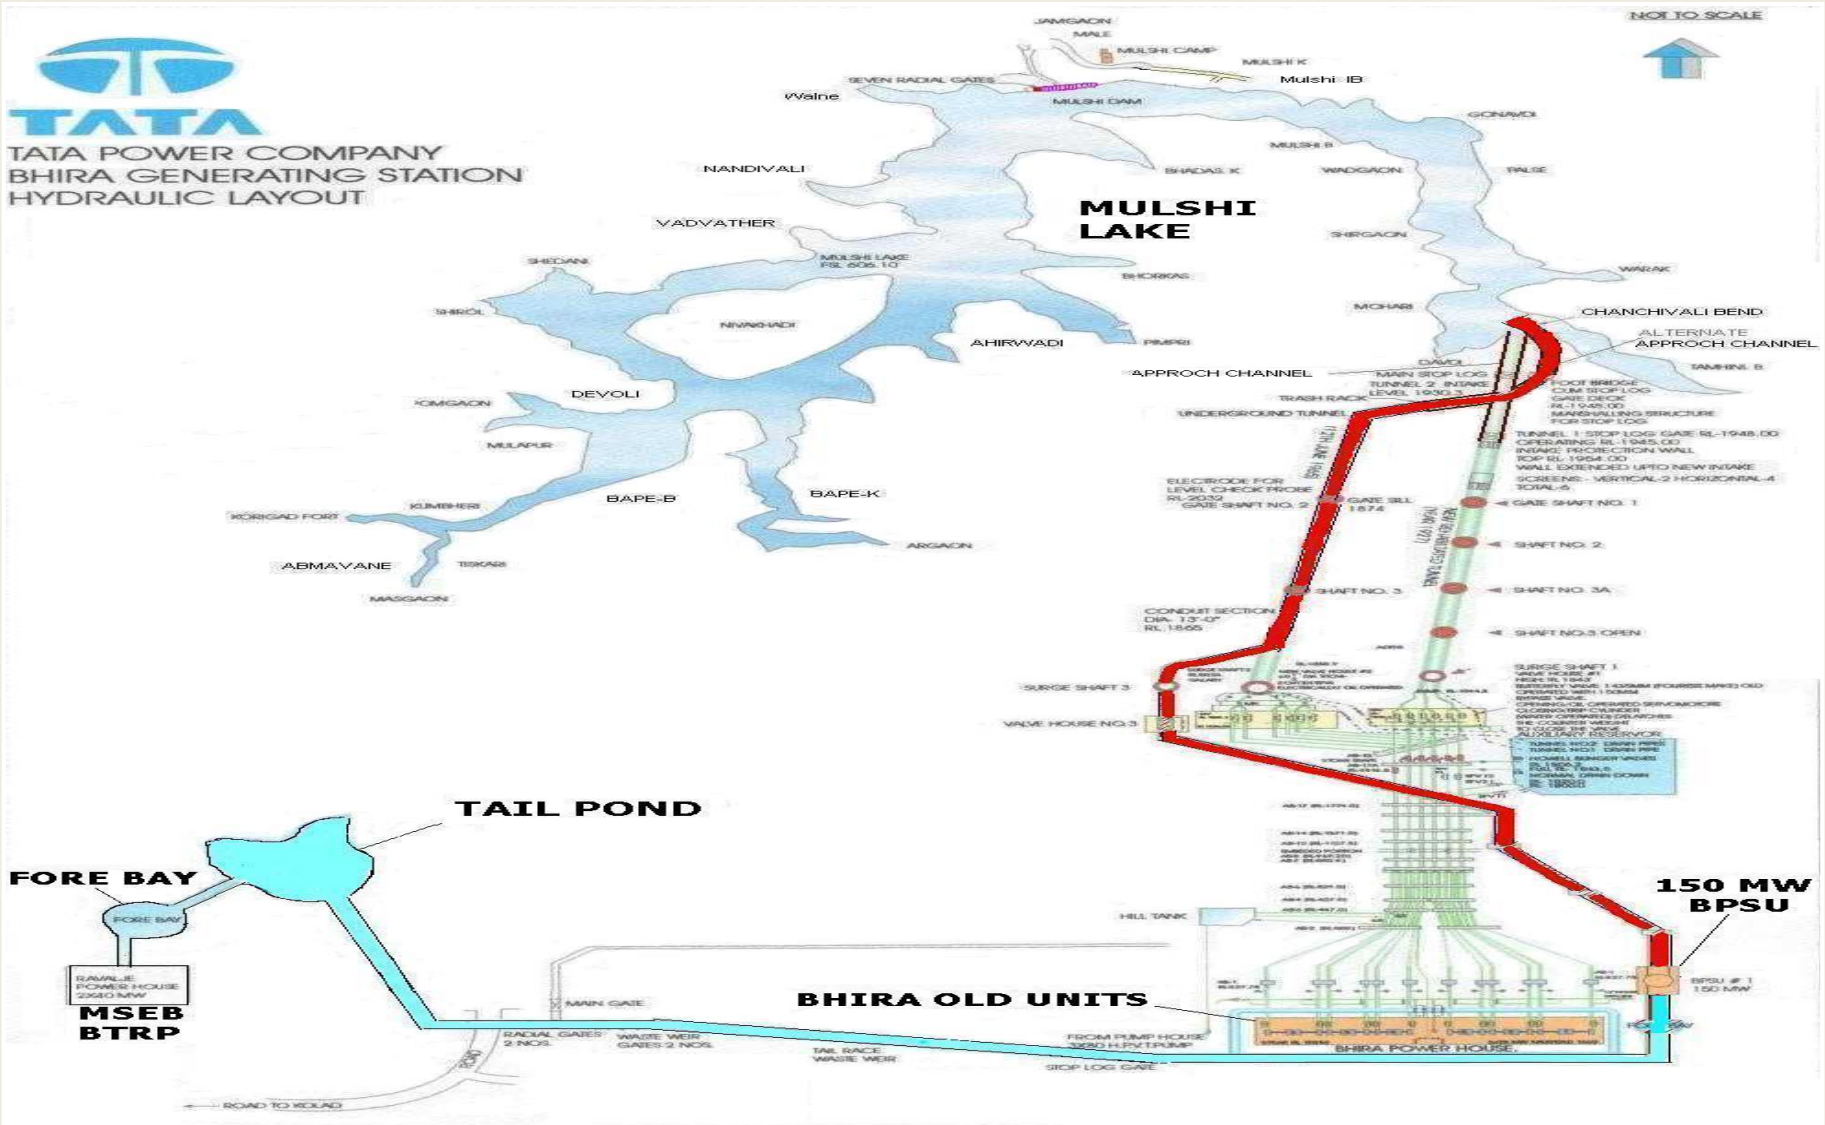



Brief Details of BPSU, Bhira – Mulshi Lake & Generation

- **TPC commissioned 150 MW pumped storage unit at Bhira (BPSU) in 1997**
- **Scheme is designed to pump water from Bhira tail race pickup pond to Mulshi lake.**
- **Lake capacity – 522.76 MCM**
- **Average Inflow – 920 MCM**
- **Possible generation with the Inflow- 989 MU**
- **Dry period generation – 562 MU**
- **Average per day generation during dry season – 2.5 MU**
- **Pick up pond capacity – 5.5 MCM**
- **Pick up pond operating level – 90 – 95 Mtr**
- **Minimum Pick up pond Level required for pumping – 94.4 Mtr**

BPSU Pumping – Existing Operational Constraints

- Pumping would be possible only during off peak hours and when Bhira Old Power House and Rawalje Power House is not generating.
- The system frequency should be between 49.5Hz and 51.5 Hz and **there shall be cheap power available for pumping.**
- The Rawalje pickup pond level should be minimum 94.4 m during starting & more than 93.85 m through out the pumping operation.
- Interconnecting tunnel of BTRP & Forebay has **no regulating gate** & transfer of water from pick up pond to Forebay is continuous. Because of this, Pick up pond level remains at around 93 m during night time, so pumping is not feasible.


Operational Constraints of Pumping → Required Tail Race Level

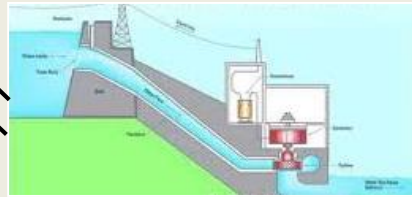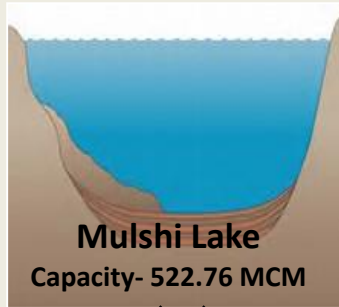

Bhira Power House
300 MW



PICK-UP POND

Capacity - 5.5 MCM
Max Level - 95.5 Mtr
Min. Level - 90.0 Mtr

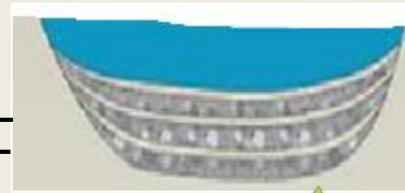

RAWALJE FORE BAY

Storage -.1.76 MCM
Max Level - 94.5 Mtr

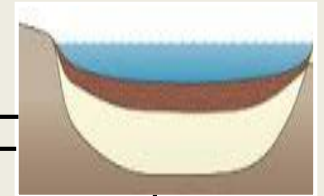


MSPGCL
Rawalje Power House
80 MW

Level requirement for pumping


Start Permissive for pumping -
Pick-up pond level - 94.4 Mtrs

Pumping can be done till
PU Pond level - 93.85 Mtr

Operational Constraints of Pumping → Required Tail Race Level

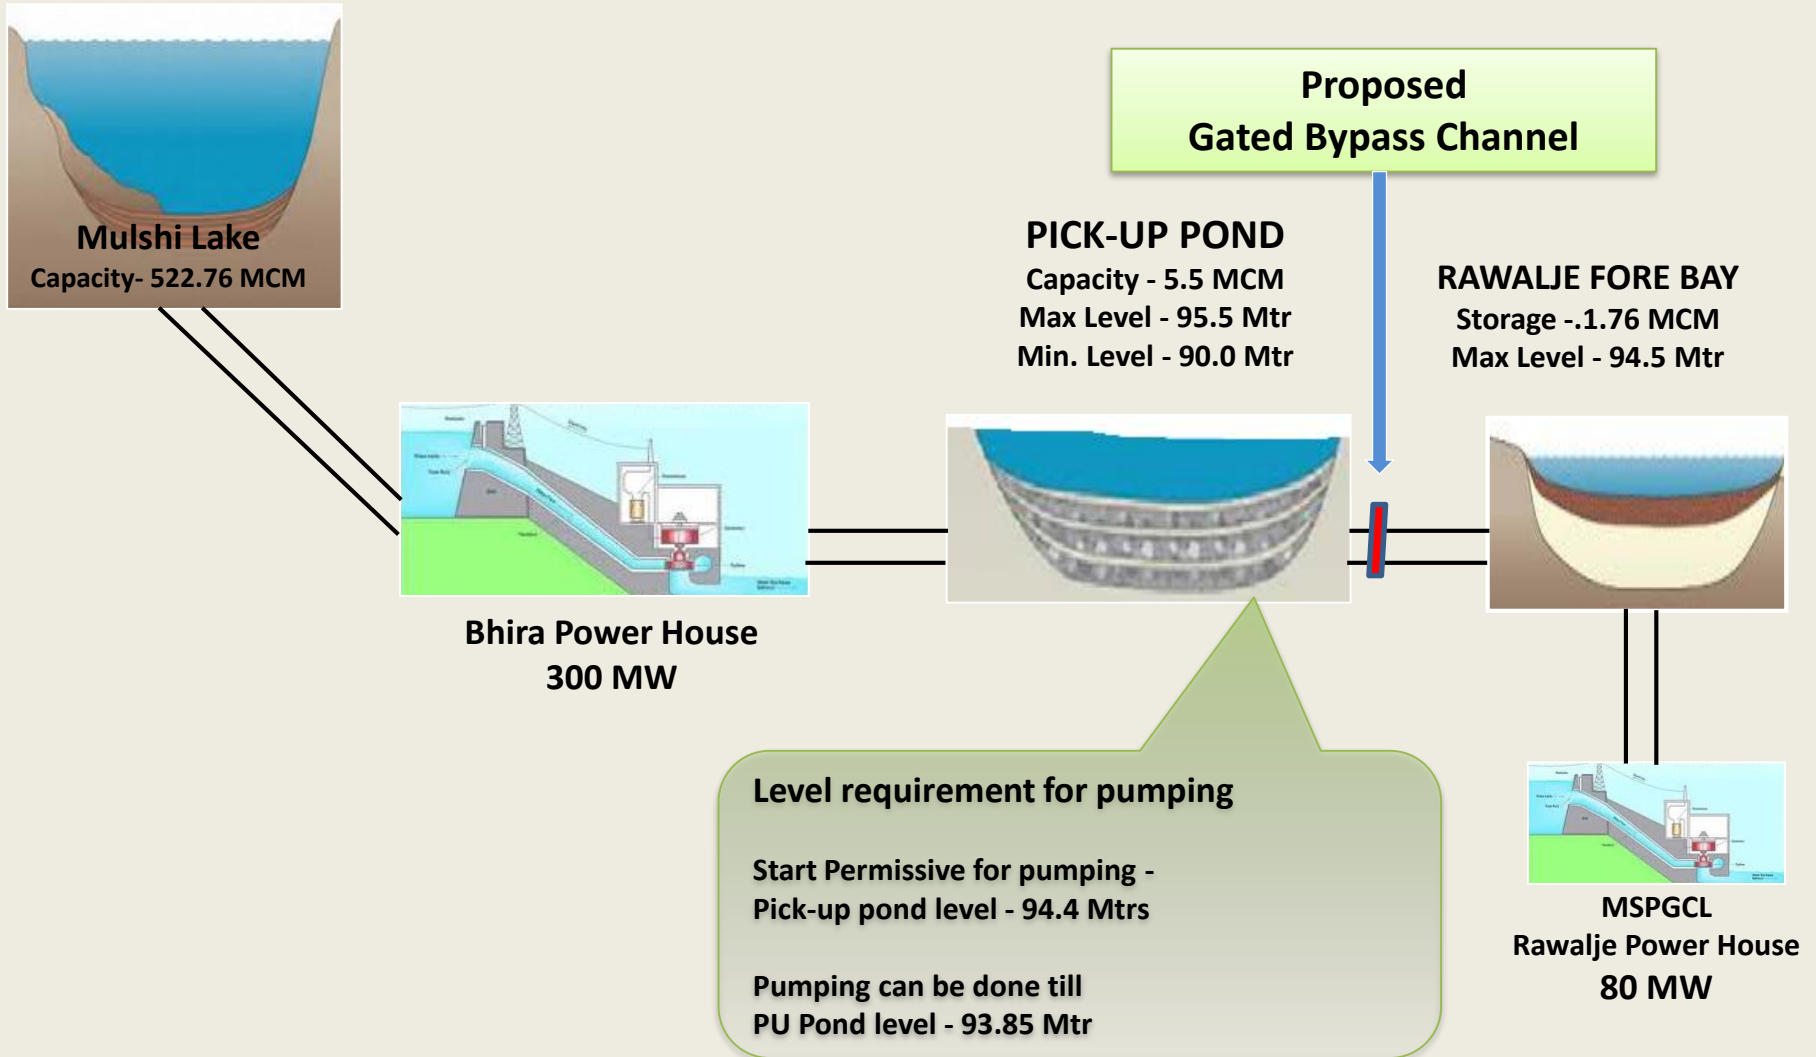

Proposed Measure to Mitigate Constraint of Tail Race Level

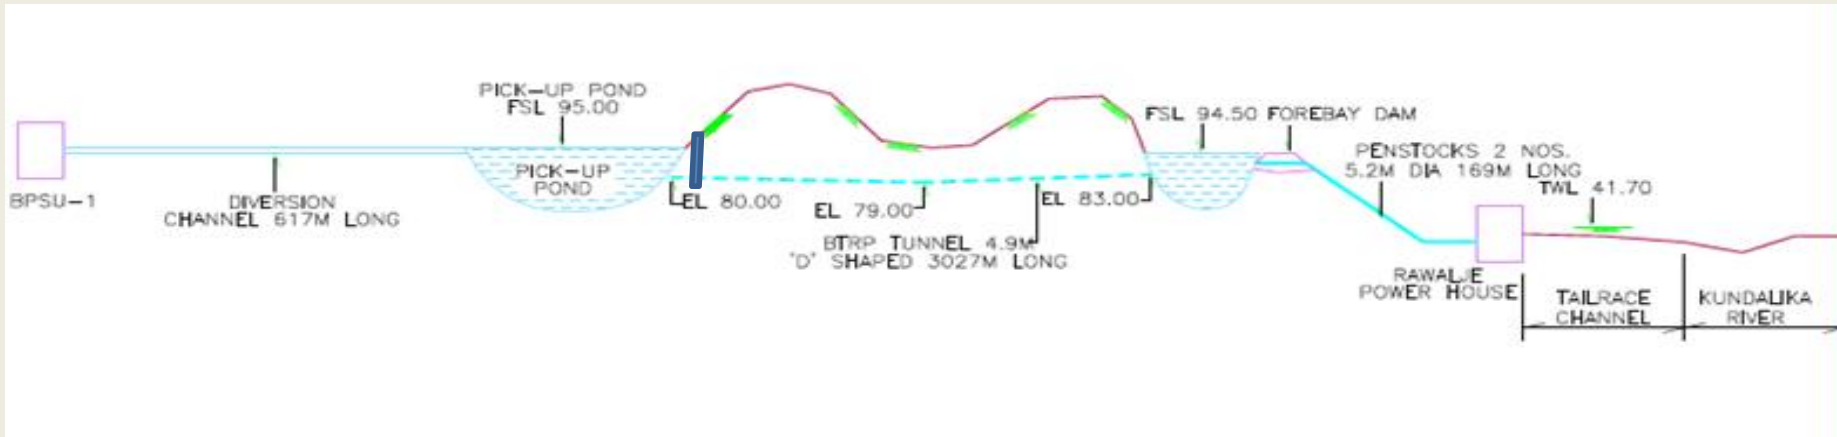

- Gate has to be provided between Pick up pond & Forebay to control the water level in Pick-up pond.
- NOC has been received from MSPGCL for the project. Agreement has been made with Central Design Organization, Nashik for Design of gated bypass channel and coffer dam for BTRP project. Design is in progress.
- After design of gated bypass channel and coffer dam for BTRP, approval from Chief Engineer, WRD-Konkan would be required for the project.
- MERC approval will be required for the project. On MERC approval for the project, estimated project cost will be deposited with Irrigation Department for project implementation.

Paithan Pump Storage Unit

1. Generator Installed Capacity (MW) :12.0 MW
2. Pumping Capacity (MW) :13.5 MW
3. Upper Dam Level (Godavari Dam) :463.90 mtr.(Full Reservoir Level)
4. Lower Dam Level (Chankawadi Dam) :435.96 mtr (Full Reservoir Level)
5. Daily average generation time : 09:00 to 12:00 hrs
: 18:00 to 21:00 hrs
6. Daily average generation energy(MUs) : 0.05 Mus
7. Daily average pumping time : 22:00 to 06:00 hrs
8. Daily average pumping energy : 0.09 Mus
9. Manufacture : M/S FUJI ELECTRIC. JAPAN



An ISO 9001-2008
certified office

GOVERNMENT OF MAHARASHTRA
WATER RESOURCES DEPARTMENT
OFFICE OF THE CHIEF ENGINEER (ELECTRICAL),
HYDRO PROJECTS

HSBC BUILDING, 4TH FLOOR, M.G.ROAD, FORT, MUMBAI-400001
Tel. : 022-22674867/22670074/22678638 Fax : 022 22674867
E-mail: cehp_mumbai@wrd.maharashtra.gov.in / ceehpwr@gmail.com



Urgent By e-mail

No.CE(E)/HP/D-9/T-2/PSS/ 668

Date: -

15 MAR 2016

To,

Chief Engineer,
S.L.D.C.

Thane Belapur Road, P.O. Airoli,
Navi Mumbai 400708

Email: cesldc@mahasldc.in or mahatransco.in, seop8000@mahatransco.in,
eeop8000@mahatransco.in

Sub.-: Availability of off peak energy for Pumped Storage Hydro Electric Projects in
Maharashtra.

Dear Sir,

We are planning to undertake following Pumped Storage Hydro Electric Projects in
Maharashtra.

Sr. No.	Name of Project	Installed capacity	Probable date of commissioning
1.	Malshej Ghat Pumped Storage Scheme	2 x 350 MW	2022-23 and beyond
2.	Panshet Pumped Storage Scheme	4 x 400 MW	2022-23 and beyond
3.	Warasgaon Pumped Storage Scheme	4 x 300 MW	2022-23 and beyond
4.	Varandhghat Pumped Storage Scheme	2 x 400 MW	2022-23 and beyond
5.	Muthkhel Pumped Storage Scheme	1 x 110 MW	2022-23 and beyond
6.	Koyna Hydro Electric Project Stage VI	2 x 200 MW	2022-23 and beyond
7.	Atvan Pumped Storage Scheme	3 x 400 MW	2022-23 and beyond


These Projects are expected to be commissioned in 2022-23 and beyond.

In view of above, it is requested to confirm whether off peak energy will be available by MSEDCL for the above projects. It is also requested to inform the duration of daily available off peak power (MW), so that capacity of pumped storage projects can be planned. Necessary action regarding stage wise development will be taken after receipt of your confirmation regarding availability of off peak energy.

It is requested to provide the required information in the matter immediately.

Thanking you,

Yours faithfully,


(V.A. Ankush)

Chief Engineer (Electrical)
Hydro Projects, Mumbai-01



Thank
YOU

OPERATIONALIZATION OF EXISTING PUMP STORAGE PLANTS



Saswati Mukhopadyay, Chief Engineer
Dipak kumar Paul, Addl. Chief Engineer
Purulia Pumped Storage Project

BACKGROUND OF SETTING UP PURULIA PUMPED STORAGE PROJECT (PPSP):

- ❖ The State of West Bengal and the Eastern Region is having predominantly thermal power generation and it faces a serious system stabilization problem.
- ❖ In order to achieve a better hydro thermal generation mix and more efficient electrical energy management in the region, development of such Pumped Storage Scheme was undertaken and finally PPSP is now under operational condition.

RENEWABLE ENERGY GROWTH - DRIVING THE NEED FOR ENERGY STORAGE




RENEWABLE ENERGY GROWTH - DRIVING THE NEED FOR ENERGY STORAGE

- ❖ India aims to increase the proportion of energy generation from Renewable source such as wind and solar. This can present new challenges for grid reliability and stability.
- ❖ The power output for these plants can fluctuate widely as weather patterns change and the magnitude of renewable energy generation ramps can be challenging to grid operators when renewable energy resources are a large component of generation portfolio.

- ❖ This variable output can lead to frequency and voltage fluctuations, which adversely affect grid stability.
- ❖ In geographic regions without a significant hydroelectric generation base, this variability is most commonly managed with fossil fuel-based thermal generation.
- ❖ Developing additional pumped storage hydro, particularly in area with increased wind and solar capacity, would significantly improve grid reliability with handling of green power.

General view of the Purulia project

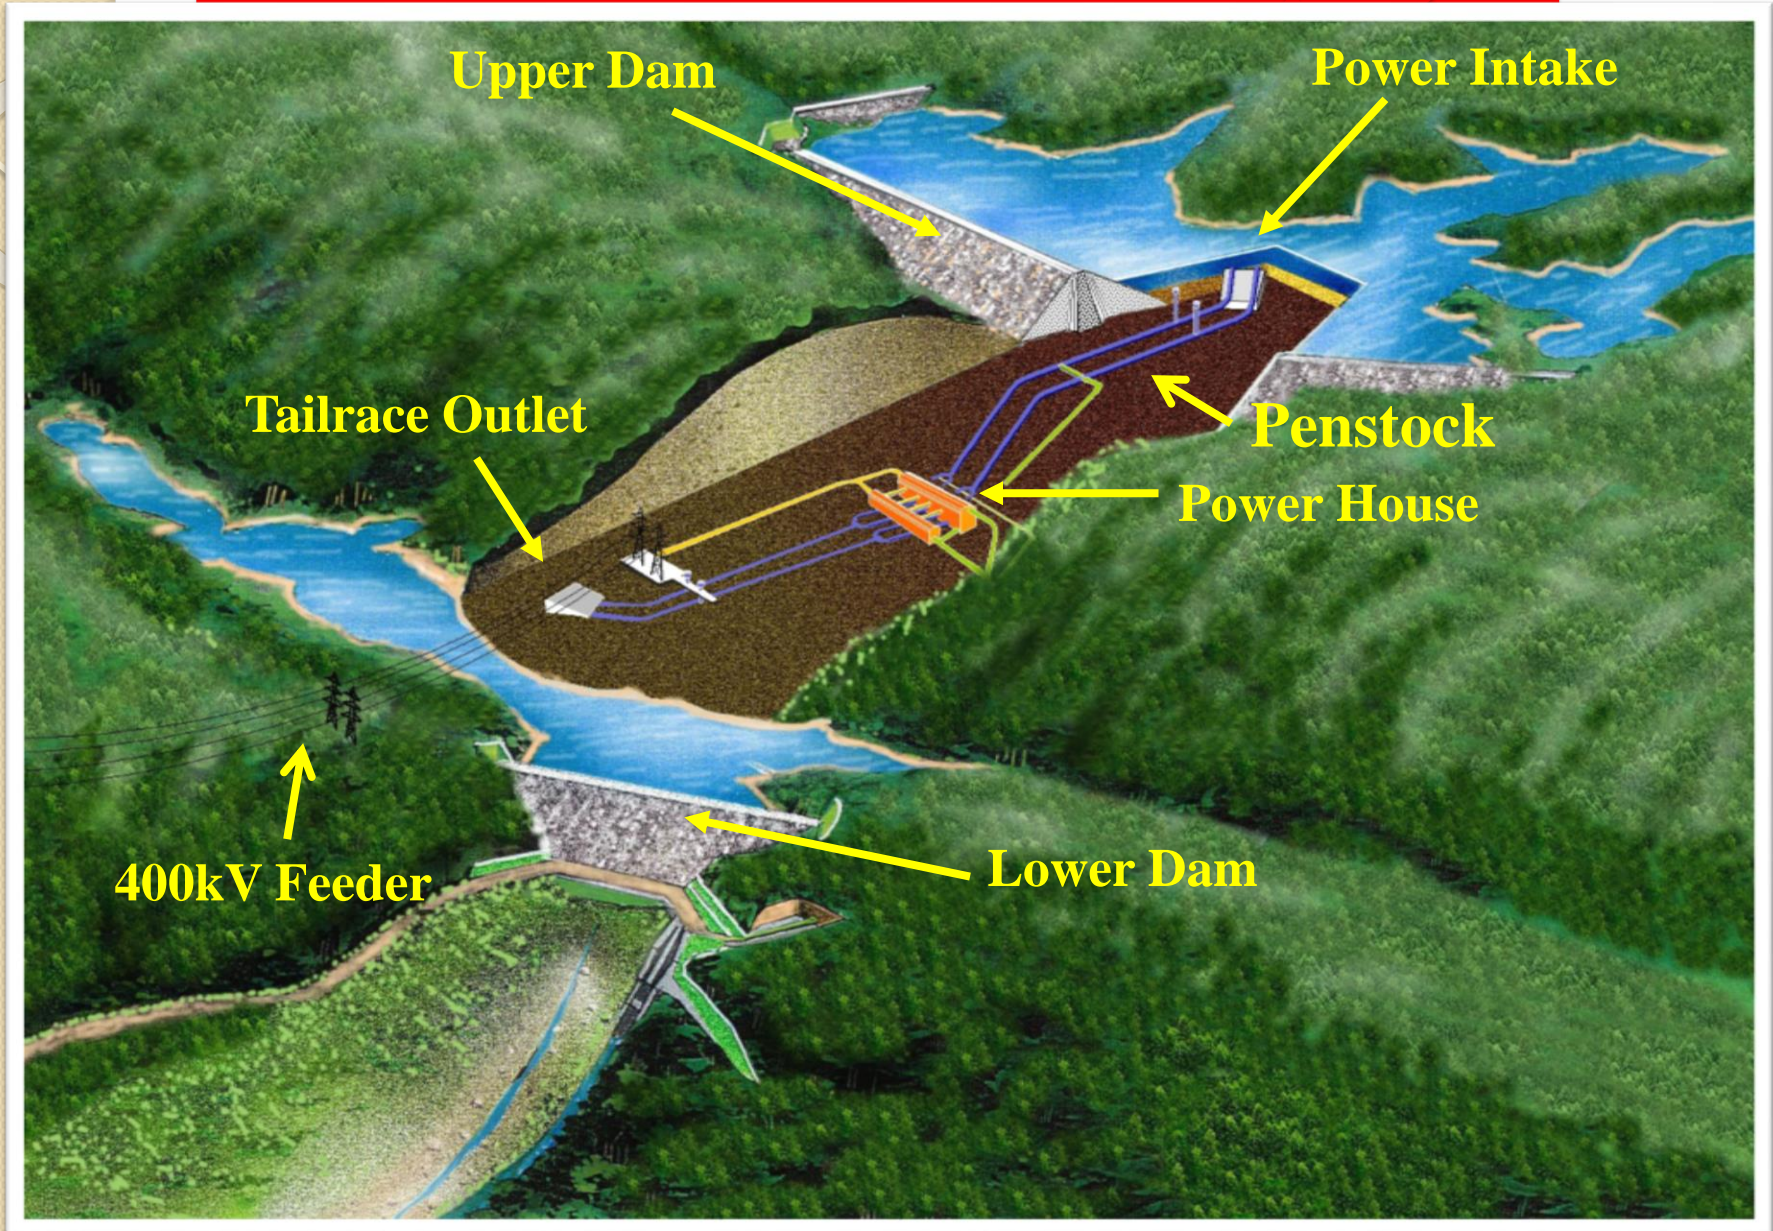

GENERATOR - MOTOR


- No of Unit :4
- No of pole at each generator :24
- No of pole winding turn : 25
- Generator :250 MVA (0.9pf lag)
- Motor :255 MW(0.95 pf lead)
- Rated Voltage :16.5 kV
- Armature Current (in P-mode) :9546 Amp
- Armature Current (in G-mode) :8748 Amp
- Excitation Current (G-Mode) :2060 Amp
- Excitation Current (P-Mode) :2040 Amp
- Excitation Voltage :305 Volt
- Rated Speed :250 RPM



PUMP-TURBINE


- ❖ **NO OF UNITS** :4
- ❖ **TYPE** :Vertical shaft, Francis
Type reversible pump turbine
- ❖ **NORMAL NET HEAD** :177 M
- ❖ **MAX/ MIN NET HEAD** :214.5 M/ 149.5 M
- ❖ **RATED TURBINE O/P** :230 MW
- ❖ **RUNNER WEIGHT** :59 TONE
- ❖ **MAX. PUMP I/P** :250 MW
- ❖ **NO OF GUIDE VANE** :20
- ❖ **SERVO OIL PRESSURE** :6.94 MPA
- ❖ **RATED SPEED** :250 RPM
- ❖ **MAX. DISCHARGE**
- ❖ **TURBINE** :150.0 Cum / sec

400 KV TRANSMISSION LINES

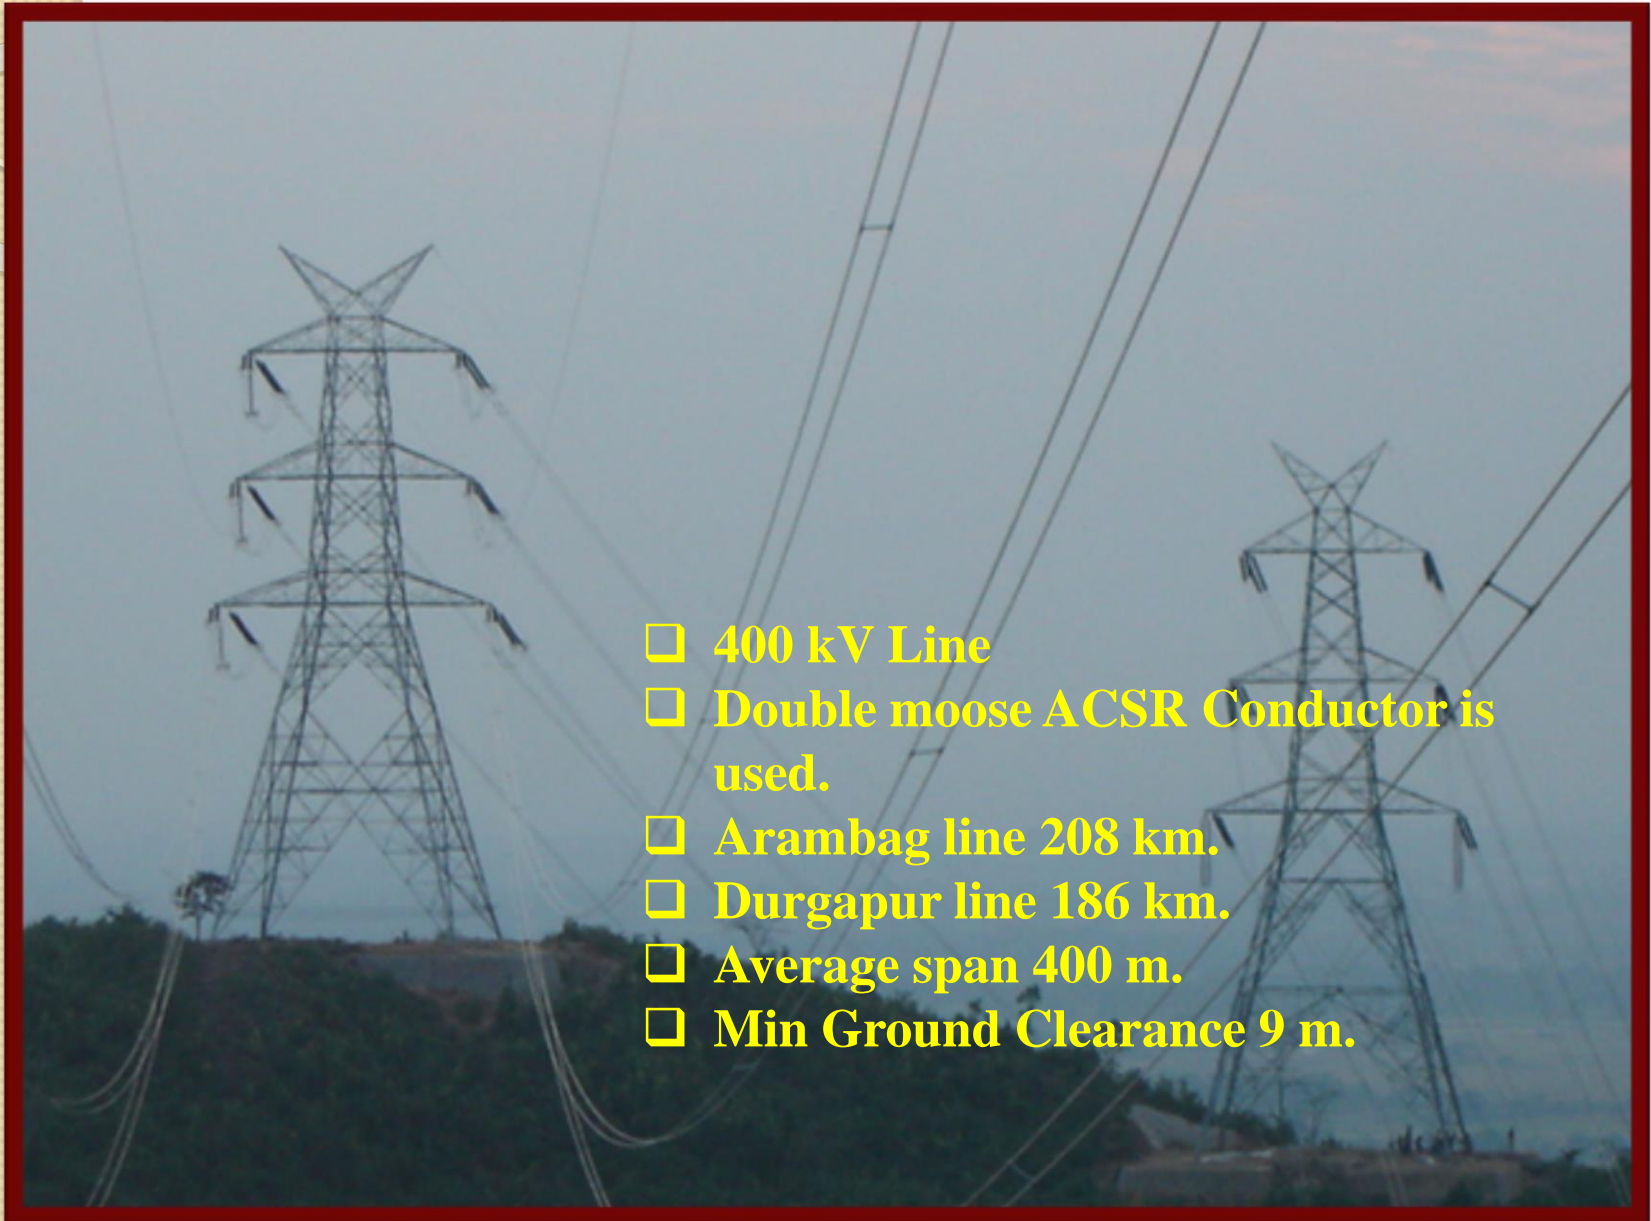

- ❑ 400 kV Line
- ❑ Double moose ACSR Conductor is used.
- ❑ Arambag line 208 km.
- ❑ Durgapur line 186 km.
- ❑ Average span 400 m.
- ❑ Min Ground Clearance 9 m.

STATION OVERVIEW

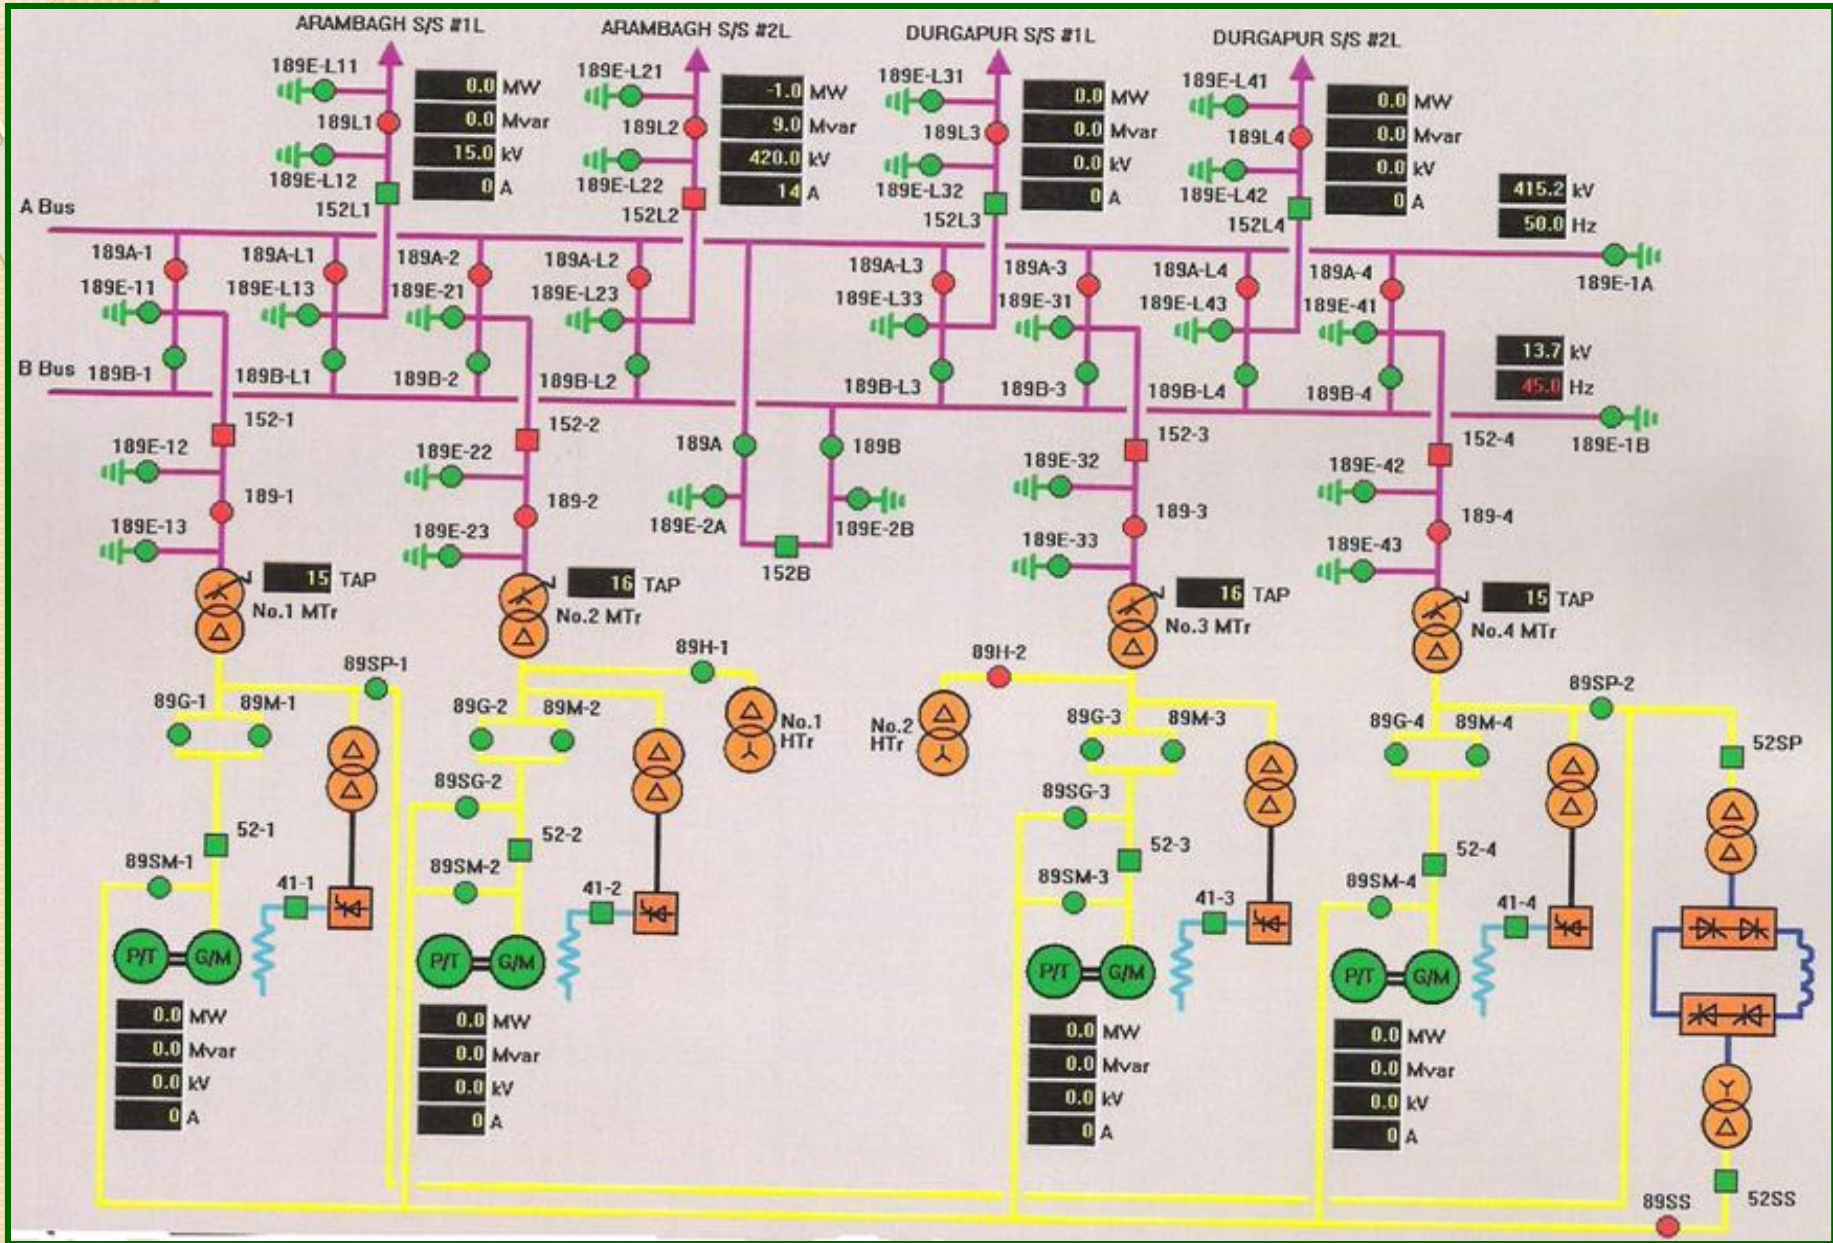




Now we are looking at a glance various mode of operations of PPSP Units in next few slides.

OPERATING MODE AND MODE CHANGING OPERATION:

- ❖ This power station has following five modes of operation.
- ❖ Generating Operation (G)
- ❖ Pumping Operation (P)
- ❖ Synchronous Condenser Operation in Generating Direction (SCOG)
- ❖ Synchronous Condenser Operation in Pumping Direction (SCOP)
- ❖ Line Charging Operation (CH)

VARIOUS MODE OF OPERATION OF PPSP UNITS

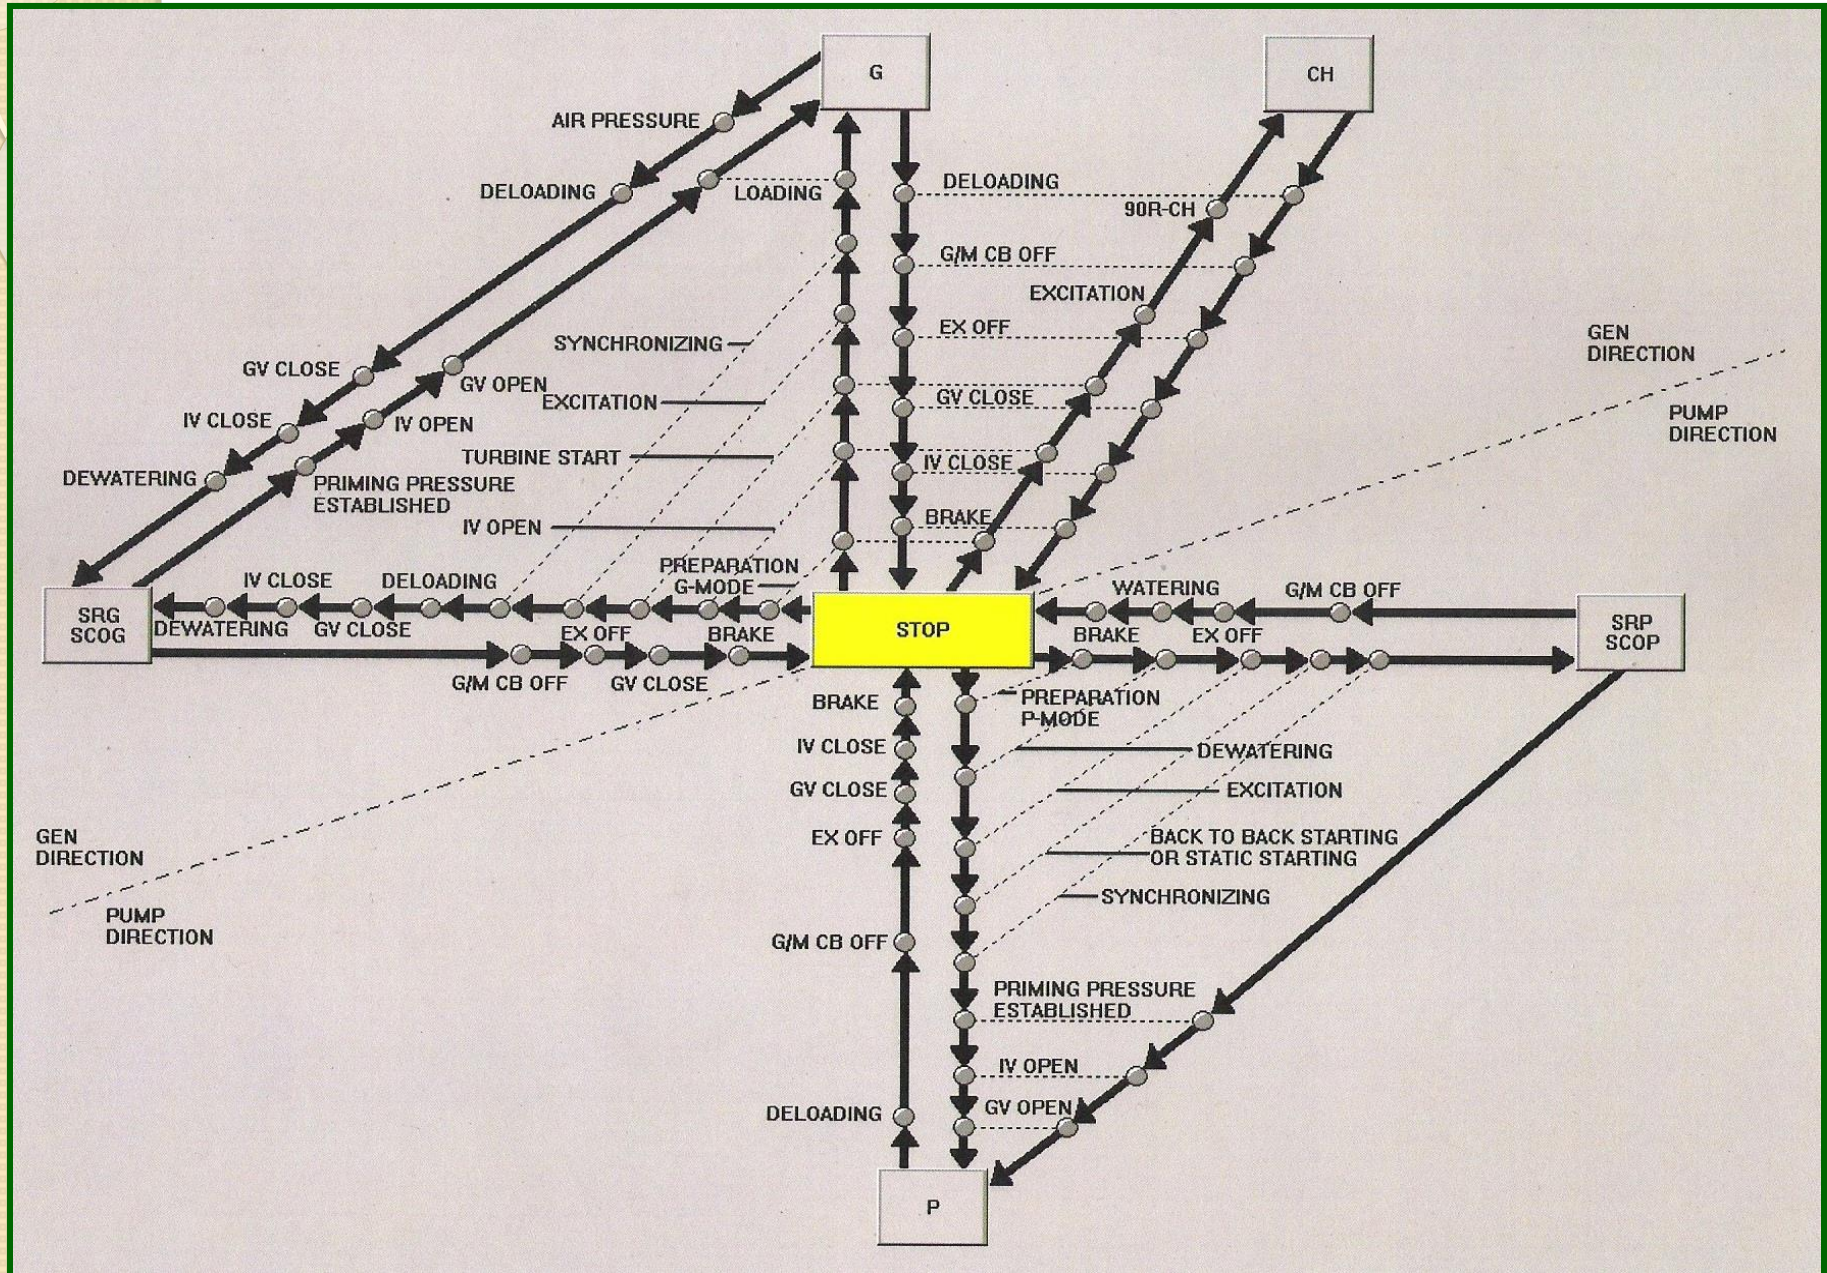

BENEFITS FROM THE PROJECT

- ❖ Peaking output : 900 MW
- ❖ No of peaking hrs : 6 hrs.
- ❖ Energy benefit : 5.4 mu / day
- ❖ Peak demand can be met instantly
- ❖ Plant load factor of thermal power station can be improved.
- ❖ Provide grid stabilisation services
- ❖ Utilizes surplus grid power to pump water from lower reservoir to upper reservoir at lean hours

- ❖ Ability to store large quantities of energy
- ❖ Load balancing
- ❖ Provide backup power & is instrumental for emergency preparedness

Generation and Pumping Data For Last 3 years:

Year	Energy Generated (MU)	Pumping Power (MU)	Plant availability factor (%)	Cycle efficiency (%)
2014-15	1416	1829	91.98	77.4
2015-16	1055	1357	76.72	77.7
2016-17	1106	1416	79.34	78.1
2017-18 Up to May 17	152	198	99.99	76.7

Purulia Pumped Storage Project :

Capacity $4 \times 225 \text{ MW} = 900 \text{ MW}$

Designed Yearly generation = 1897 MU;


Designed Cycle efficiency = 75.5%

Purpose :

- 1. To cater peaking load demand**
- 2. Grid balancing**
- 3. To enhance plant load factor and efficiency of thermal units in the State**

PPSP Yearly Generation (MU)

Generation in MU

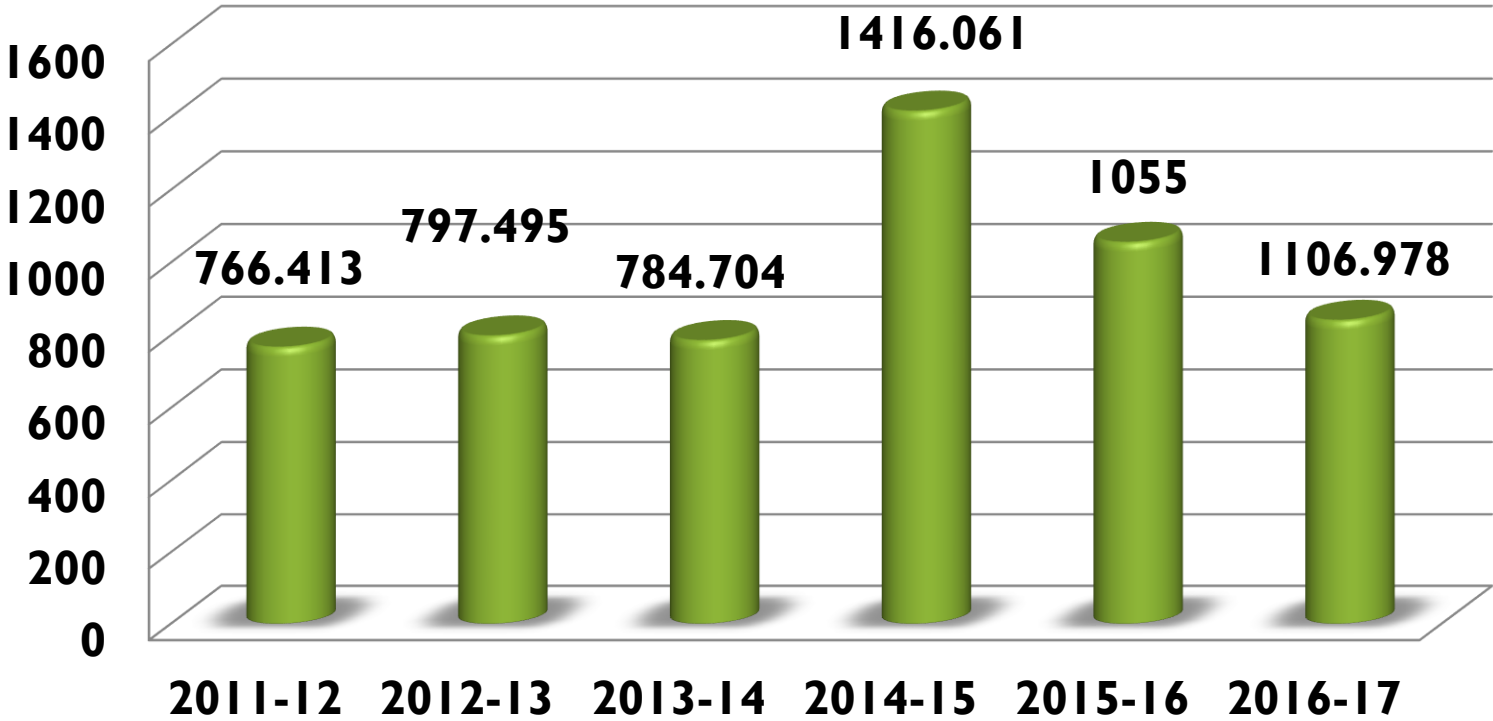

Hydro Power Station of WBSEDCL

Name of the Power Station	Installed capacity	Remarks
Rammam Hydel Project	51 MW	
Teesta Canal Fall Hydel Project	67.5 MW	
Jaldhaka HEP	44 MW	
Massanjore HEP	4 MW	Small Hydel Project
Little Rangit HEP	2 MW	Small Hydel Project
Rinchington HEP	2 MW	Small Hydel Project
Mungpo-Kalikhola HEP	3 MW	Small Hydel Project
Fazi HEP	1.2 MW	Small Hydel Project
Sidrapong HEP	600 KW	Small Hydel Project
TOTAL (Hydel)	175.3 MW	

CONCLUSION:

- ❖ For grid stability, reliable supply and providing quality power, peak load plant to base load plant mix ratio should be 40:60. This can be achieved by installing pumped storage scheme.
- ❖ With rising levels of intermittent renewable energy generation by wind and solar system, clean energy pumped storage solution are being pursued.
- ❖ Pump storage can contribute to a future of sustainable energy.

- ❖ Bulk energy storage could promote the development of new variable energy because it would be able to shift renewable energy from low demand period to higher demand periods, thereby maximising the value of these green power projects.
- ❖ Regulatory Policy work can contribute to the development of valuable facilities, by assigning an actual value and compensation practices for the benefits of faster ramping resources & other ancillary services provided by pumped storage plants.

- ❖ Incentivizing the Pumped Storage Projects in a proper way. If the loss due to cycle efficiency is compensated by way of grant of 15 % of project cost, the cost of generation and tariff of the project may become reasonable.
- ❖ Arrangement of Viability Gap Funding under National Clean Energy Fund for developing Pumped Storage Project, so that it can support large scale renewable powers to be integrated in the grid effectively.

Thank
You!




Pumped Storage Schemes (PSS)



Hydro Business Group

Presentation Outline

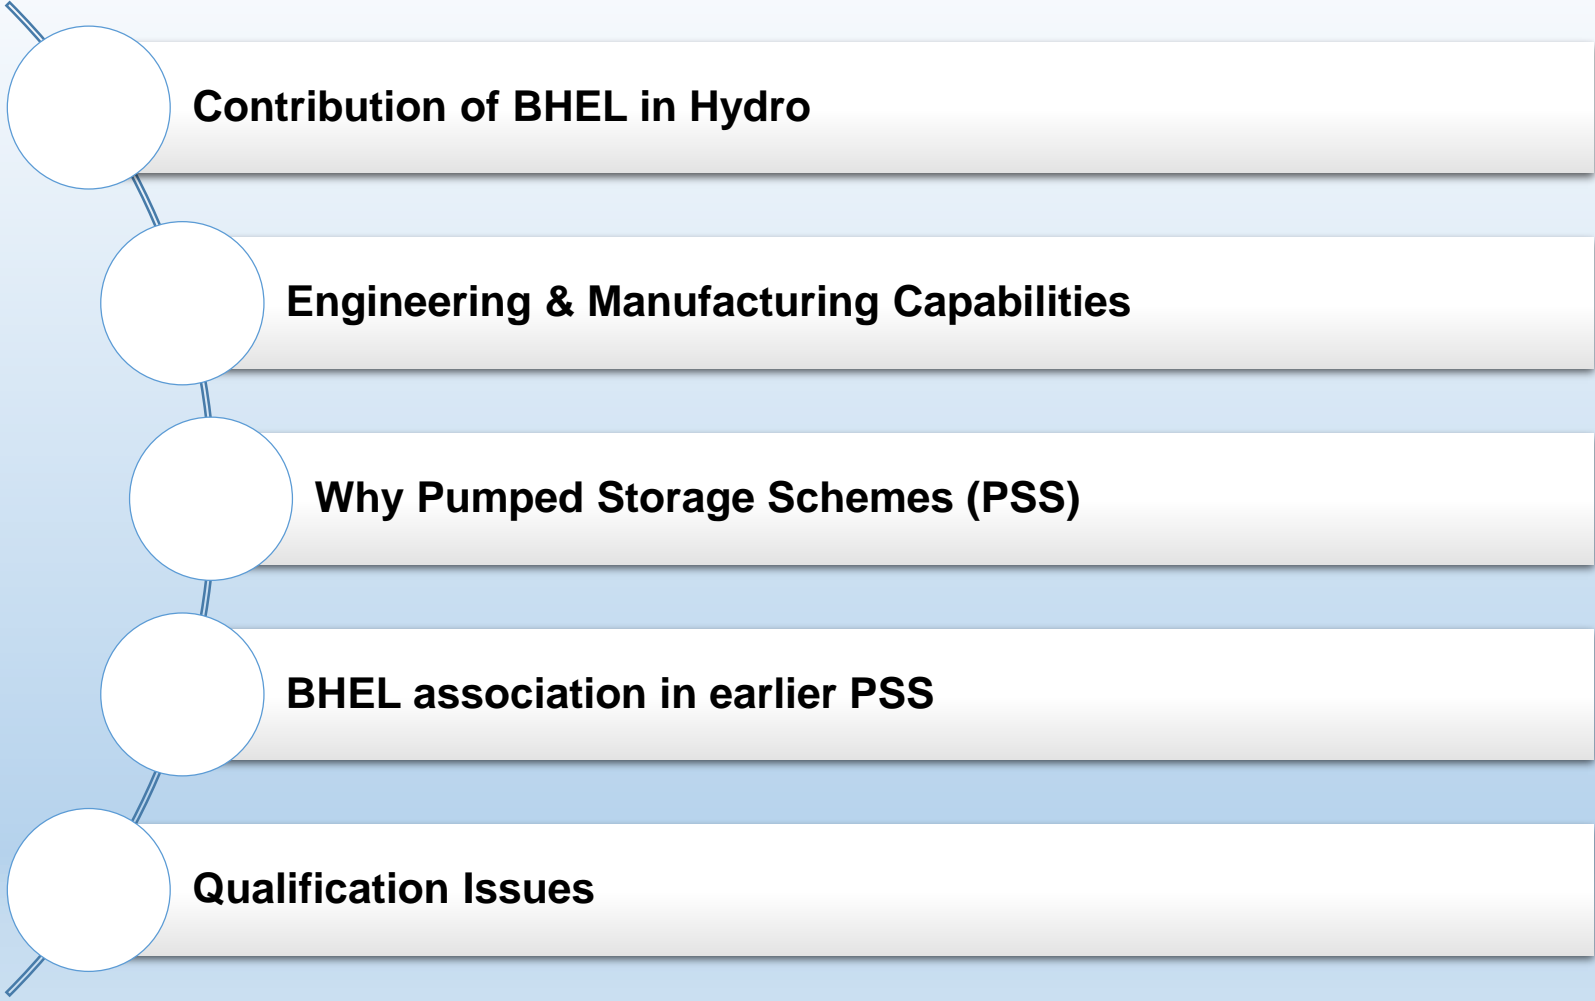

Contribution of BHEL in Hydro



First Hydro Generating Set commissioned : 3X33 MW Obra HEP in 1970

BHEL hydro sets account for 44.62% of total installed hydro capacity in the country

Experience of supplying and commissioning of more than 500 sets in India and abroad

BHEL has contracted 5877 MW of pumps for various lift Irrigation Schemes. Largest pump is of 145 MW unit rating.

Manufacturing capacity of 2500 MW per annum at Bhopal works, can be supplemented by Hardwar unit

State of Art turbine model testing Laboratory at Bhopal : only hydro equipment manufacturer in India having a model test lab

Engineering & Manufacturing Capabilities


	Unit Rating (MW)	Head (m)	Runner Dia. (mm)
<u>PELTON</u>			
Capacity	1.5 to 300	200 to 1500	1000 to 5000
Actual	1.5 to 200	200 to 1100	Upto 3500
<u>FRANCIS</u>			
Capacity	5 to 400	30 to 600	1000 to 8000
Actual	Upto 200	Upto 500	Upto 5680
<u>KAPLAN</u>			
Capacity	2 to 150	10 to 80	1200 to 8500
Actual	Upto 75	Upto 50	Upto 5650

Engineering & Manufacturing Capabilities



Model Development & Testing Facility - Bhopal






- Recognized by the Department of Scientific & Industrial Research (DSIR), Government of India as in-house R & D group for Hydraulic Design & Development of Hydro Turbines.
- Accredited by NABL as per ISO / IEC 17025 :2005 in the field of Fluid Flow Testing.
- Fully automated Model Test Facility with 3 Universal test-beds for all types of turbines, pumps and reversible pump-turbines fulfilling IEC-60193 recommendations.
- Dedicated Workshop with CNC Machines (5-axis and 3-axis) for accurate Model manufacturing.

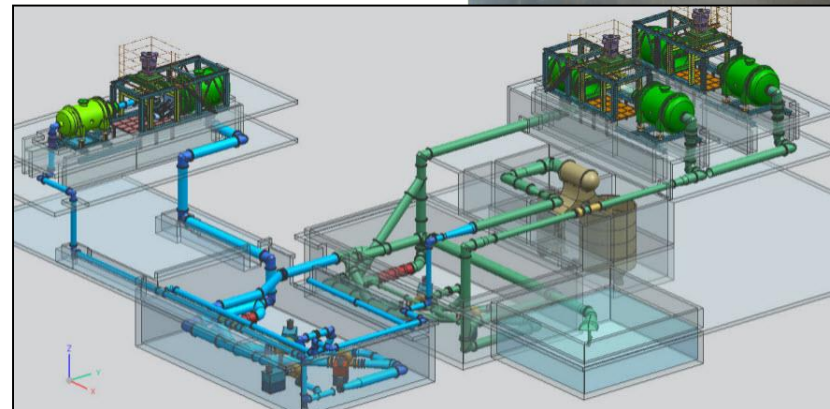

CFD Centre – Bhopal



- Equipped by a dedicated CFD laboratory which forms the basic back-bone of Hydraulic design and optimization of Hydraulic profiles.
- Dedicated High Performance Cluster for CFD Analysis.
- Capability of Hydraulic design and optimization of full range of Francis, Kaplan, Pelton turbines & pumps.
- Advance Research undertaken in the field of hydraulic machinery.

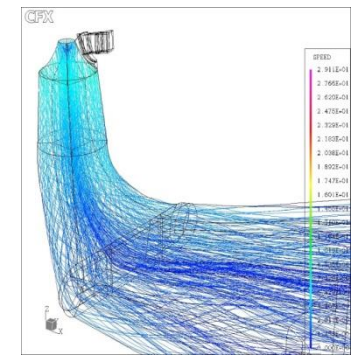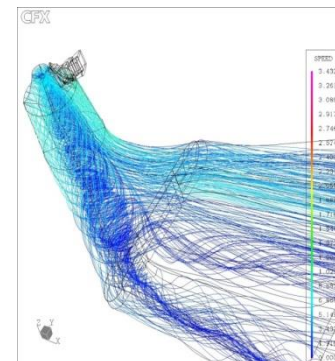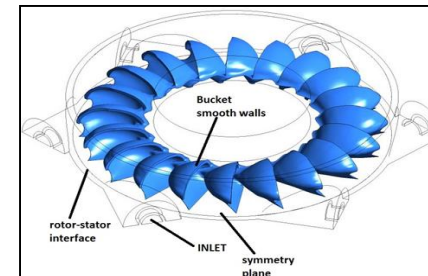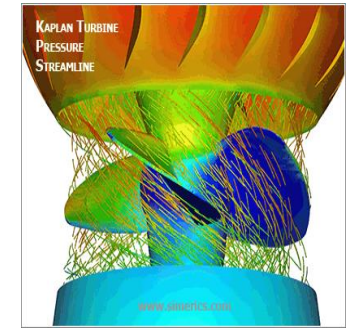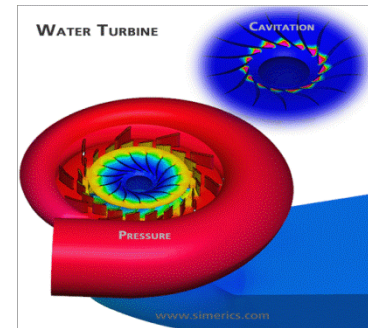

Engineering & Manufacturing Capabilities at BHEL Bhopal

- **Total Dedicated Engineering strength of 200 Engineers.**
- **Hydraulic design capability for all types of turbines.**
- **Strength calculations for all components using latest CAD /CAE tools.**
- **Use of F.E.M for all major components for turbine & generator**
- **3-D Visualization of different assemblies by 3D Solid Modeling**
- **Designing done through Knowledge Based Engineering system.**
- **Designs developed for longer life, easy maintenance and cost reduction.**

Dimensional details of large size Hydro Turbines

Project	Runner Max Dia (mm)	Turbine Shaft Dia (mm)	Head Cover Dia (mm)	Pivot / Bottom Ring Dia (mm)	Stay Ring Dia (mm)
Ranjit Sagar (4 x 150 MW)	4550	1050	5580	5200	7060
Sardar Sarovar RPT (6 x 200 MW)	7000	1220	9520	8980	10880
Srisaïlam RPT (7 x 110 MW)	6680	1168	9180	8591	10530
Indira Sagar (8 x 125 MW)	5681	1120	7300	7020	8560
Koldam (4 x 200 MW)	4900	1168	6200	6000	7500
Nagarjun Sagar RPT (7 x 100 MW)	4500	965	7760	7230	8450

Milestones in Hydro Generators

Sl. No.	Description	Rating
1	Highest capacity vertical - JV	6x305 MVA, 300 RPM for Naptha Jhakri power house in India
2	Biggest in physical size	6x165 MVA, 136 RPM for Srisailam power house in India with a frame diameter of 13.4 m
3	Heaviest thrust bearing load	1800 tons for 4x84 MVA, 150 RPM for Ukai power house in Gujarat
4	Highest speed machine	1x24 MVA, 750 RPM for Kundah 'V' power house in Tamilnadu
5	Highest capacity (vertical) generator / motor - JV	6x222 MVA, 136 RPM for Sardar Sarovar Dam
6	Largest Bulb generators	2 x 9 MW, 125 RPM for Mukerian HEP

Higher Rating Generating Sets (150 MW & Above) - Supplied & Commissioned

Project	Customer	Rating	Type Of Turbine	Head (m)	Speed (Rpm)	Year of Commg 1st Unit
Nathpa Jhakri	SJVN	6 x 250	Francis	428	300	2003
S. Sarovar	SSNNL	6 x 200	R. Francis	116.6	136.4	2006
Kol Dam	NTPC	4 x 200	Francis	131.2	166.6	2015
Tala	Bhutan	6 x 170	Pelton	819	375	2006
Dehar	BBMB	6 x 165	Francis	282	300	1977
Srisaillam	APSEB	6 x 150	R. Francis	82.8	136.4	2003
Ranjit Sagar	PSEB	4 x 150	Francis	100	166.7	2000

Higher Rating Generating Sets Under Execution

Project	Customer	Rating MW	Type Of Turbine	Head (m)	Speed (rpm)
Parbati-II	NHPC	4 x 200	Pelton	789	375
Punatsangchhu - I	PHPA Bhutan	6 x 200	Francis	338	250
Mangdechhu HEP	MHPA Bhutan	4 x180	Pelton	692	375
Punatsangchhu - II	PHPA Bhutan	6 x 170	Francis	241	250
Kameng	NEEPCO	4 x 150	Francis	504	428.6
Tapovan Vishnugarh	NTPC	4 x 130	Pelton	483	300
Vishnugad Pipalkoti	THDC	4x111	Francis	212.46	250

Higher Rating Pump Sets

Name of the Project / Scheme	No. x Rating in MW	Total MW
AMRP Lift Irrigation Scheme (Sri Sailam LBC)	4 x 18 MW	72
Mahatma Gandhi Kalwakurthy Stage-I LIS	5 x 30 MW	150
Jawahar Nettempadu Stage-I LIS	4 x 17 MW	68
Jawahar Nettempadu Stage-II LIS	3 x 17 MW	51
Koilsagar Stage-I LIS	2 x 7.5 MW	15
Koilsagar Stage-II LIS	2 x 7.5 MW	15
Mahatma Gandhi Kalwakurthy Stage-III LIS	5 x 30 MW	150
Pranahitha Chevella LIS Package - 6	7 x 116 MW	812
Pranahitha Chevella LIS Package - 8	7 x 139 MW	973
Pranahitha Chevella LIS Package - 10	4 x 106 MW	424
Pranahitha Chevella LIS Package - 11	4 x 134 MW	536
Palamuru Rangareddy LIS Stage - 2	9 x 145 MW	1305
Palamuru Rangareddy LIS Stage - 3	9 x 145 MW	1305
	Total	5877

	No of Sets	Total MW
Total Commissioned projects	22	431
Total under execution projects	43	5446

Why Pumped Storage Schemes (PSS)

- **Government of India has set an ambitious program for increase in Renewable Energy Generation. Wind and solar plants are subject to daily cyclic natural fluctuations, as well as seasonal fluctuations leading to grid instability.**
- **Hydro pumped storage systems shall play an important role in providing storage of power and maintaining grid stability -- most of the developed countries are following this route.**
- **Hydro pump storage system is the only long term technically proven solution without any restriction of Unit capacity, is cost-effective, highly efficient and provides operationally flexible energy storage on a large scale and is available on short notice.**
- **In India the first pumped storage plant was taken up at Nagarjunasagar in Andhra Pradesh in the year 1970 with installed capacity of 700 MW. The project got commissioned during 1980-1985.**

BHEL association in earlier PSS

Out of 4786 MW of PSS capacity in India, BHEL has been associated in the following schemes as partner with foreign manufacturers 

Project	Collaborator	Rating	Rated Head	Rated Speed	Year of commng
Kadamparai (Tamilnadu)	Boving (T) AEI (G)	4 x 100 MW	341m (T) 381m (P)	500 rpm	Oct 87 till Dec 88
Nagarjun Sagar (AP)	Hitachi (T) MELCO (G)	7 x 100 MW	93m (T) 97m (P)	157.8 rpm	Oct 84 till Dec 85
Srisailam (AP)	Hitachi (T) MELCO (G)	6 x 150 MW	82.8m	136.4 rpm	Mar 01 till Sep 01
Sardar Sarovar (Gujarat)	Hitachi (T) Toshiba (G)	6 x 200 MW	100m (T) 96m (P)	136.4 rpm	Mar 06 till Jun 06
Ghatghar (Maharashtra)	Fuji (T&G)	2 x 125 MW	410m (T) 430 m (P)	500 rpm	Apr 08
Kadana (Gujarat)	Skoda	4 x 60 MW	43.5 (T) 47 (P)	142.8 rpm	May 98

BHEL's concern in PSS

- **While BHEL has been associated in Six PSS projects, BHEL does not possess the qualification requirements as orders were placed on foreign manufactures, with BHEL as partner**
- **BHEL over the years has developed its own technology and is capable of supplying PSS schemes**
- **BHEL is already a leader in design, engineering & supply of large size pumps for Lift Irrigation Schemes**
- **In view of forthcoming requirement of PSS, It would be in the interest of all stakeholders to qualify BHEL for future PSS tenders**

Concerns regarding PQ and suggested way forward

- **E & M package to be a stand alone Package (excluding any civil works); Alternatively E & M works vendor can be a nominated sub-vendor to the civil party**
- **Options for qualification should be available to companies like BHEL who have earlier executed reversible Pump-Turbine sets in India in association with established Pump-Turbine manufacturers**

Proposed Qualification criteria

- A. General Experience: Prime contractor/ lead partner/ JV partner/ EPC contractor having experience of having executed E & M pkg. for a hydro project, valued at 50% of E&M estimated value in last 20 Years**

- B. Specific Experience:**
 - i. Designed, engineered, manufactured, tested, erected/ supervised erection and commissioning/ supervised commissioning of at least one (1) no. reversible Pump Turbine of minimum 50% MW unit capacity OR one (1) no. of Pump of minimum 50% MW unit capacity in last 20 years in India and should be in successful operation.**

Cont...

Proposed Qualification criteria

AND

- ii. **Designed, engineered, manufactured, tested, erected/ supervised erection and commissioned/ supervised commissioning of at least one (1) no. hydro turbine generator set of not less than 50% MW unit capacity in last 20 years in India and should be in successful operation.**

AND

- iii. **Designed, engineered, manufactured, tested, erected/ supervised erection and commissioned/ supervised commissioning of at least one (1) no. Generator of not less than 50% MW (equivalent MVA) unit capacity in last 20 years in India and should be in successful operation.**

Methods of achieving the qualification

Qualification

General Experience

- Prime Contractor, or
- Lead Partner, or
- JV Partner, or
- EPC Contractor meeting the criteria

Specific Experience

Alt I

- Bidder meeting all the specific criteria (i, ii & iii)

Alt II

- Bidder meeting specific Experience under any one/two of the criteria (i, ii & iii) can associate with a firm meeting balance two/ one of the criteria
- Bidder & associate jointly & severally responsible.
- JDU to be submitted with the bid (as per format)

Alt III

- Bidder shall be a joint venture of firms (Max 3 Nos)
- Firms of JV should together meet criteria (i, ii & iii) JV will identify a lead partner.
- JV agreement to be submitted with bid (as per format) along with Division of Work (DOW)

THANK YOU

9 PSS (4785.6 MW) under operation

S.No.	Name of Project/State	Installed Capacity		Pumping Mode Operation	Reasons for not working in Pumping mode
		No. of units	Total (MW)		
1.	Kadamparai, Tamil Nadu	4x100	400	Working	
2.	Bhira, Maharashtra	1x150	150	Working	
3.	Srisaillam LBPH, Andhra Pradesh	6x150	900	Working	
4.	Ghatgar, Maharashtra	2x125	250	Working	
5.	Purlia PSS, West Bengal	4x225	900	Working	
6.	Panchet Hill-DVC	1x40	40	Not Working	Tail pool Dam not constructed
7.	Sardar Sarovar Gujarat	6x200	1200	Not Working	Tail pool Dam under construction
8.	Kadana St.I & II Gujarat	2x60+2x60	240	Not Working	Due to vibration problem
9.	Nagarjuna Sagar, Andhra Pradesh	7x100.80	705.60	Not Working	Tail pool Dam constructed but not yet operational
		Total	4785.60		

