



सत्यमेव जयते

भारत सरकार  
Government of India  
विद्युत मंत्रालय  
Ministry of Power  
केन्द्रीय विद्युत प्राधिकरण  
Central Electricity Authority  
पावर कम्युनिकेशन डवलपमेंट प्रभाग  
Power Communication Development Division

No./CEA/PCD/PTCC/RAJ-627/1016-1017

Date: 15.10.2019

DET (PTCC), Northern Zone,  
Bharat Sanchar Nigam Limited (BSNL),  
O/o PGM (N), Inspection Circle,  
CTS Compound, Netaji Nagar,  
New Delhi - 110023

**Subject:** Final PTCC route approval in respect of PTCC proposal for 400 KV DCSS transmission line from 400 KV switchyard of M/S Renew Solar power private ltd. to 765/400 KV PGCIL substation at Jalasar, Bikaner

**Reference:** Defence letter no. B/46937/Sigs 7(b)/1696 dated 03.09.2019

Induced Voltage Calculation on paralleling BSNL and Railway telecom circuits for provisional PTCC clearance of the above mentioned line were issued vide this office letter no. CEA/PCD/PTCC/RAJ-627/944-946 dated 30.08.2019. The Defence Authority have issued No Objection Certificate vide above reference (enclosed as Annexure).

Taking above into consideration, you are requested to issue Final PTCC route approval.

**Encl.:** As above

राष्ट्रकेन्द्र प्रशासक सिंह  
R.P. Singh 15.10.19  
(Director, PTCC)

m/c

Copy to:

AGM, Power Evacuation, Renew Solar Power Pvt. Ltd., 138, Ansal Chambers II, Bikaji Cama Place, Delhi-110066.



Tele : 23019746

Annexure

PD - RAJ-627

Directorate General of Signals  
Signals 7  
General Staff Branch  
Integrated HQ of MoD, (Army)  
DHQ PO, New Delhi - 110011


B/46937/Sigs 7(b)/1696 /

03 Sep 2019

AGM, Power Evacuation  
Renew Solar Power Private Limited  
138, Ansal Chambers II, Bikaji Cama Place,  
Delhi-110066

PTCC CLEARANCE FOR 400KV DCSS RENEW SOLAR POWER PLANT SWITCHYARD,  
BIKANER-765KV PGCIL S/S JALALSAR LINE

1. Ref your letter No Renew/Bikaner/46 dt 01 May 2019 (copy att).
2. No Objection Certificate (NOC) is accorded based on inputs provided vide Map sheet received under your letter mentioned above.
3. Documents along with map sheets (in original) are returned herewith for your further necessary action.

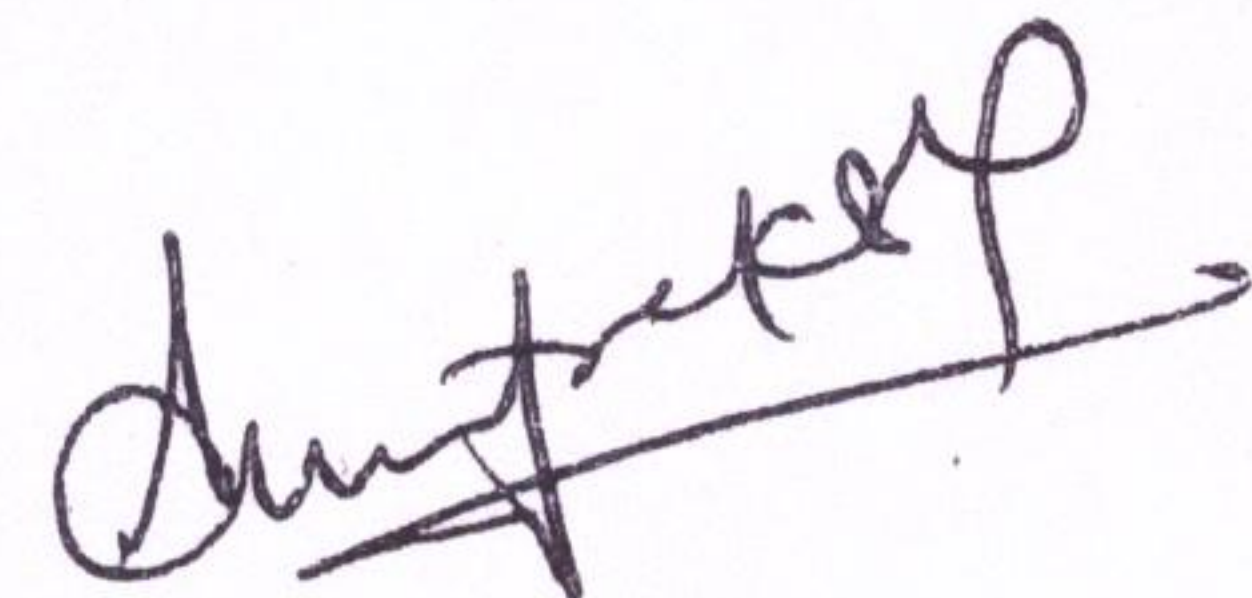

(A Rawat)  
Maj  
GSO 1 (Comn)  
for SO-in-C

Enclosures : As above

Copy to :-

✓ The Director (PTCC), CEA  
Power Communication Development Division  
NRPC Complex, 18-A Shaheed Jeet Singh Marg  
Katwaria Sarai, New Delhi - 110016

Divisional Engineer Telegraph (PTCC)  
O/o GM (North); BSNL, QA & Inspection Circle,  
CTS Compound, Africa Avenue Road,  
Netaji Nagar, New Delhi-110023

for information

~~SH. TAMUJ~~  
~~PP~~  
~~9/9~~  
~~6/9~~

1/14  
6/9/2019