

NRSS XXXVI Transmission Limited

Correspondence Address: 6th floor, Plot No. 19 & 20, Film City, Sector 16-A, Noida, Uttar Pradesh -201301 Tel.: +91 120 4849500 | www.esselinfraprojects.com

Ref: NRSS XXXVI/DEL/2018/ 74

Dated: 5th April, 2018

To

Chief Engineer (PSPM),
Central Electricity Authority
Sewa Bhawan, R. K. Puram, Sector -1,
New Delhi-110066

Sub: System Strengthening Scheme in Northern Region (NRSS - XXXVI) – Traversing of 400 KV D/C Koteshwar – Rishikesh Transmission Line through the premises of Indian Drugs and Pharmaceuticals Limited (IDPL), Rishikesh.

- Ref : 1) CEA Letter No. CEA/PSPM/1/57/33/2017/1982-84 dated 27.11.2017
2) IDPL Letter No. IDR (R)/GM-12/2017-126 dated 12.12.2017
3) IDPL Letter No. IDR (R)/GM-12/2018-09 dated 18.01.2018
4) NRSS XXXVI Letter No. NRSS XXXVI/DEL/2018/57 dated 23.01.2018
5) NRSS XXXVI Letter No. NRSS XXXVI/DEL/2018/58 dated 01.02.2018
6) IDPL Letter No. IDR (R)/GM-12/2018-17 dated 06.02.2018
7) NRSS XXXVI Letter No. NRSS XXXVI/DEL/2018/62 dated 09.02.2018
8) NRSS XXXVI Letter No. NRSS XXXVI/DEL/2018/64 dated 23.02.2018
9) CEI Letter No. CEI/1/1/2018 dated 05.03.2018.
10) NRSS XXXVI Letter No. NRSS XXXVI/DEL/2018/67 dated 09.03.2018
11) NRSS XXXVI Letter No. NRSS XXXVI/DEL/2018/71 dated 13.03.2018
12) Meeting held in CEA on 03.04.2018.

Dear Sir,

This is in reference to the meeting held in CEA on 3rd April 2018 regarding traversing of 400 KV D/C Koteshwar – Rishikesh Transmission Line through the premises of Indian Drugs and Pharmaceuticals Limited (IDPL), Rishikesh.

As per discussions held in the meeting, the locations of Towers from AP 74/0 to AP 76/0 of the line has been shifted towards the IDPL boundary so that max. horizontal clearance is maintained from the nearest building.

After incorporating the suggested changes as discussed in the meeting, the revised co-ordinates for the locations falling inside the IDPL premises are as under:

Sl. No	AP. Nos.	Tower Type	UTM Coordinate		Angle of Deviation	Span Length
			Easting	Northing		
1	AP-74	DD+9	236145	3331175	59°28'58.7"	267
2	AP-75	DB+9	236044	3330928	7°32'7.7"	231
3	AP-76	DB+9	235929	3330727	11°2'59"	258
4	AP-77	DB+0	235761	3330531	4°52'22.8"	257
5	77/1	DA+0	235580	3330349		258

NRSS XXXVI Transmission Limited

Correspondence Address: 6th floor, Plot No. 19 & 20, Film City, Sector 16-A, Noida, Uttar Pradesh -201301 Tel.: +91 120 4849500 | www.esselinfraprojects.com

6	AP-78	DD+0	235398	3330165	85°26'52"	117
7	AP-79	DD+0	235472	3330074	38°5'47.9"	304
8	79/1	DA+0	235767	3330003		304
9	79/2	DA+0	236063	3329932		304
10	AP-80	DD+3	236359	3329861	88°53'26.7"	287
11	80/1	DA+0	236303	3329579		287
12	AP-81	DD+0	236246	3329298	53°41'11"	115
13	AP-82	DD+0	236324	3329213	67°30'22.3"	331
14	AP-83	DB+0	236185	3328913	11°52'12.4"	331
15	AP-84	DD+25	235991	3328644	42°43'48.5"	170
16	AP-85	DD+25	235825	3328608	43°1'6.2"	

The revised route map drawing from AP 74/0 to AP 77/0 specifying the clearance from nearest building is also enclosed.


As we are unable to start the construction work in the Line for non-issuance of NOC by IDPL, it is requested to kindly extend your support in the matter.

Thanking you and looking forward for your kind support.


Yours Faithfully

NRSS XXXVI Transmission Limited

(Amit Kumar)
Director



Copy to : Chief Engineer, Chief Electrical Inspectorate Divn., 18-A, Shaheed Jeet Singh Marg,
Katwaria Sarai, New Delhi-110016

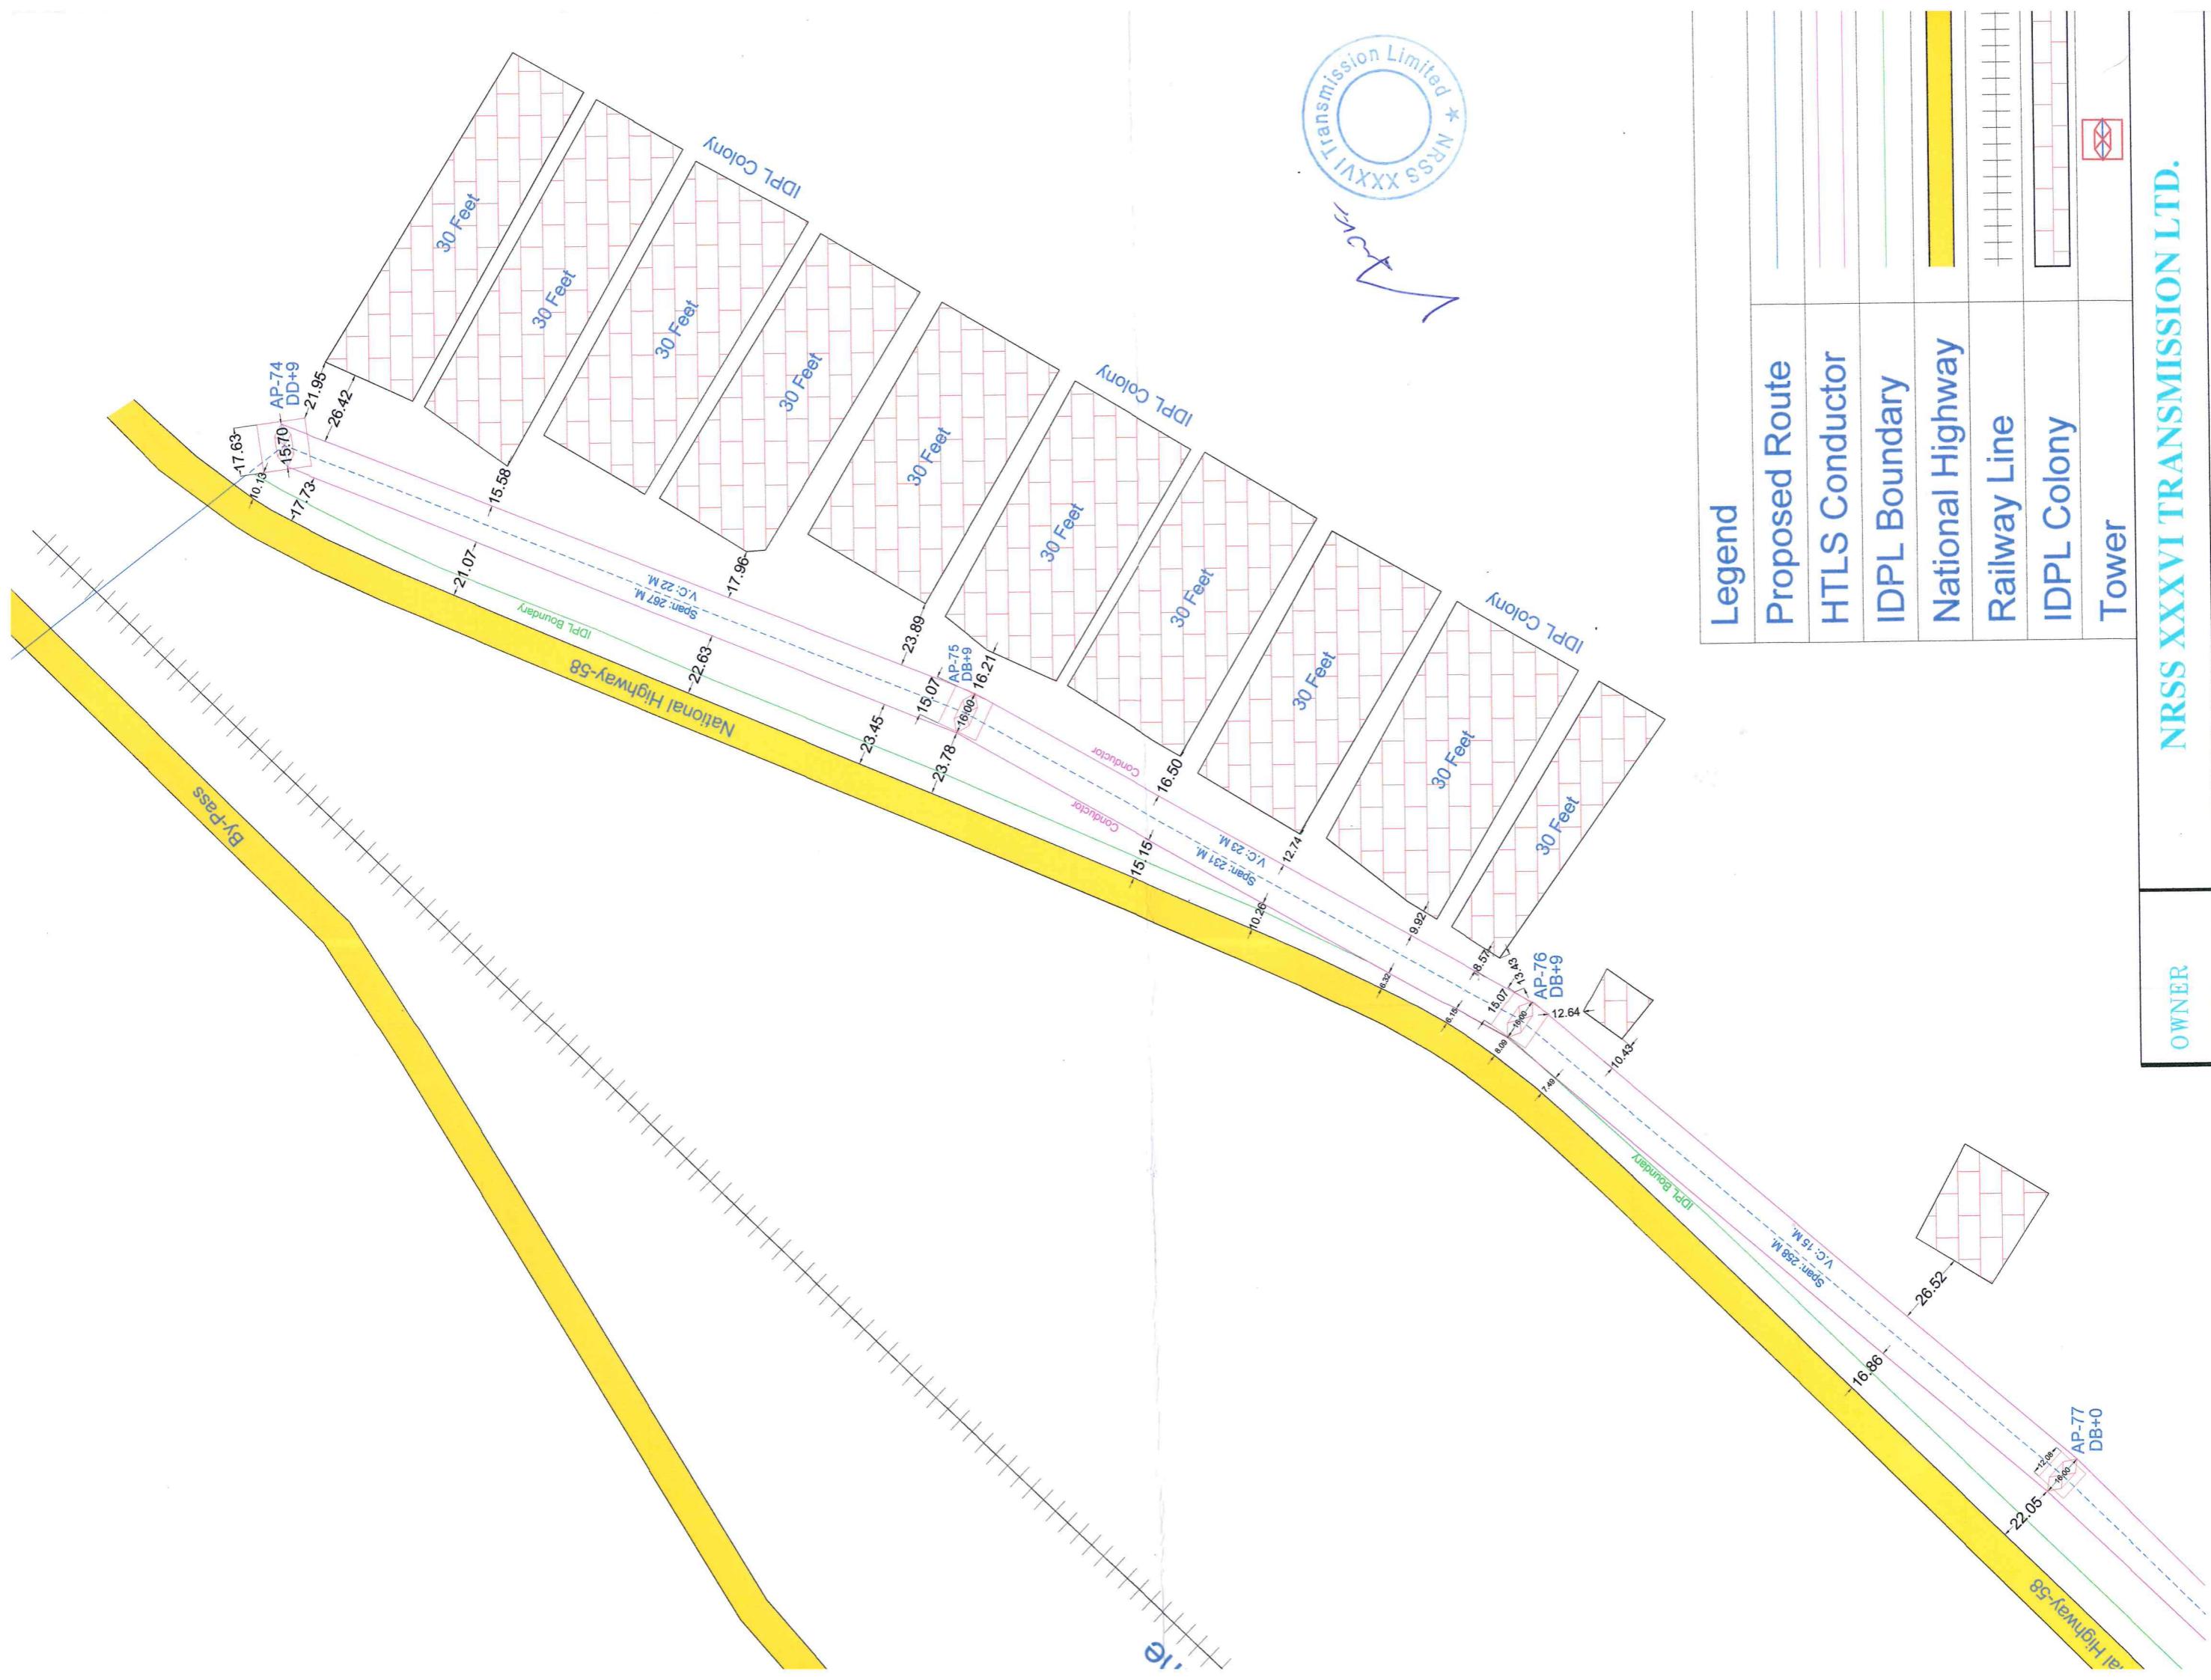

Legend	
Proposed Route	
HTLS Conductor	
IDPL Boundary	
National Highway	
Railway Line	
IDPL Colony	
Tower	

OWNER	NRSS XXXVI TRANSMISSION LTD.
PROJECT	System Strengthening Scheme in Northern Region (NRSS-XXXVI) along with LILO of Sikar-Neemrana 400kV D/C Line at Babai (RRVPNL)
LINE NAME	KOTESHWAR POOLING STATION - RISHIKESH 400kV D/C (TWIN HTLS) TRANS. LI