


POWER EVACUATION ARRANGEMENT FROM CHANDRABHAGA BASIN IN HP

(LAHAUL & SPITI)

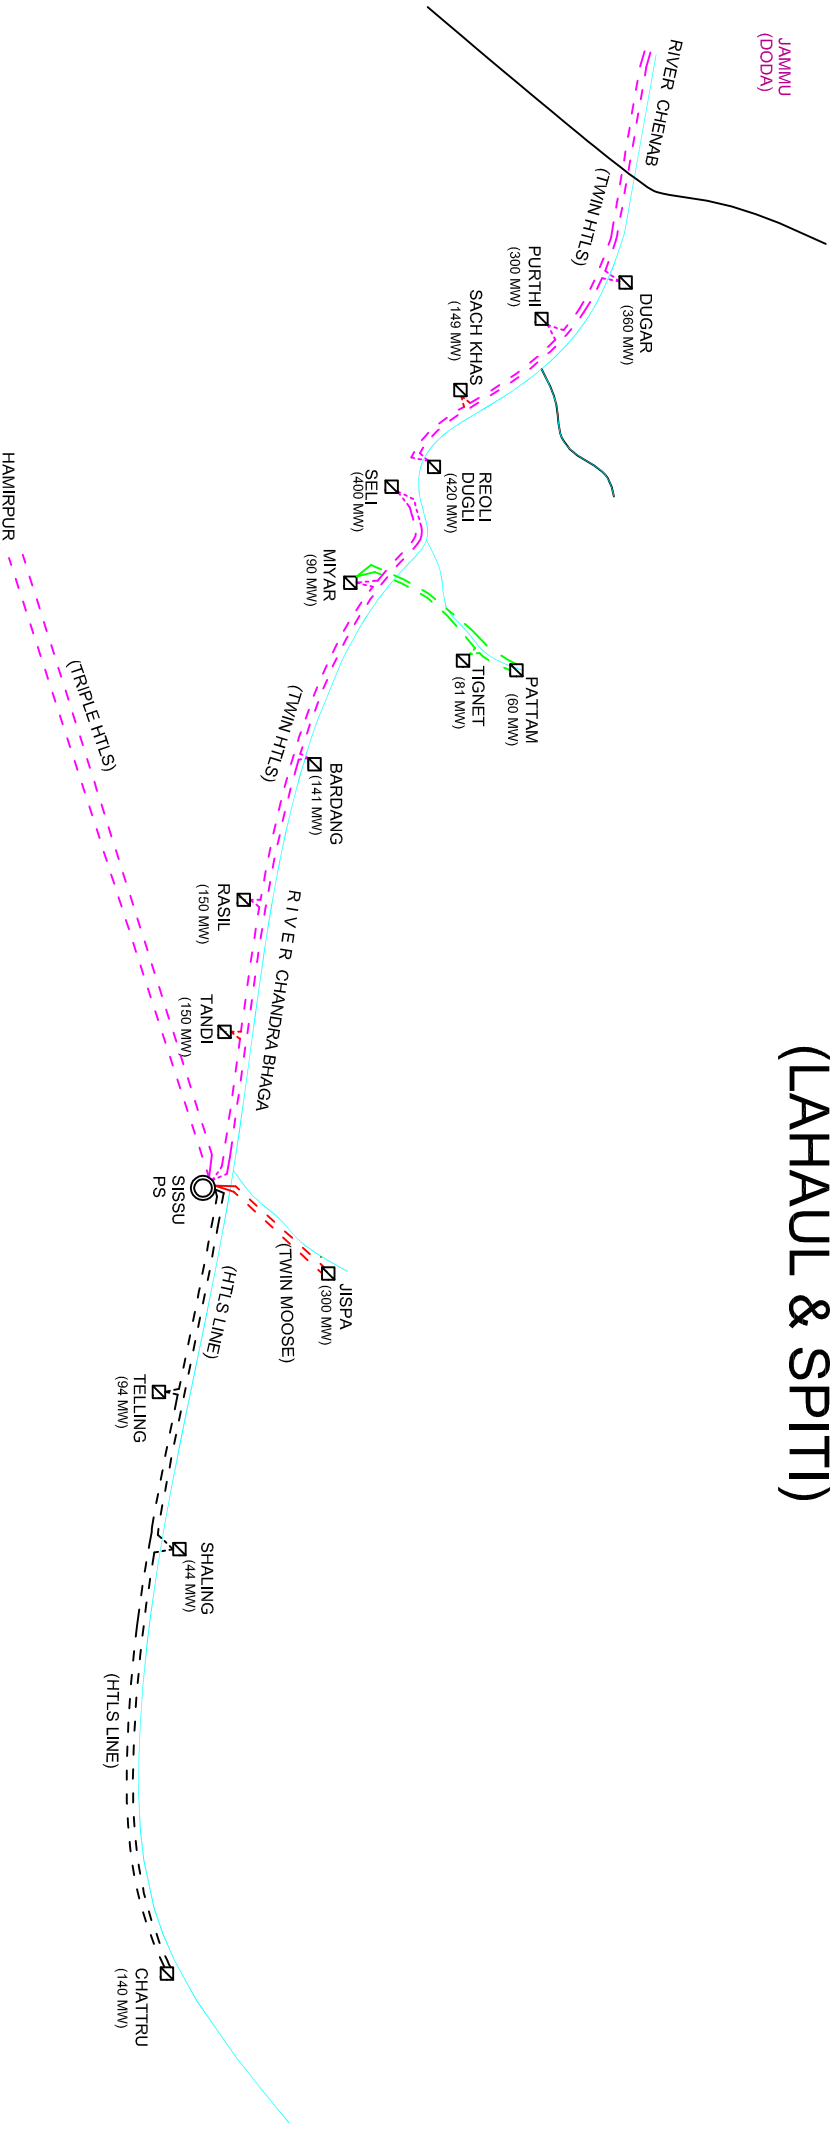

LEGEND

Existing	Proposed
400 kV (HTLS)	400 kV (HTLS)
400 kV (TWIN MOOSE)	400 kV (TWIN MOOSE)
220 kV (HTLS)	220 kV (HTLS)
220 kV	220 kV
POOLING POINT	POOLING POINT
HEP	HEP